
FED. ROAD	STATE	FED. AID	FISCAL	SHEET	TOTAL
DIST. NO.		PROJ. NO.	YEAR	NO.	SHEETS
HAWAII	HAW.	STP-011-1(22)	1999	10	14

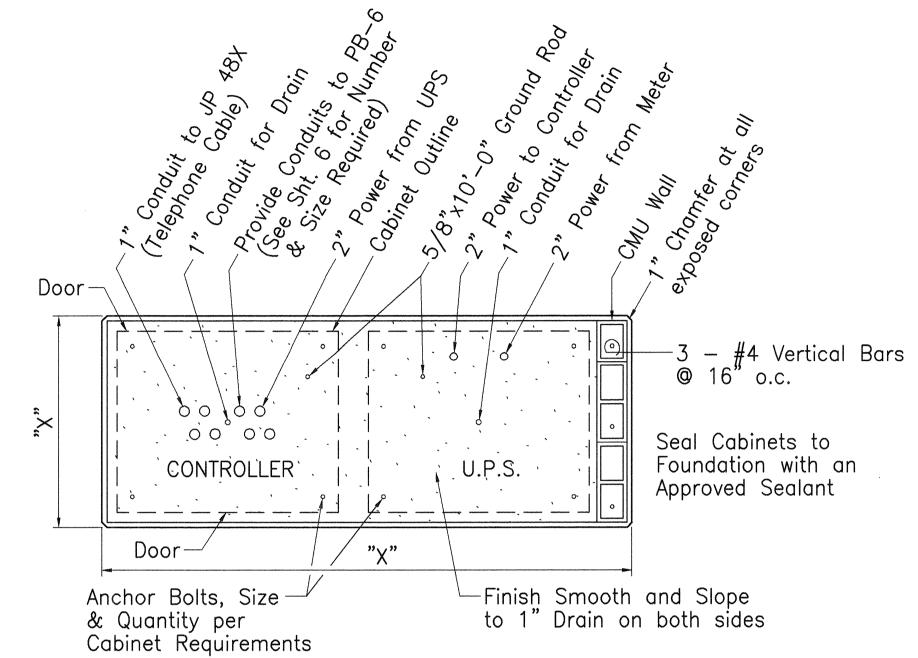


NOTE: The Contractor shall verify all conduit requirements prior to installation.

Dimensions of Concrete Base to be determined by size of Controller and U.P.S. Cabinet. Details of Anchor Bolts, Conduits, etc. shall be as per manufacturer recommendations and secured by the Contractor.

"X" = Size of Concrete Foundation. To be 3" larger than Cabinet all around. NOTE: The Contractor shall verify all conduit requirements prior to installation.

<u>PLAN</u>

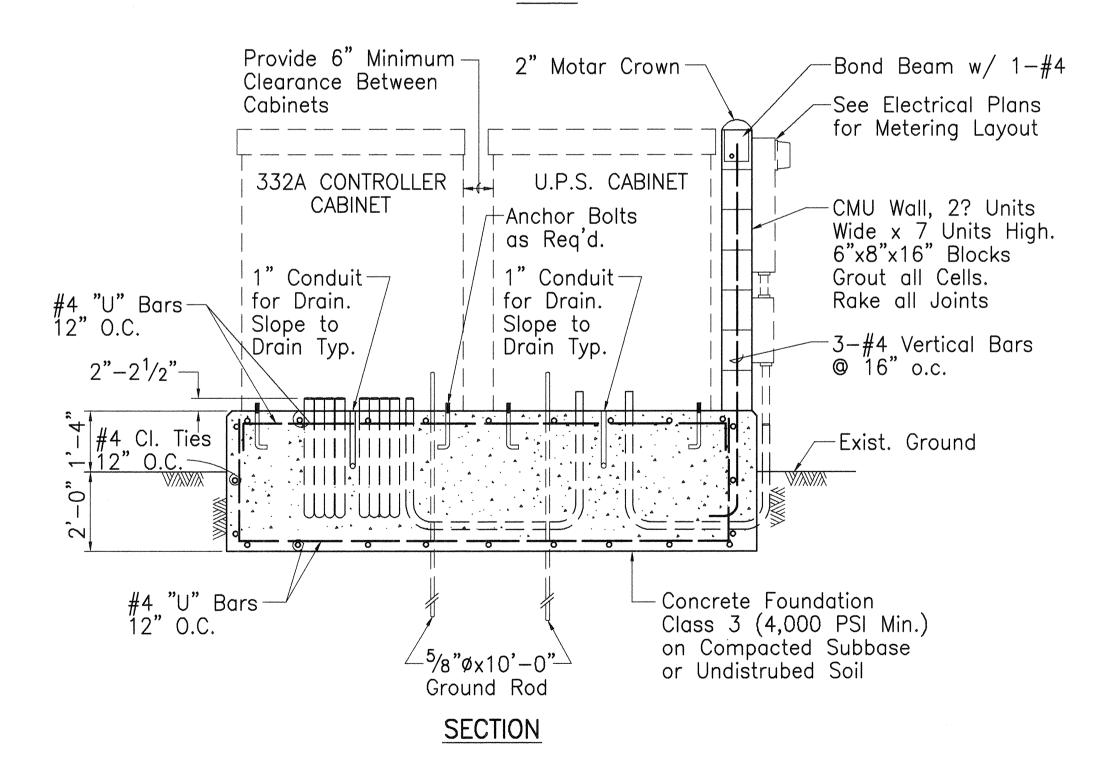

UNINTERRUPTED POWER SUPPLY (UPS) UNIT & CONTROLLER CABINET FOUNDATION

Not to Scale

STATE OF HAWAII

DEPARTMENT OF TRANSPORTATION

HIGHWAYS DIVISION

MISCELLANEOUS DETAILS

KUAKINI HIGHWAY INSTALLATION OF TRAFFIC SIGNALS AT SEA VIEW CIRCLE FAP NO. STP-011-1(22)

SCALE: AS NOTED

DATE: MARCH 1998

SHEET No. 1 OF 1 SHEETS