


FED. ROAD DIST. NO.	STATE	PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	HWY-K-01-97	1998	6	12

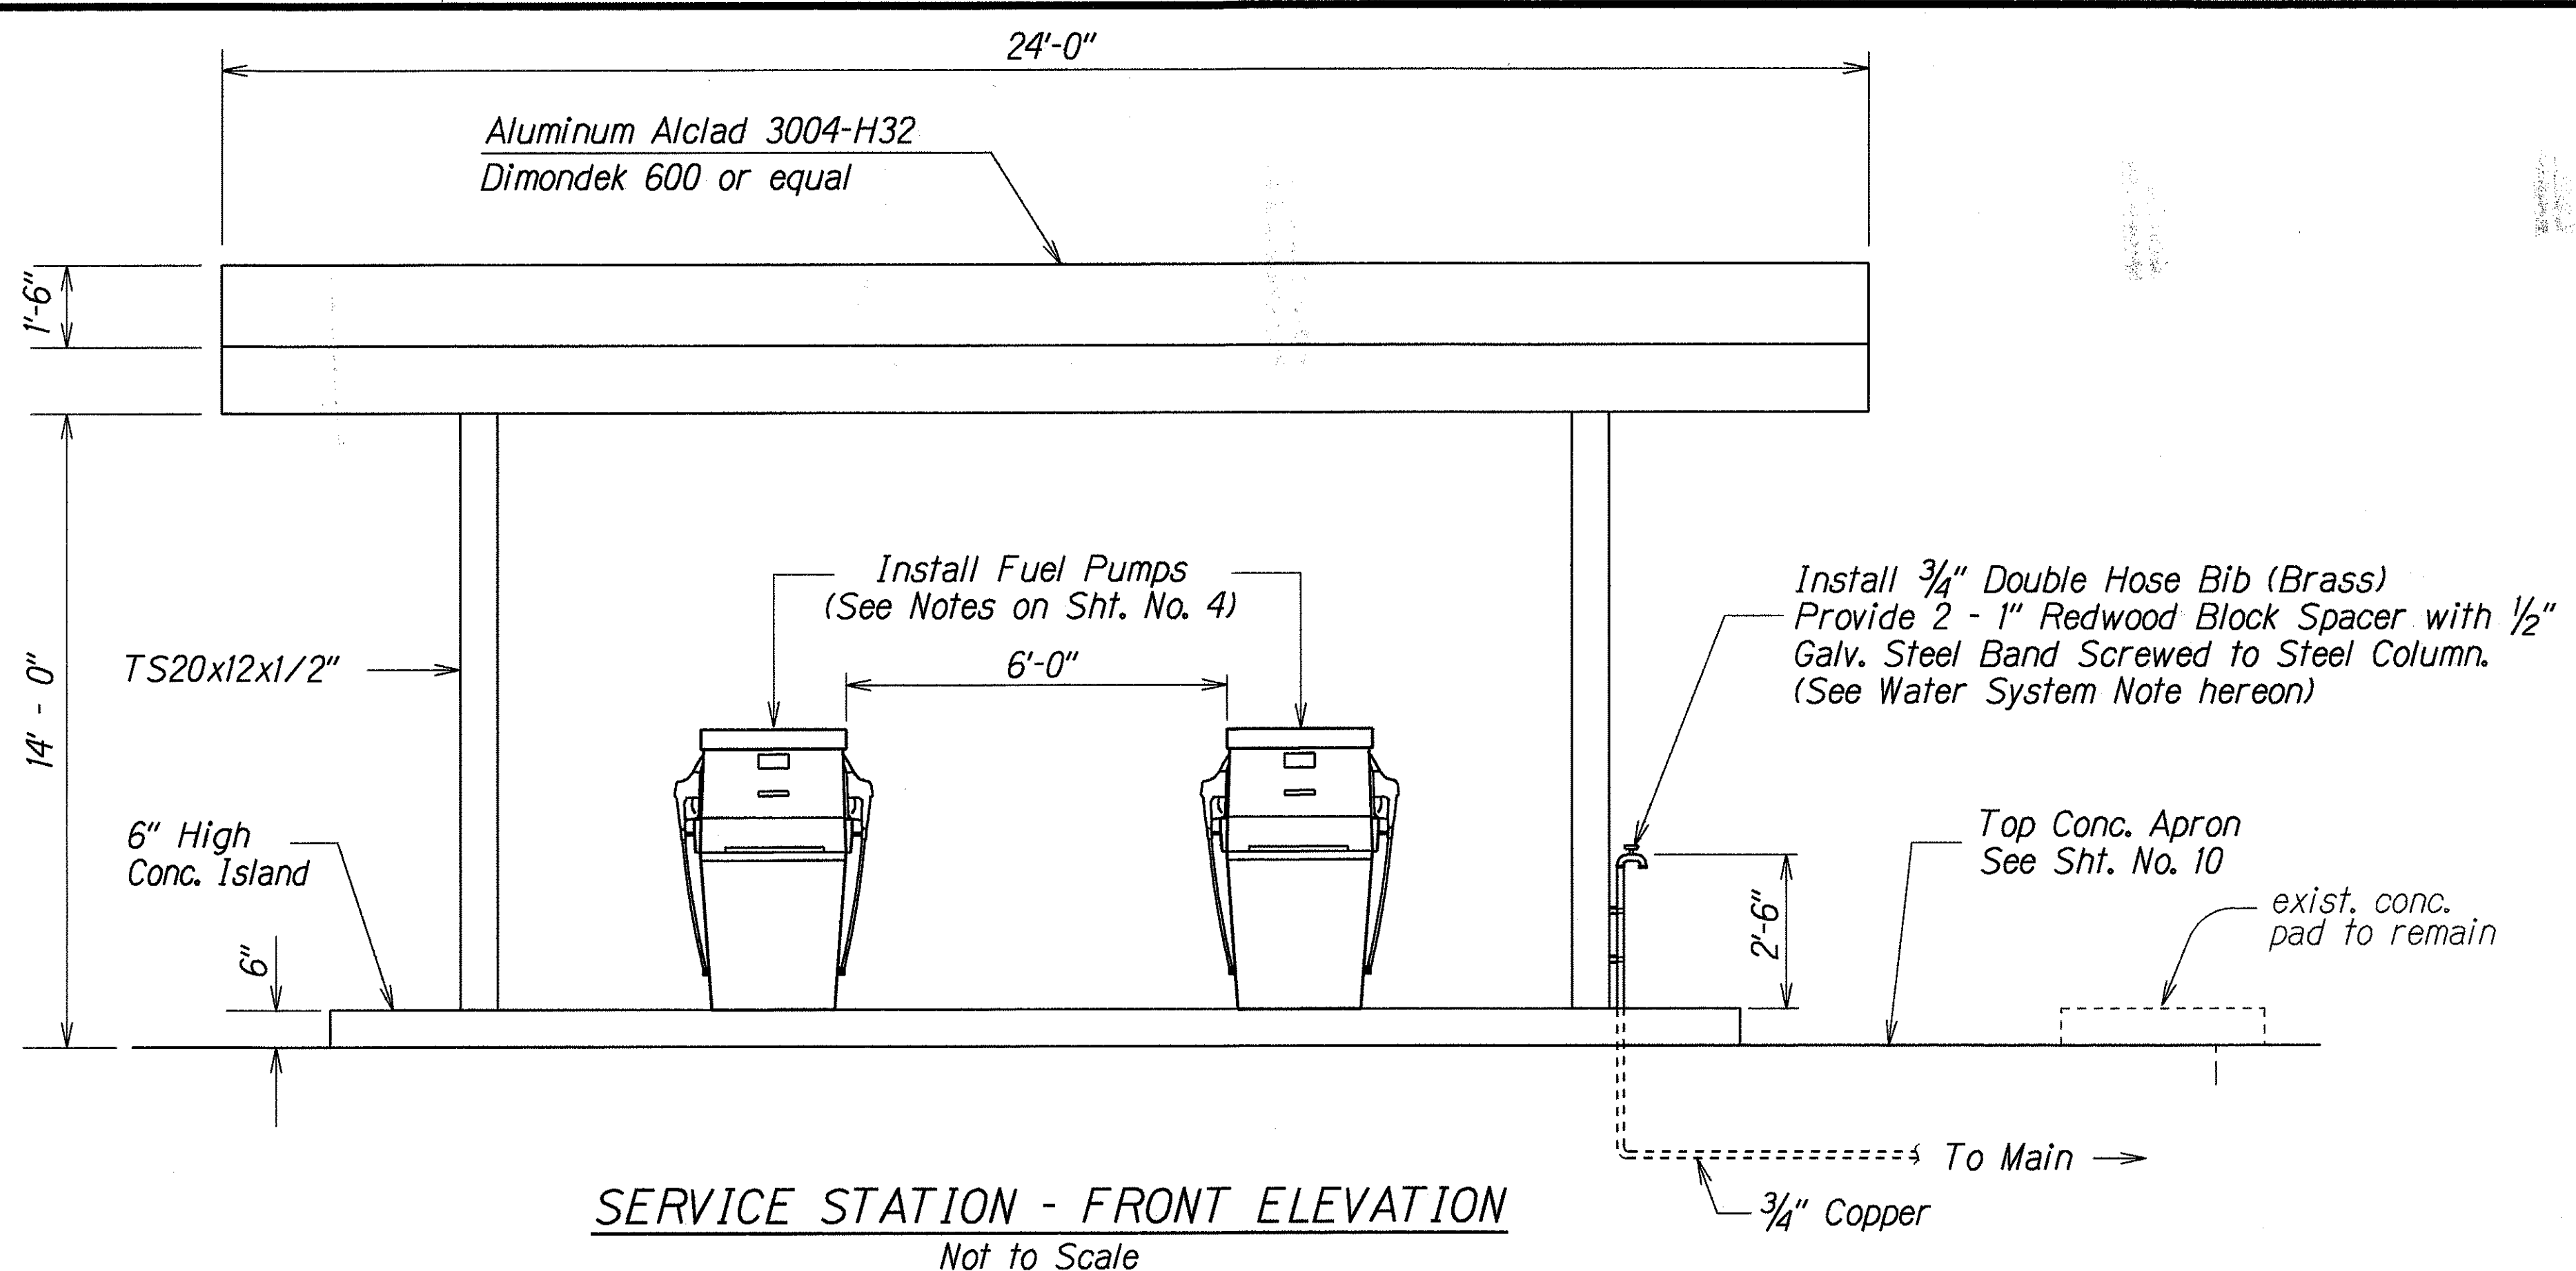


**WATER SYSTEM NOTE:**

1. Water System shall include all materials, tools, equipment, labor and incidentals necessary to complete the work and shall be paid under Item No. 624.1901 - Water System. Include one 25' long x 1/2"Ø rubber hose with brass nozzle with valve for filling radiators.

**ROOFING SYSTEM NOTES:**

1. Roofing material shall be:  
Prepainted Aluminum Alclad 3004-H32  
0.032-inch thick  
21,000 psi min. yield  
Dimondek 600 or equal
2. For fastener, stainless steel single clips shall be placed on every purlin. Use stainless steel screws (type 410) with the steel clips, or as recommended by the manufacturer and approved by the Engineer.
3. Flashing shall be fabricated from the same material and finish as the roofing materials. Flashing is made in 10-foot lengths and laps should overlap at least 4 inches and sealed with a silicone sealant. Attachment of the flashing should be allowed for expansion and contraction of the Dimondek roofing.

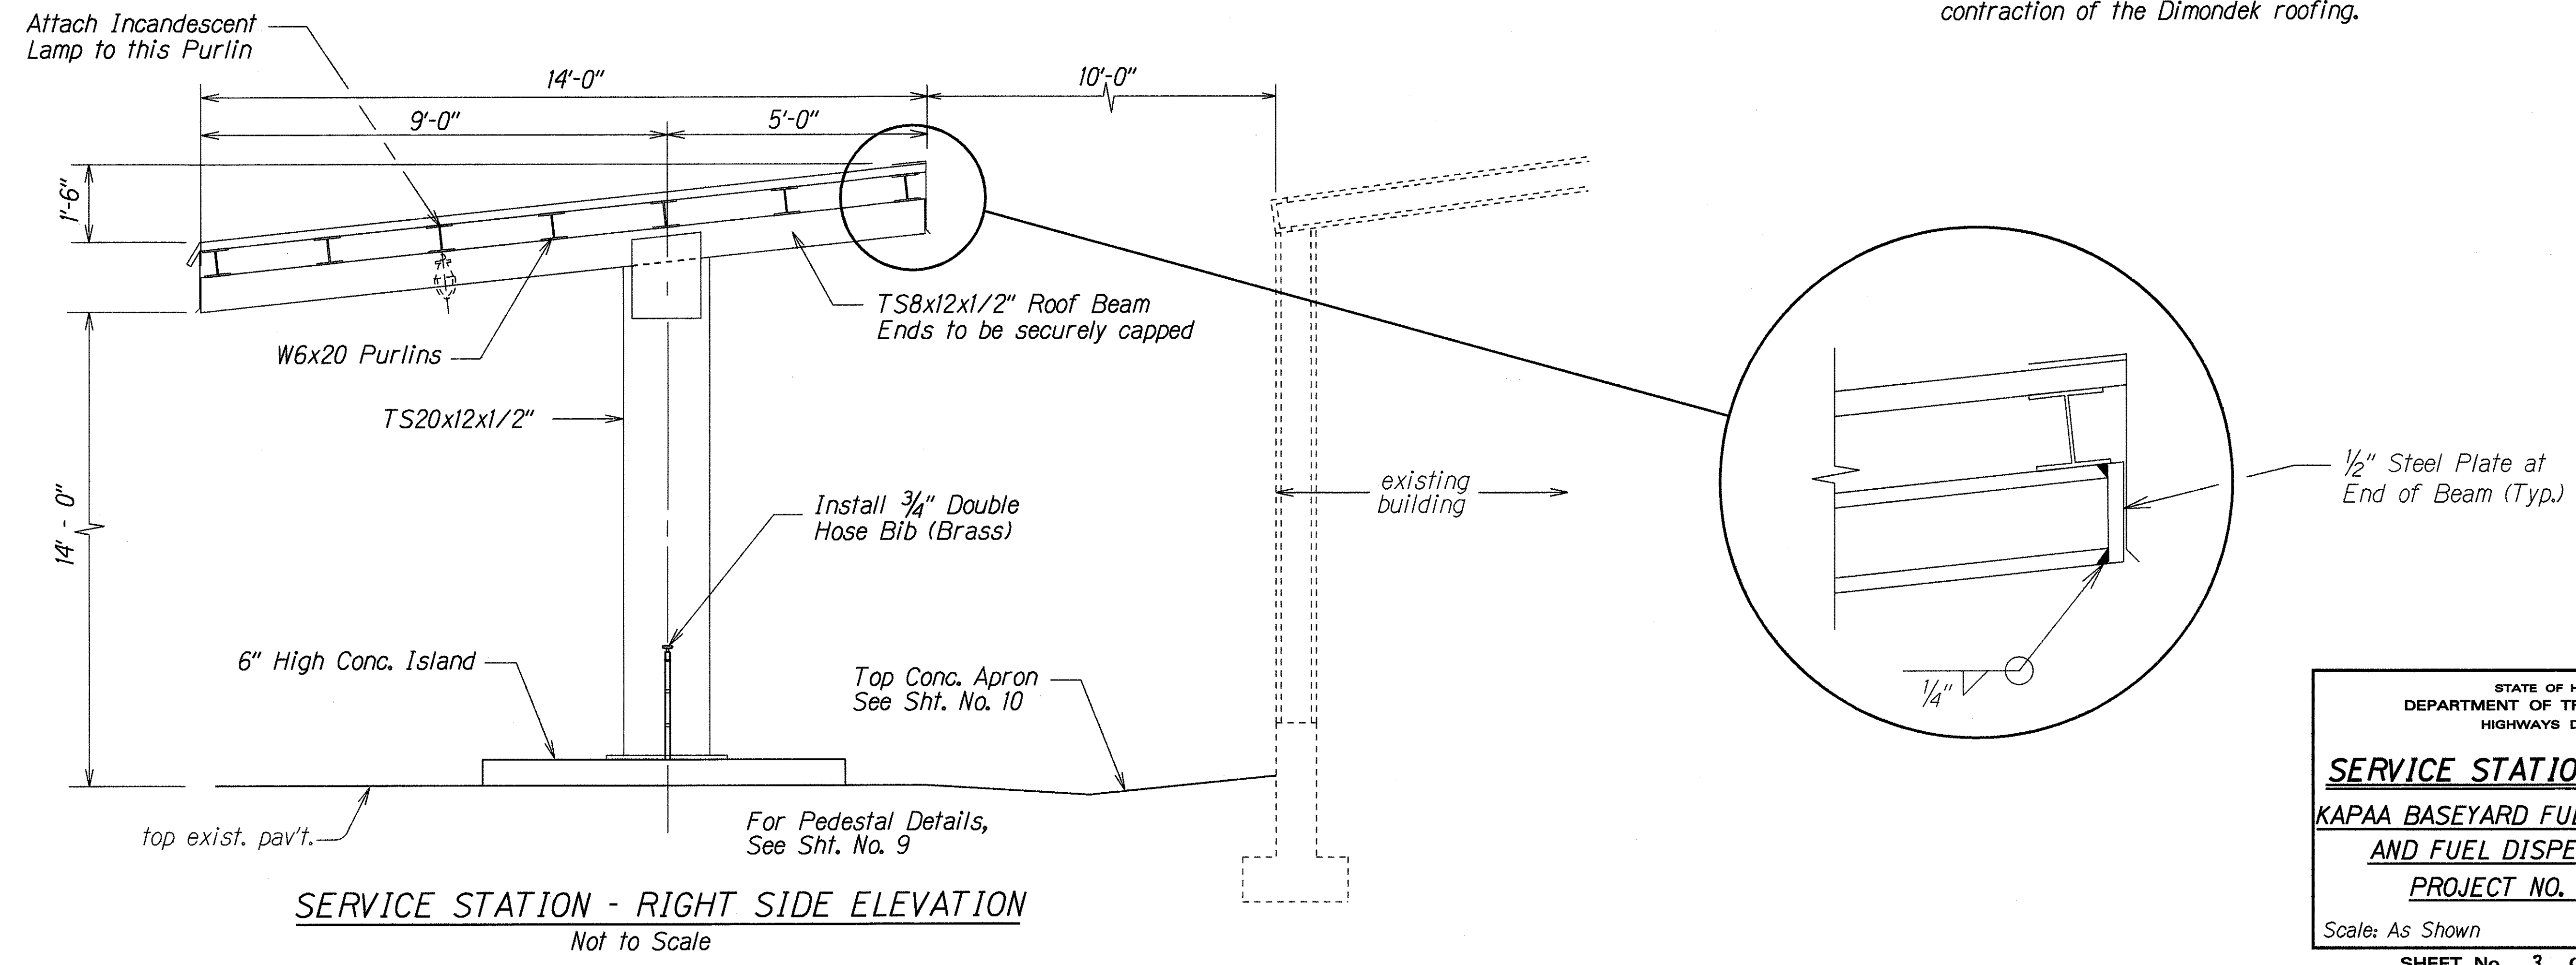

DESIGNED BY	DATE
DRAWN BY	11-2-97
CHECKED BY	
NOTED BY	
QUANTITIES BY	
ORIGINAL PLAN	

STATE OF HAWAII  
DEPARTMENT OF TRANSPORTATION  
HIGHWAYS DIVISION

**SERVICE STATION ELEVATIONS**  
KAPAA BASEYARD FUEL STORAGE TANK  
AND FUEL DISPENSING SYSTEM  
PROJECT NO. HWY-K-01-97

Scale: As Shown Date: November, 1997

SHEET No. 3 OF 8 SHEETS