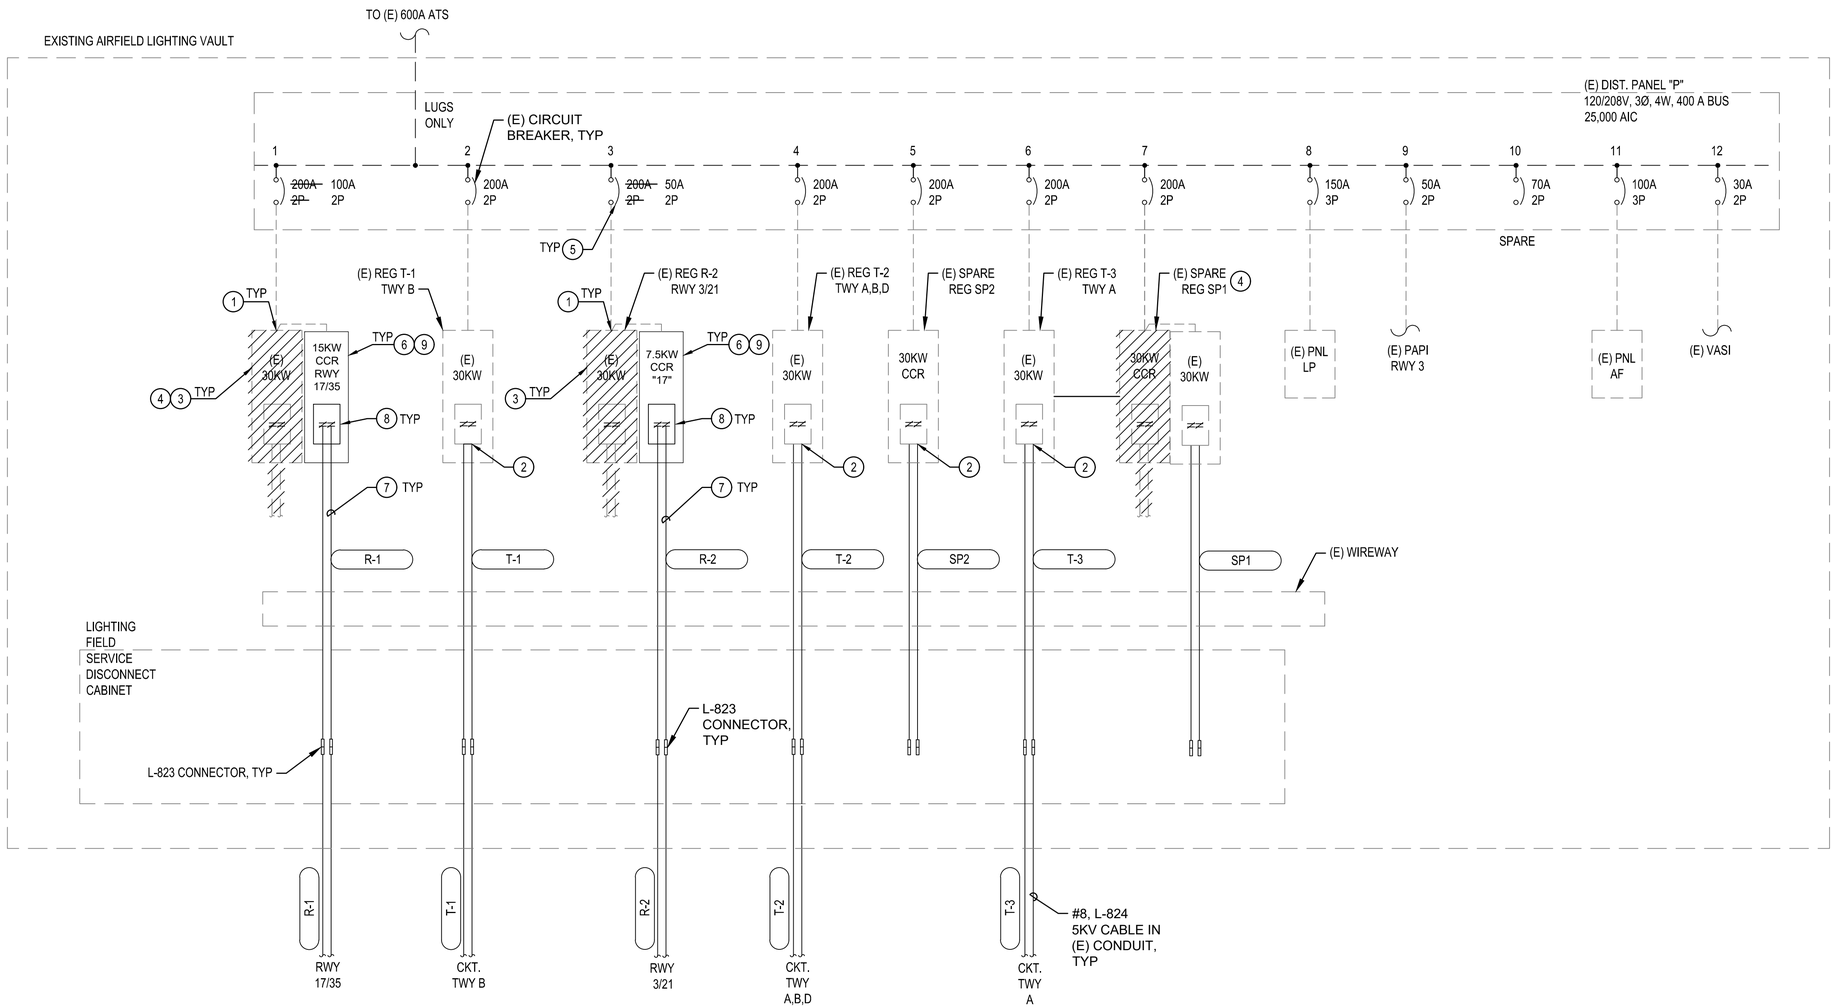

SHEET NOTES:

1. ALL EXISTING EQUIPMENT SHOWN SHALL BE PROTECTED IN PLACE, UNLESS OTHERWISE INDICATE,

NOTES:

1. DISCONNECT (E) CONDUCTORS AND CONNECT TO (N) CCR AS INDICATED.
2. REMOVE AND REPLACE (E) L-824 CABLE WITH NEW. CONNECT (N) L-824 TO (E) S1 SERIES DISCONNECT
3. REMOVE (E) CCR AND REPLACE WITH (N), PROVIDE LABEL PER SPECIFICATIONS.
4. REMOVE (E) "REG SP1" AND REPLACE WITH (E) 30KW, 3-STEP CCR REG. R-2 RWY 3/21, RENAME RELOCATED CCR AS "REG SP1"
5. REMOVE EXISTING CIRCUIT BREAKER AND REPLACE WITH NEW SIZE AS INDICATED. AIC RATING NOT TO LESS 25KAIC.
6. FURNISH AND INSTALL CCR EQUIPED WITH INTEGRATED CONTROL UNIT
7. FURNISH AND INSTALL L-824 CABLE
8. S1 SERIES DISCONNECT INTEGRAL TO CCR HOUSING.
9. INSTALLATION SHALL CONFORM TO LOCAL SEISMIC REQUIREMENTS

Airports Division
DEPARTMENT OF TRANSPORTATION
STATE OF HAWAII

CHRISTOPHER T. BRISKORN
LICENSED PROFESSIONAL ENGINEER
PE-19550
HAWAII, U.S.A.

4/30/24
Expiration Date
CHRIS BRISKORN, PE
ELECTRICAL ENGINEER

DSGN.	DRWN.	CHKD.	APPD.
HF	HT	JB	DY

KEY PLAN / NOTES:

NO.	DATE	REVISIONS

CONSTRUCTION DOCUMENTS
JULY 2022
DATE

PROJECT TITLE :

RELOCATE RUNWAY 3-21

AT LIHUE AIRPORT LIHUE, KAUAI, HAWAII

PROJECT NO.:

AK1031-14

SHEET TITLE:

SINGLE LINE DIAGRAM

DATE : **07/2022**

SHEET : 374 OF 376 SHEETS

DWG. NO. E5.02

C:\USERS\GALLARDOA\BOX\LIHUE RSA\900-CAD\20-SHEETSIES.02.DWG