

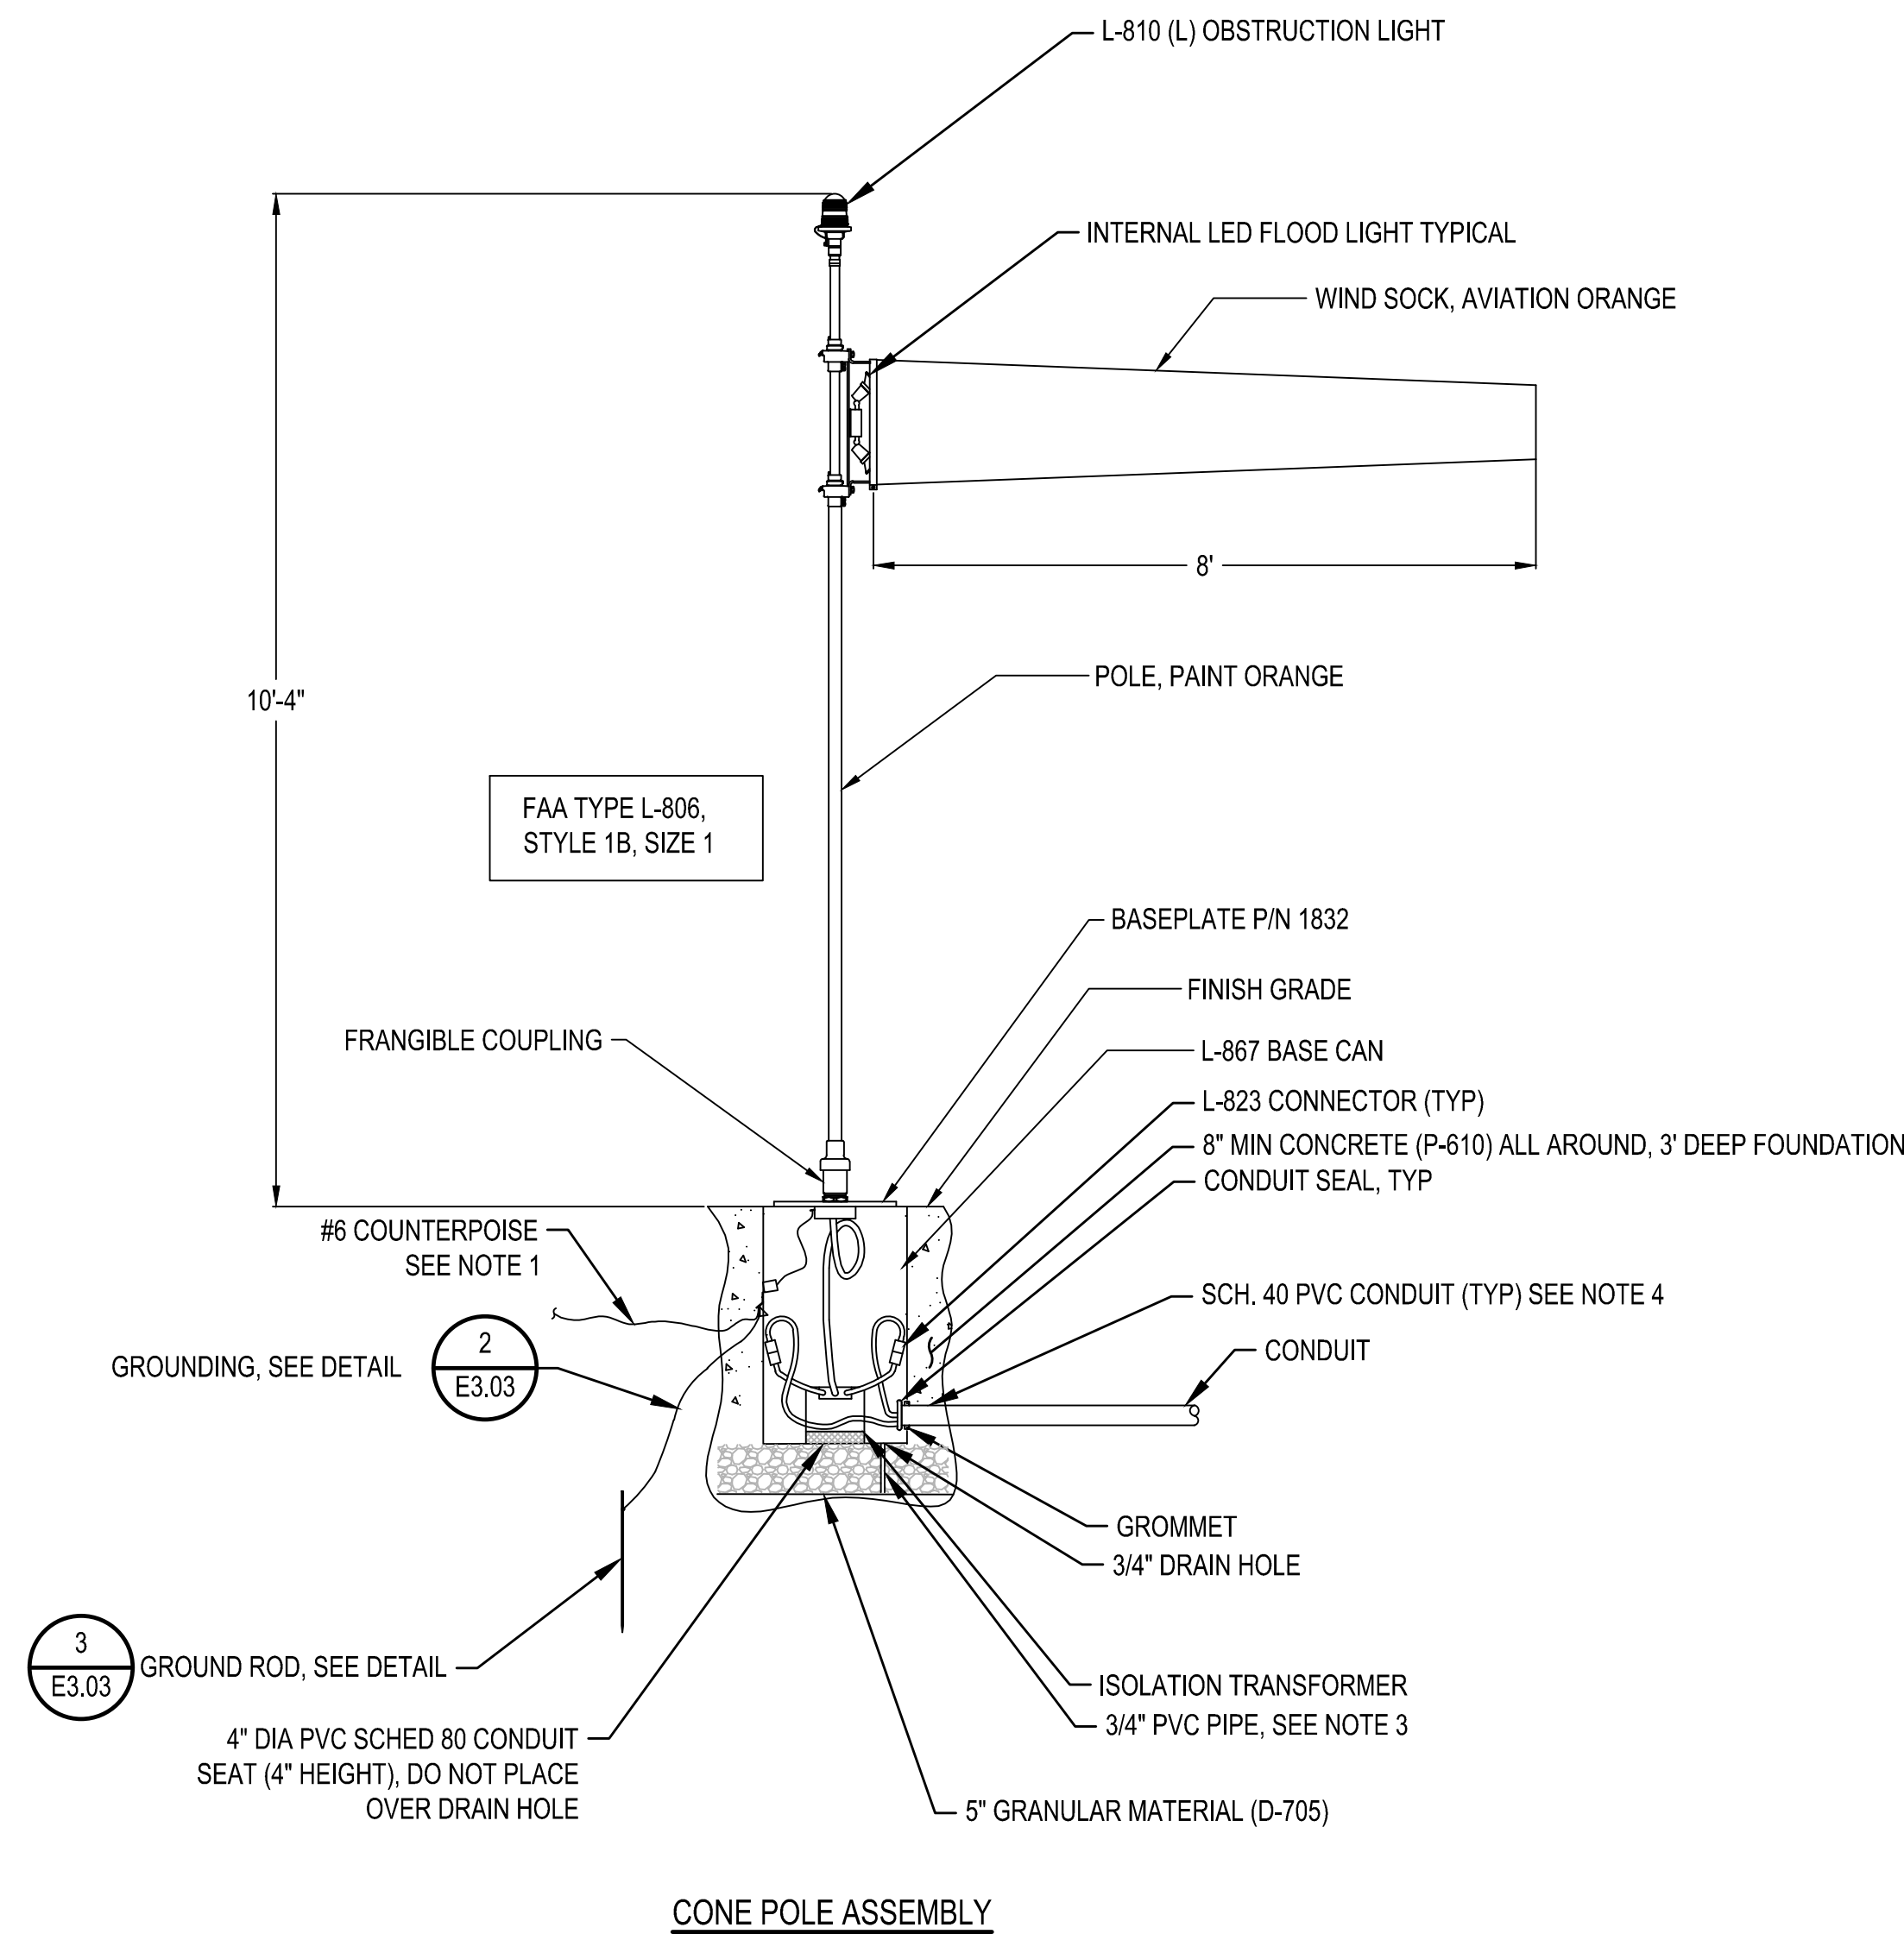


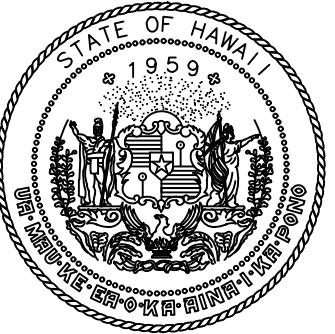


- NOTES:**
- AS REQUIRED, PROVIDE EXTENSION RINGS/SPACERS.
 - EXTEND PVC PIPE DRAIN INTO THE SUBGRADE.
 - LIQUID TIGHT NON-METALLIC FLEXIBLE CONDUIT AS REQUIRED.

L-806 (L) SUPPLEMENTAL
WIND CONE ASSEMBLY
SCALE: N.T.S.

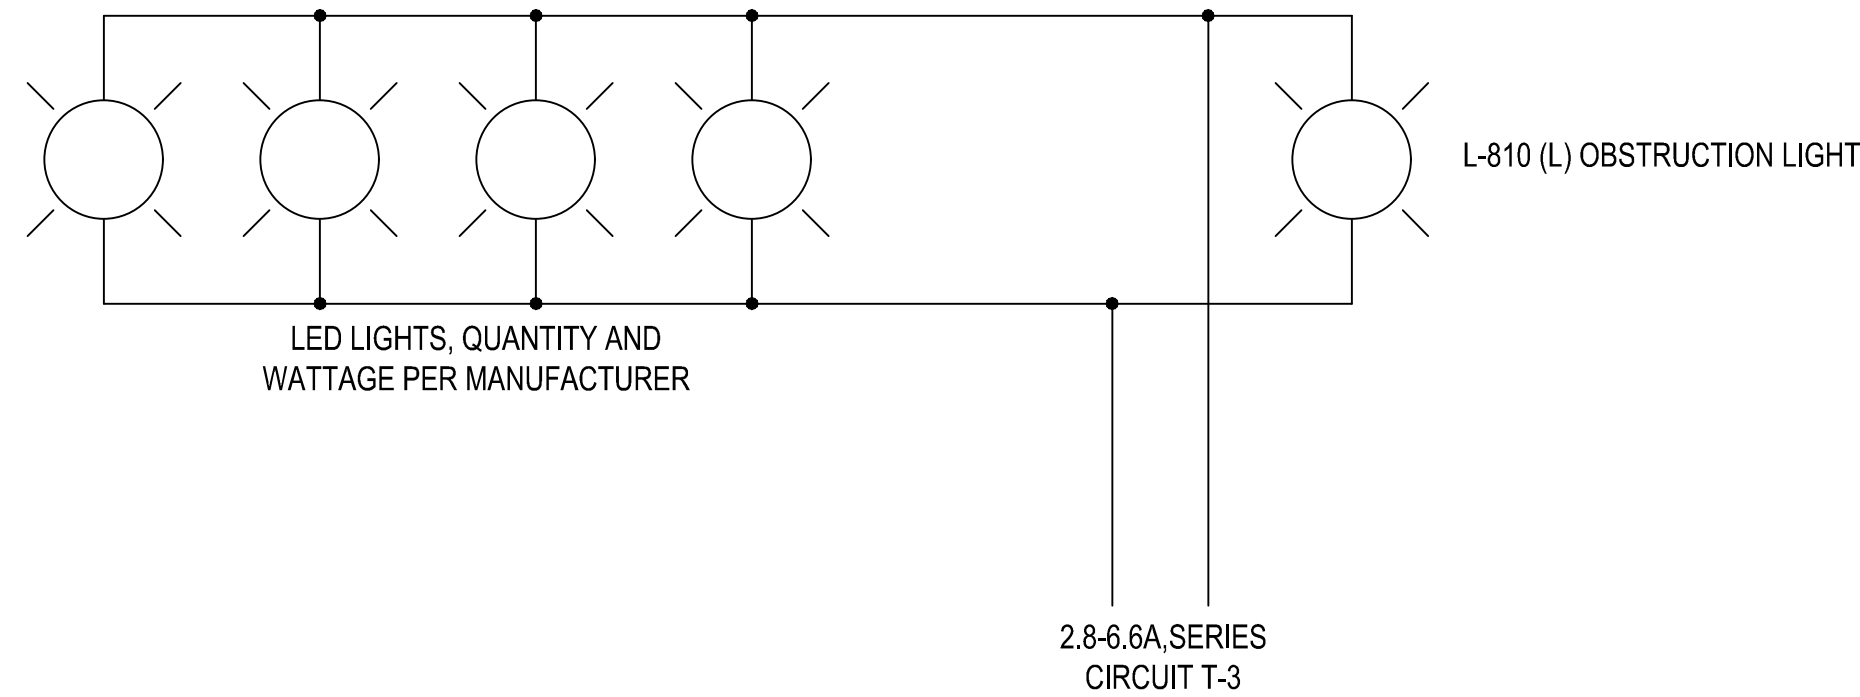

Airports Division
DEPARTMENT OF TRANSPORTATION
STATE OF HAWAII

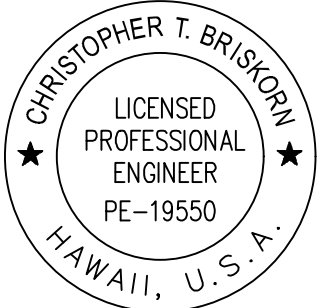

CHRIS BRISKORN, PE
ELECTRICAL ENGINEER
4/30/24
Expiration Date

DSGN.	DRWN.	CHKD.	APPD.
HF	HT	JB	DY

KEY PLAN / NOTES:

NO.	DATE	REVISIONS
-----	------	-----------

CONSTRUCTION DOCUMENTS

JULY 2022
DATE

PROJECT TITLE :

**RELOCATE
RUNWAY 3-21**

AT
LIHUE AIRPORT
LIHUE, KAUAI, HAWAII

PROJECT NO.:

AK1031-14

SHEET TITLE:

WIND CONE DETAILS

DATE :	DWG. NO.
07/2022	E3.08
SHEET :	
352 OF 376 SHEETS	