


DIST. NO.	STATE	PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
KAUAI	HAW.	50B-01-14	2020	34	44


SITE ELECTRICAL SYMBOLS

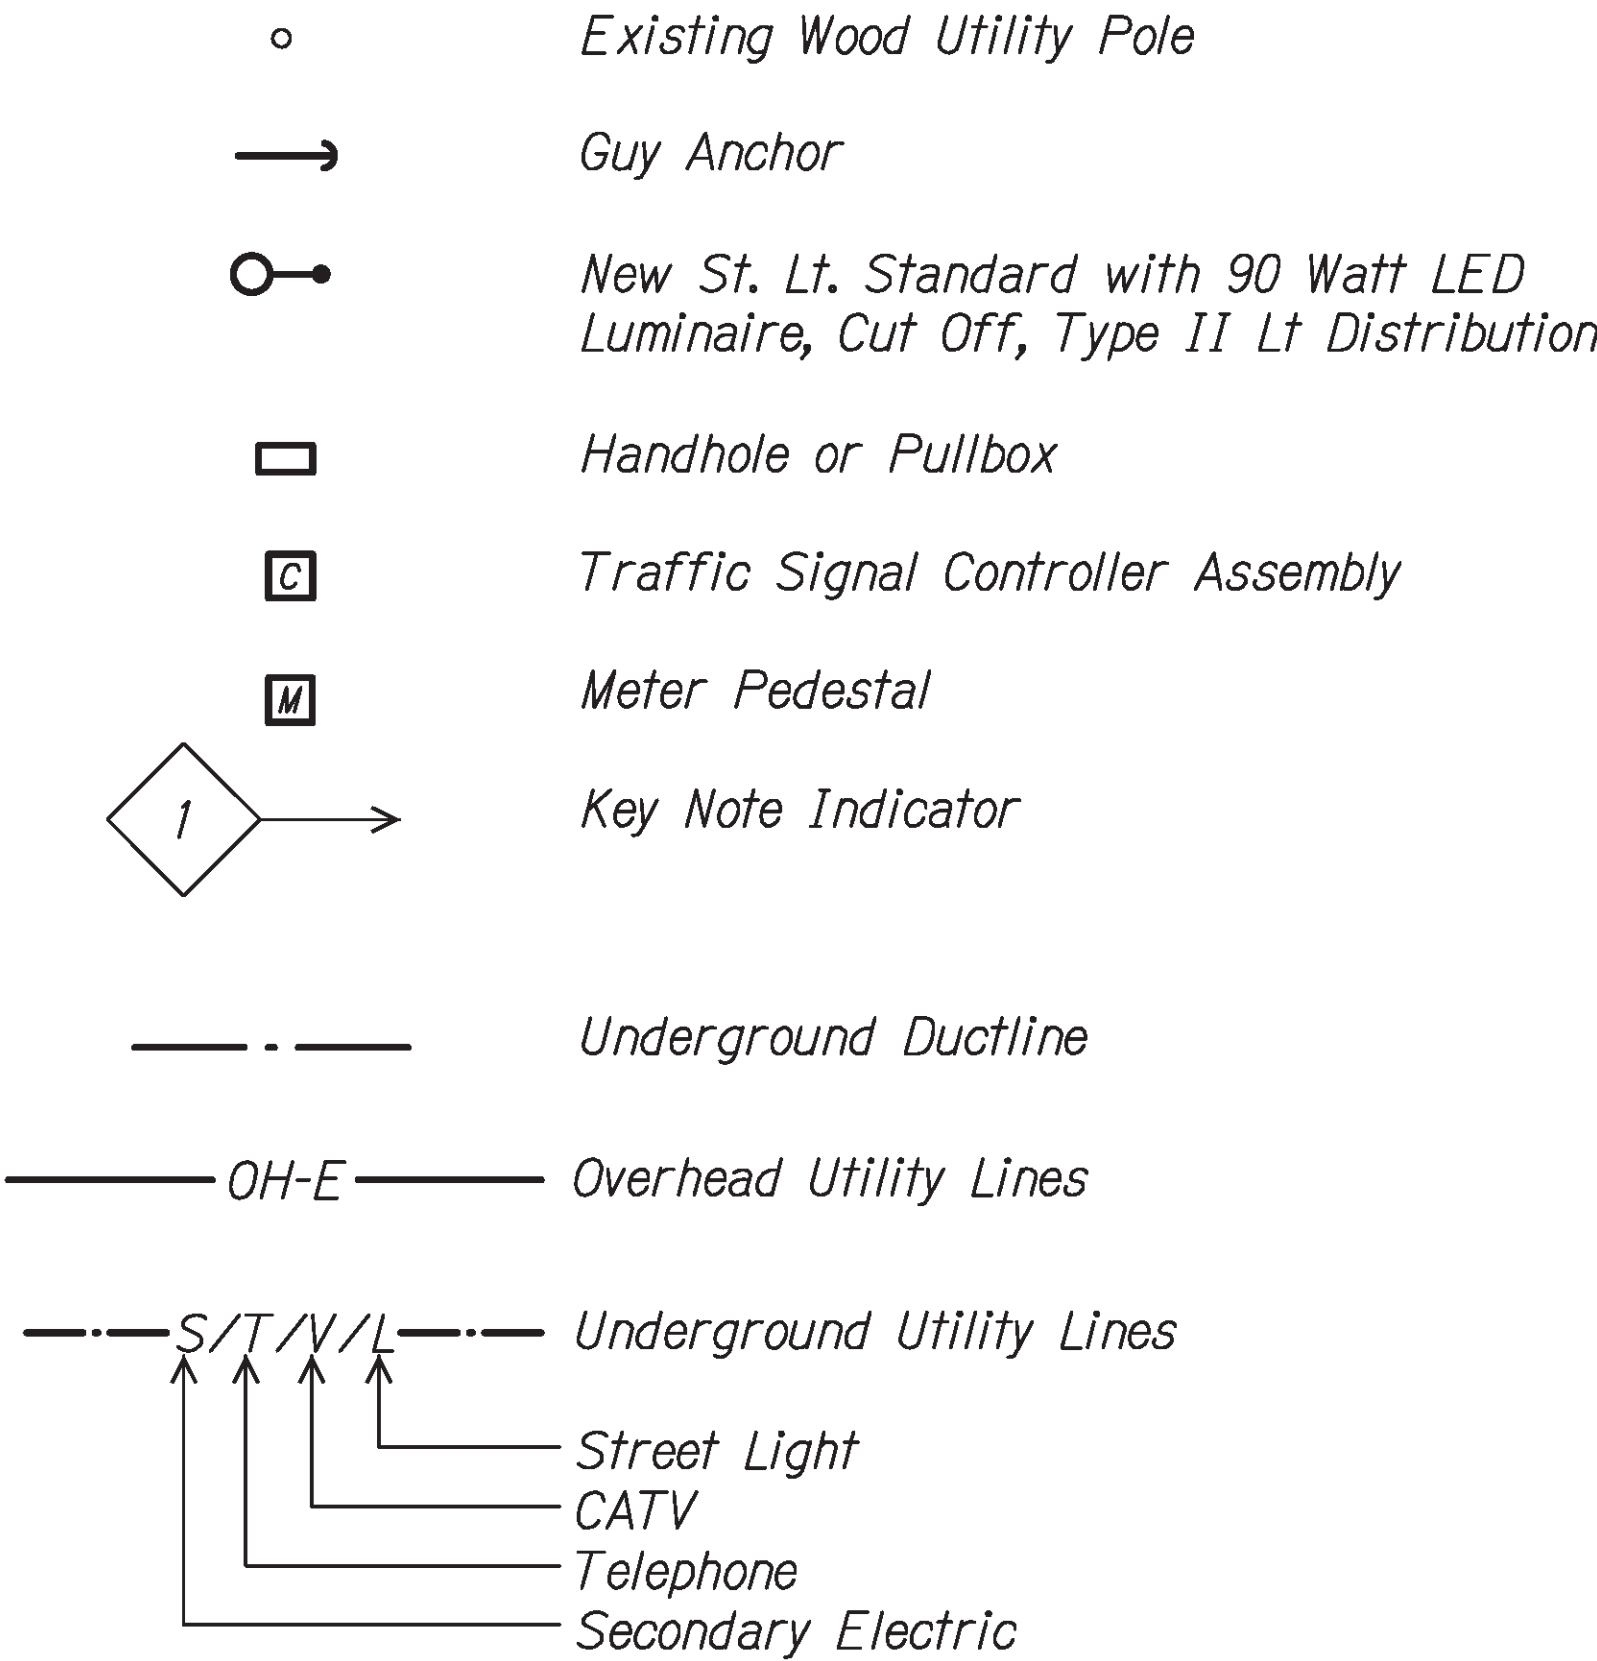

PULLBOX SCHEDULE

- 46 3' x 5' HTcom Pullbox LRED  
Per HTcom Spec GTS-8395
- 101 KIUC 2' x 4' Handhole Type  
30-2005
- 102 24" x 36" CATV Pullbox


DUCT DESIGNATION

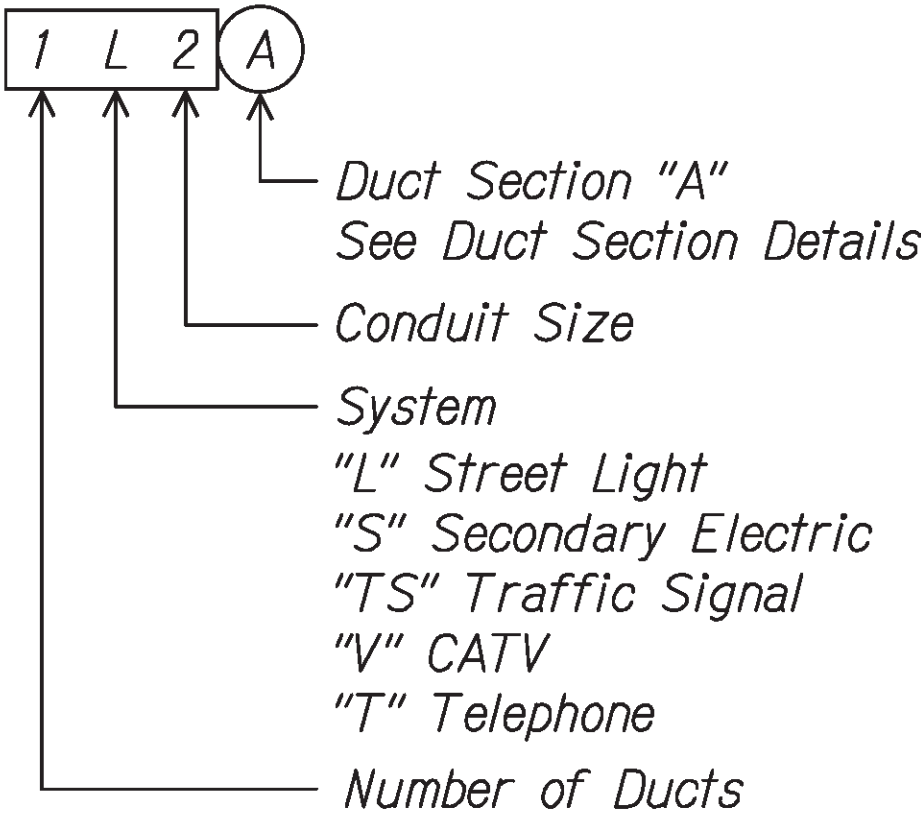

GENERAL UTILITY NOTES:

1. For General Electrical and Communication Notes, See Sheet E-2
2. For Electric and Communication Utility Notes, See Sheets E-2 to E-4.
3. Resolve All Discrepancies or Questions with the Engineer and Utilities Prior to Start of Any Utility Work.
4. Obtain All Required Standard Drawings and Installation Details From the Serving Utility Companies. The Contract Drawings Do Not in Any Way Duplicate The Standards of The Utility Companies.
5. Furnish and Install Schedule 40 PVC Ducts as Indicated on the Drawings with 3" Concrete Encasement as Indicated.
6. Furnish and Install All Pullboxes and Handholes as Noted on the Drawings. All Pullboxes and Handholes within the Road Right-of-Way Shall be Placed with Tops Flush with Final Grade, Pavement or Sidewalk as Applicable.
7. All Work Shall be Subject to Utility Company and State of Hawaii Inspection. Contractor Shall Provide a Minimum of 3 Working Days Inspection Notice Prior to Pouring of Concrete, or for Any Other Inspection Services.

ORIGINAL PLAN	SURVEY PLOTTED BY	DATE
NOTE BOOK	DRAWN BY	
No.	DESIGNED BY	
	QUANTITIES BY	
	CHECKED BY	

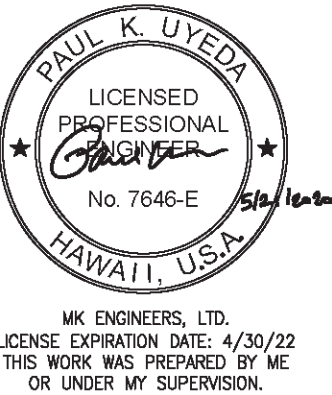

STATE OF HAWAII  
DEPARTMENT OF TRANSPORTATION  
HIGHWAYS DIVISION

**ELECTRICAL SYMBOL LIST**

**& NOTES**

*Kaunualii Highway Intersection  
Improvements at Waimea Canyon Drive  
and Menehune Road/Halepule Road*

*Project No. 50B-01-14*

Scale: As Shown Date: May 2020

SHEET No. E-1 OF 11 SHEETS