


NOTES:

- 1. Filter fabric shall be a minimum of 36 inches wide.
- 2. If silt fence is obtained from manufacturer as a package (i.e. fabric attached to post) the manufacturer's installation instruction shall be adhered to.
- Fence stakes may be wood or metal and must be capable of supporting anticipated loads.


SILT FENCE DETAIL Not to Scale

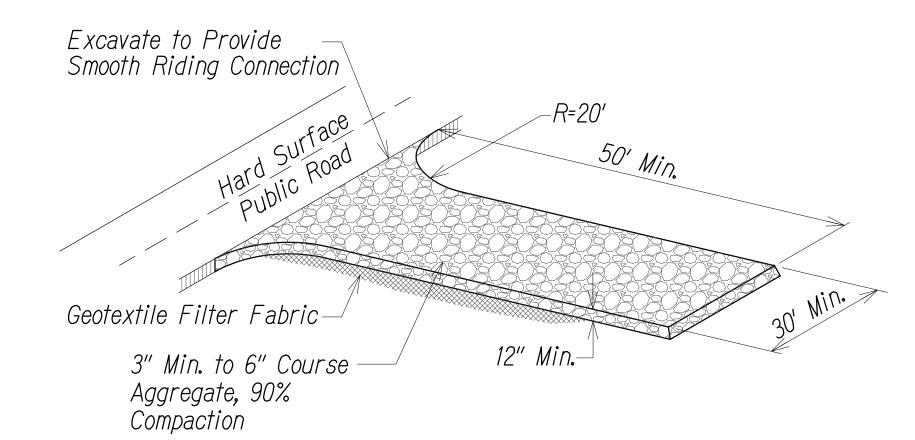

TEMPORARY STABILIZED CONSTRUCTION ENTRANCE/EXIT

Not to Scale

FED. AID PROJ. NO. FISCAL YEAR SHEET NO. DIST. NO. STATE BR-030-1(37) 2024 13

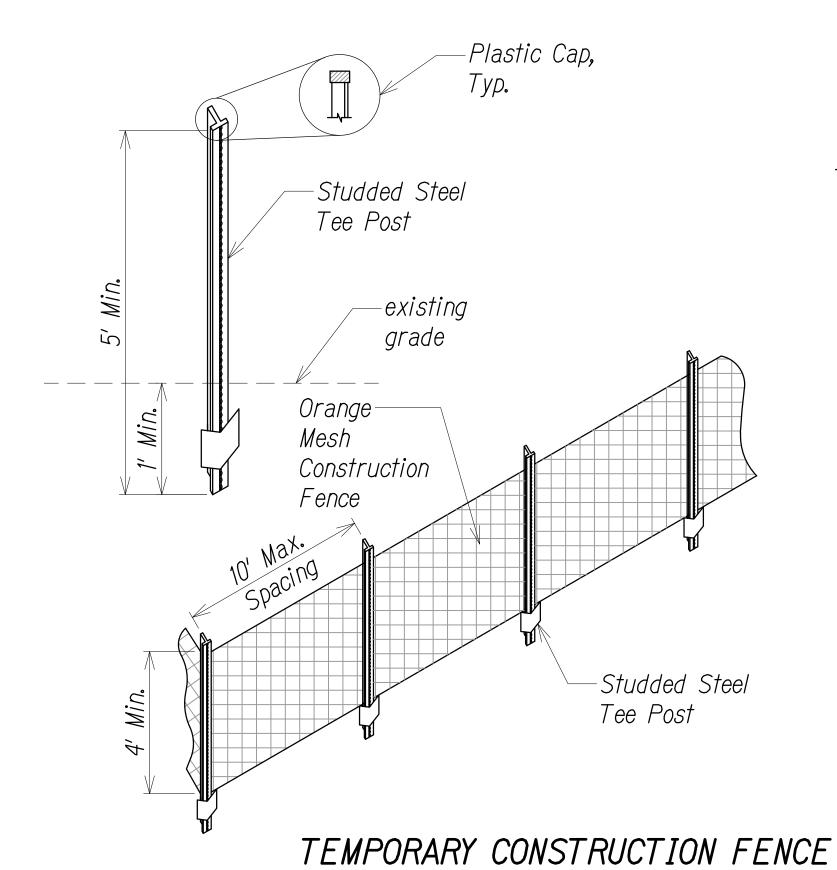

Not to Scale

CONSTRUCTION FENCE INSTALLATION NOTES:

- 1. See plan view for location of construction fence.
- 2. Construction fence shown shall be installed prior to any land disturbing activities.
- 3. Construction fence shall be composed of orange, Contractor-grade plastic material that is at least 4' high. Metal post should have a plastic cap for safety.
- Studded steel tee post shall be utilized to support the construction fence. Maximum spacing for steel tee post shall be 10'.
- 5. Construction fence shall be securely fastened to the top, middle, and bottom of each post.

PROFESSIONAL **ENGINEER**

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION.

STATE OF HAWAI'I DEPARTMENT OF TRANSPORTATION


EROSION CONTROL DETAILS

<u>Honoapi'ilani Highway</u> Rehabilitation of Honolua Bridge F.A.P No. BR-030-1(37)</u>

Scale: As Shown

Date: August 2024

SHEET No. *C1.12* OF *42* SHEETS

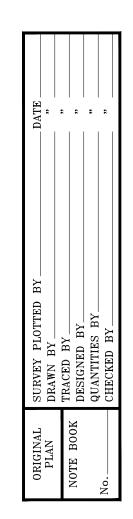

13