
FED. ROAD DIST. NO.	STATE	PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	HWY-0-09-06	2008	13	46

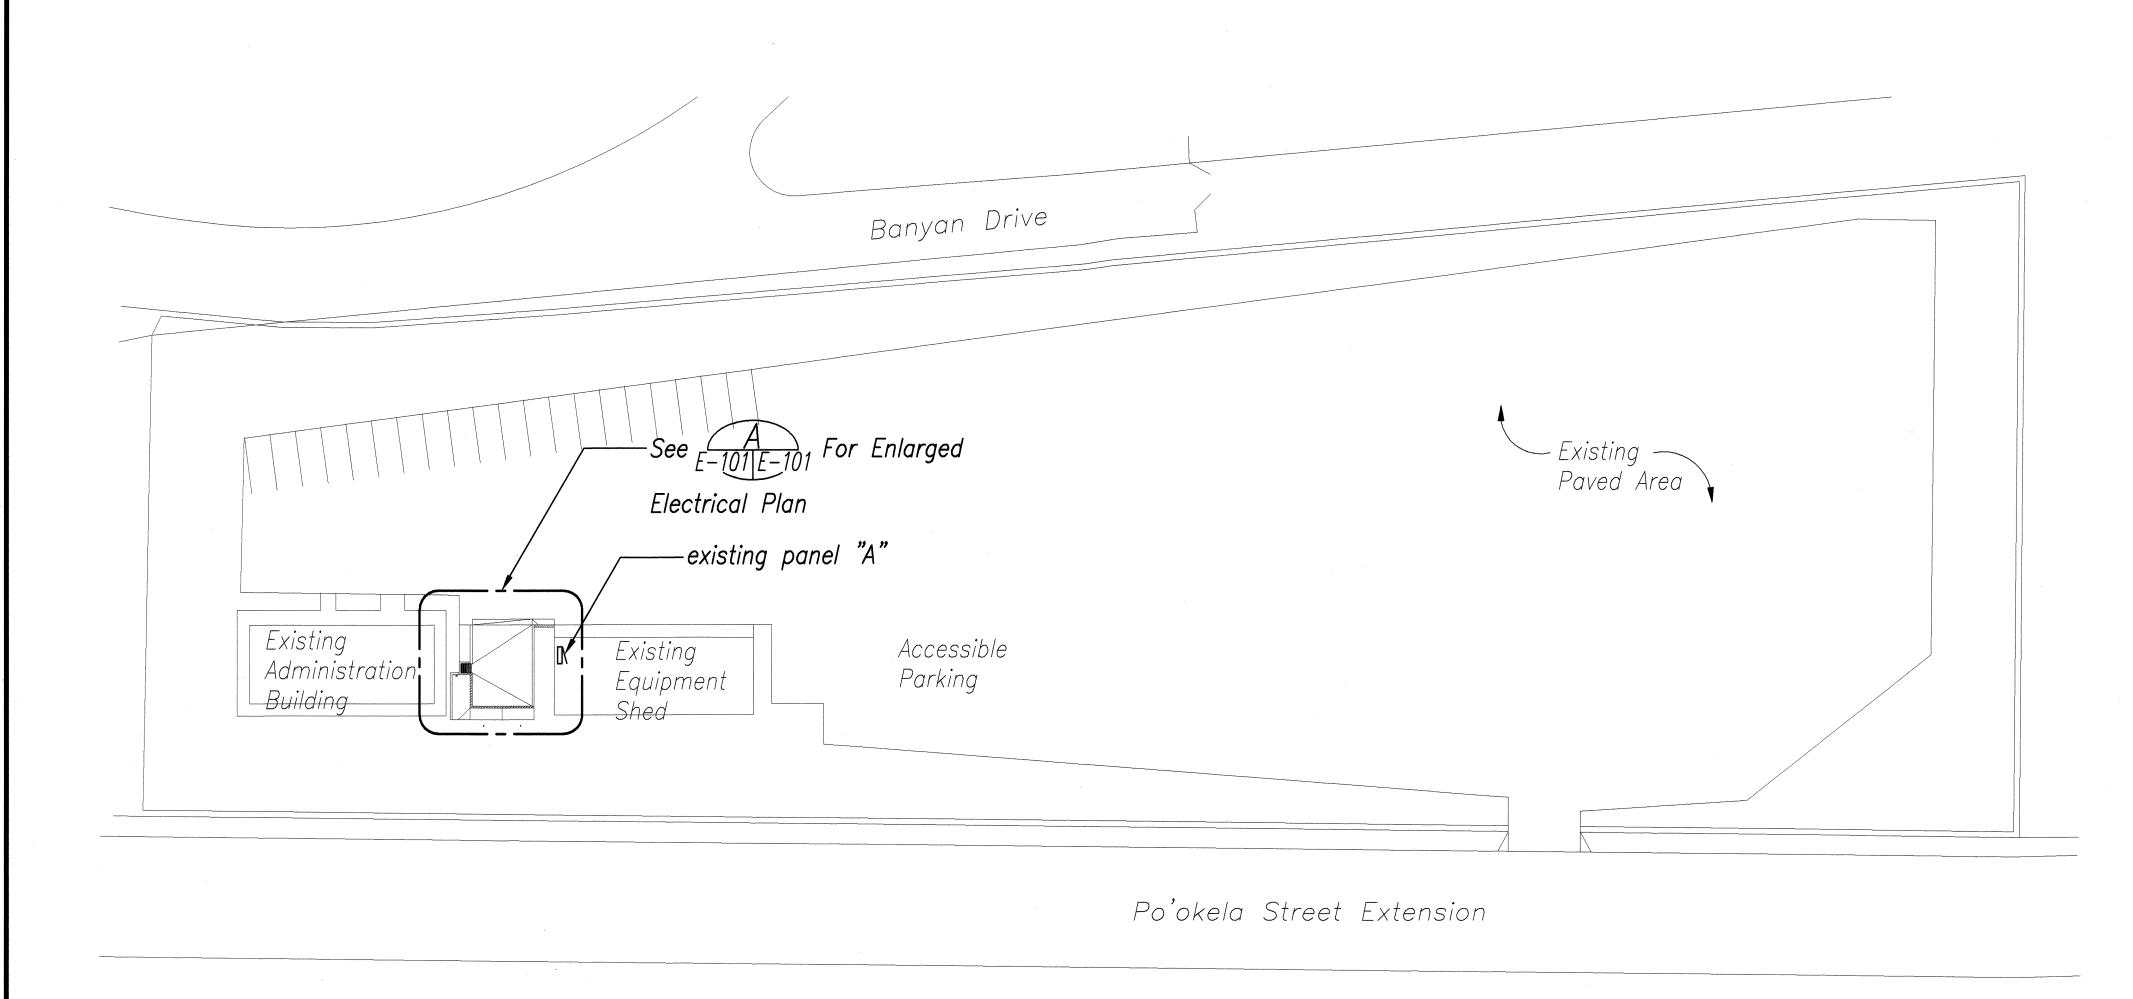

## ELECTRICAL SYMBOLS

- Duplex Convenience Outlet, 3W2OA, Ground Fault Interrupter Type, +16" Unless Otherwise Noted
- ₩all Junction box, 4-11/16" Square Minimum
- □ Large Junction Box
- existing panelboard
- © Equipment Connection
- →
   Safety Switch
- **WP** Weatherproof
- —— — Wiring In Raceway Concealed In Floor Or Below Grade
- ---- Wiring In Exposed Raceway

- <u>Notes:</u> 1. Any Circuit With No Further Designation Indicates A Two Wire Circuit. Circuits With Additional Wires Are Indicates As Follows: -/-, 3 Wires: -//-, 4 Wires, Etc.
  - 2. Ground Wire Per National Electrical Code Indicated As Follows: —
  - 3. All Exposed Conduit And Boxes Shall Be Painted To Match Adjacent Wall Or Ceiling Surrounding

ELECTRICAL SITE PLAN (KANEOHE BASEYARD)

E-100 E-100 SCALE : 1/32" = 1'-0"



STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION

ELECTRICAL SITE PLAN (KANEOHE BASEYARD)


KANEOHE, PEARL CITY AND WAIANAE
BASEYARD WASHDOWN RACKS Project No. HWY-0-09-06

Scale: 1/32" = 1'-0"

SHEET No. E-100 OF 46 SHEETS


Date: MAY 2008

FED. ROAD DIST. NO.	STATE	PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	HWY-0-09-06	2008	14	46

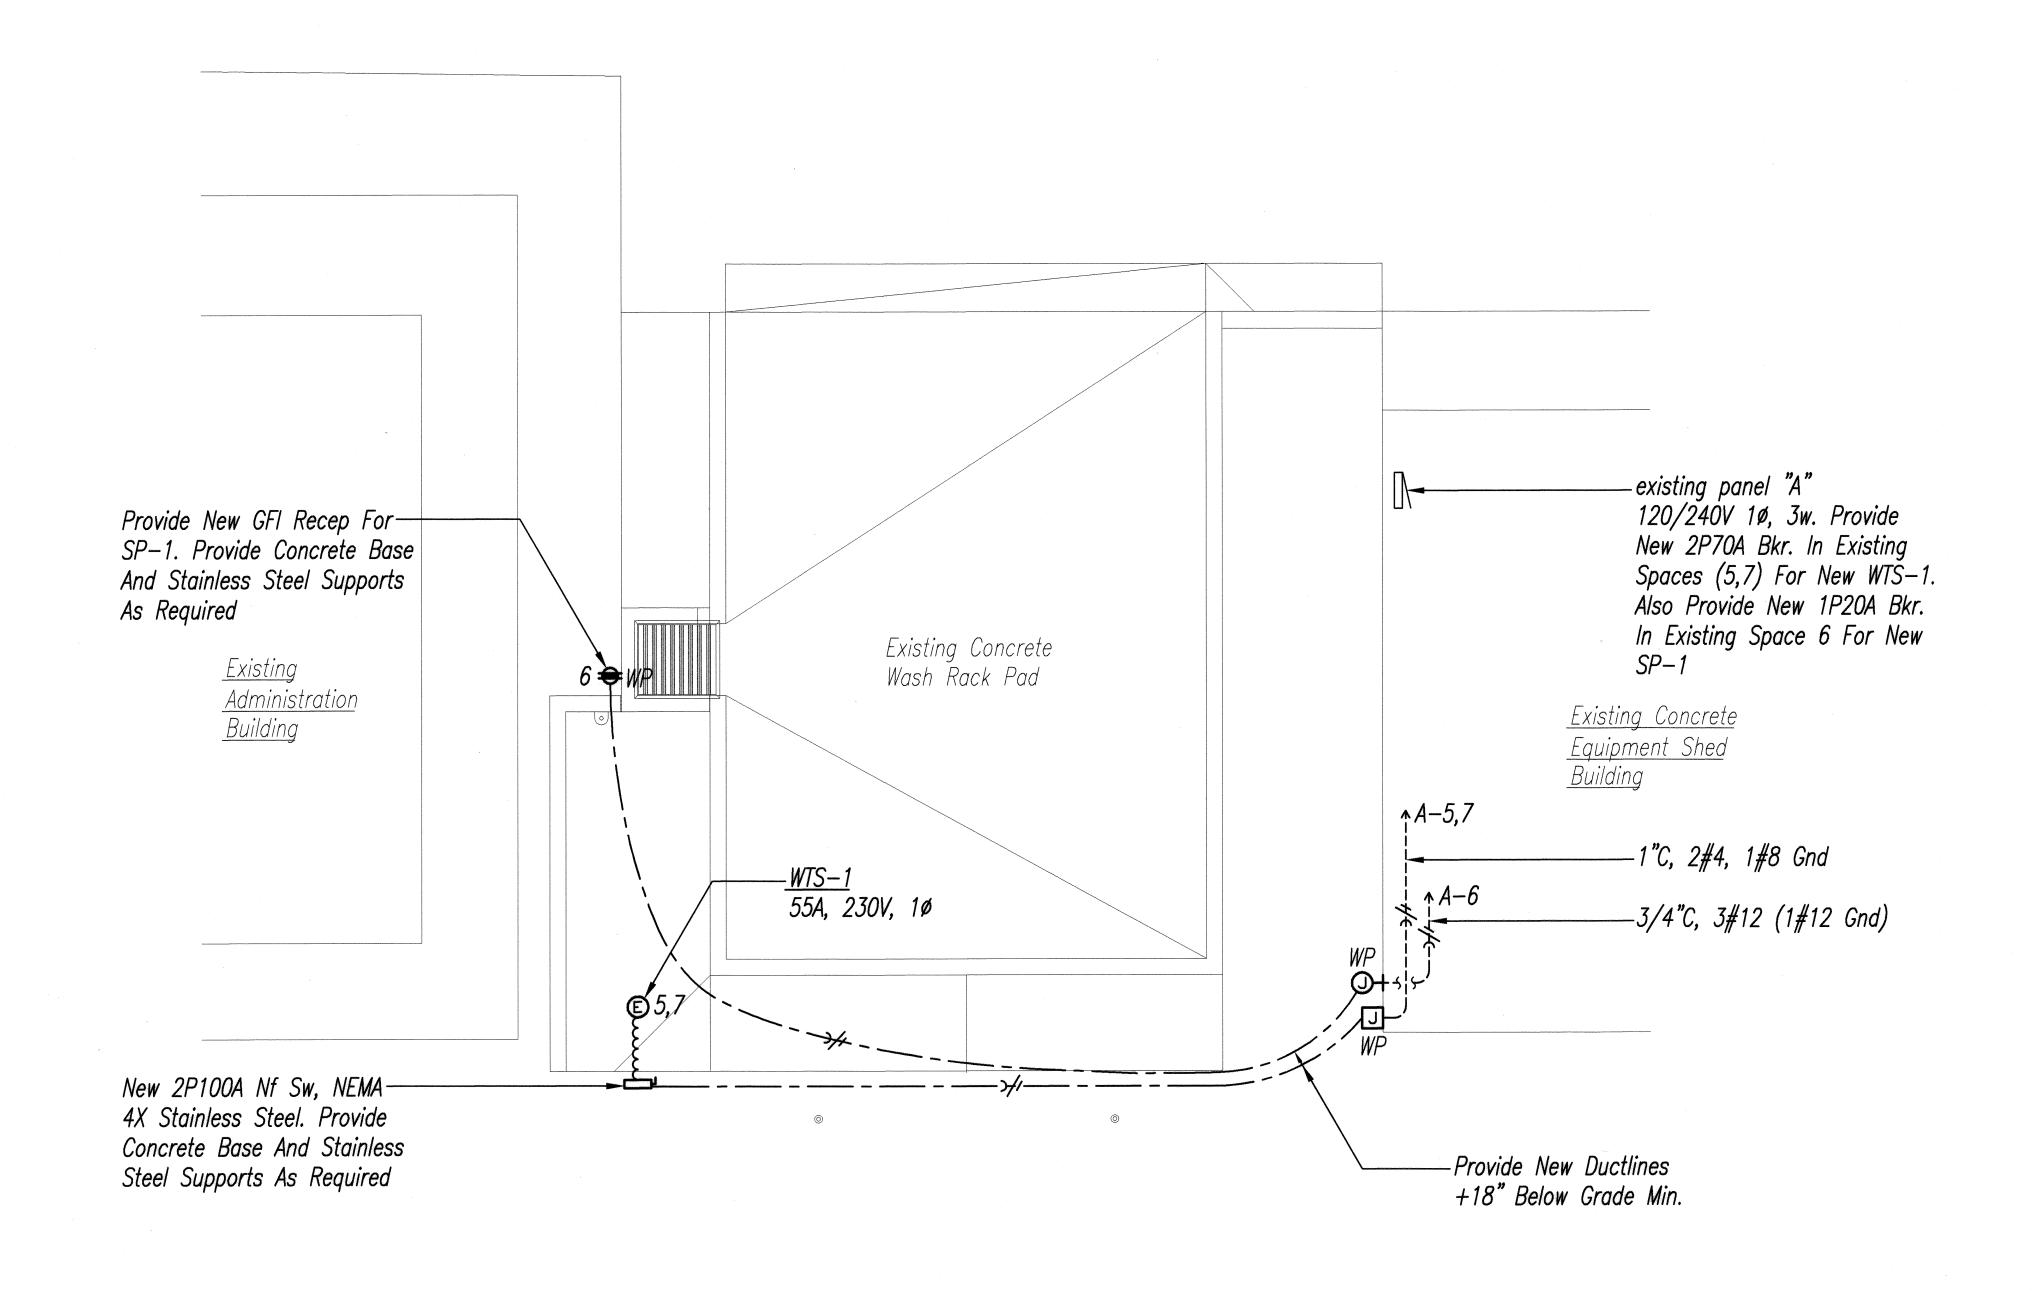

ENLARGED ELECTRICAL PLAN (KANEOHE BASEYARD)

E-101|E-101| SCALE : 1/4" = 1'- 0"



STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

ENLARGED ELECTRICAL PLAN (KANEOHE BASEYARD)

KANEOHE, PEARL CITY AND WAIANAE

BASEYARD WASHDOWN RACKS

Project No. HWY-0-09-06

Scale: 1/4" = 1'-0" Date: MAY 2008

SHEET No. E-101 OF 46 SHEETS

14