




4/25/23-16:50 Y:\044\044.088 Pier 53 Repair Elec Panels\044.088 E-3.001.dwg

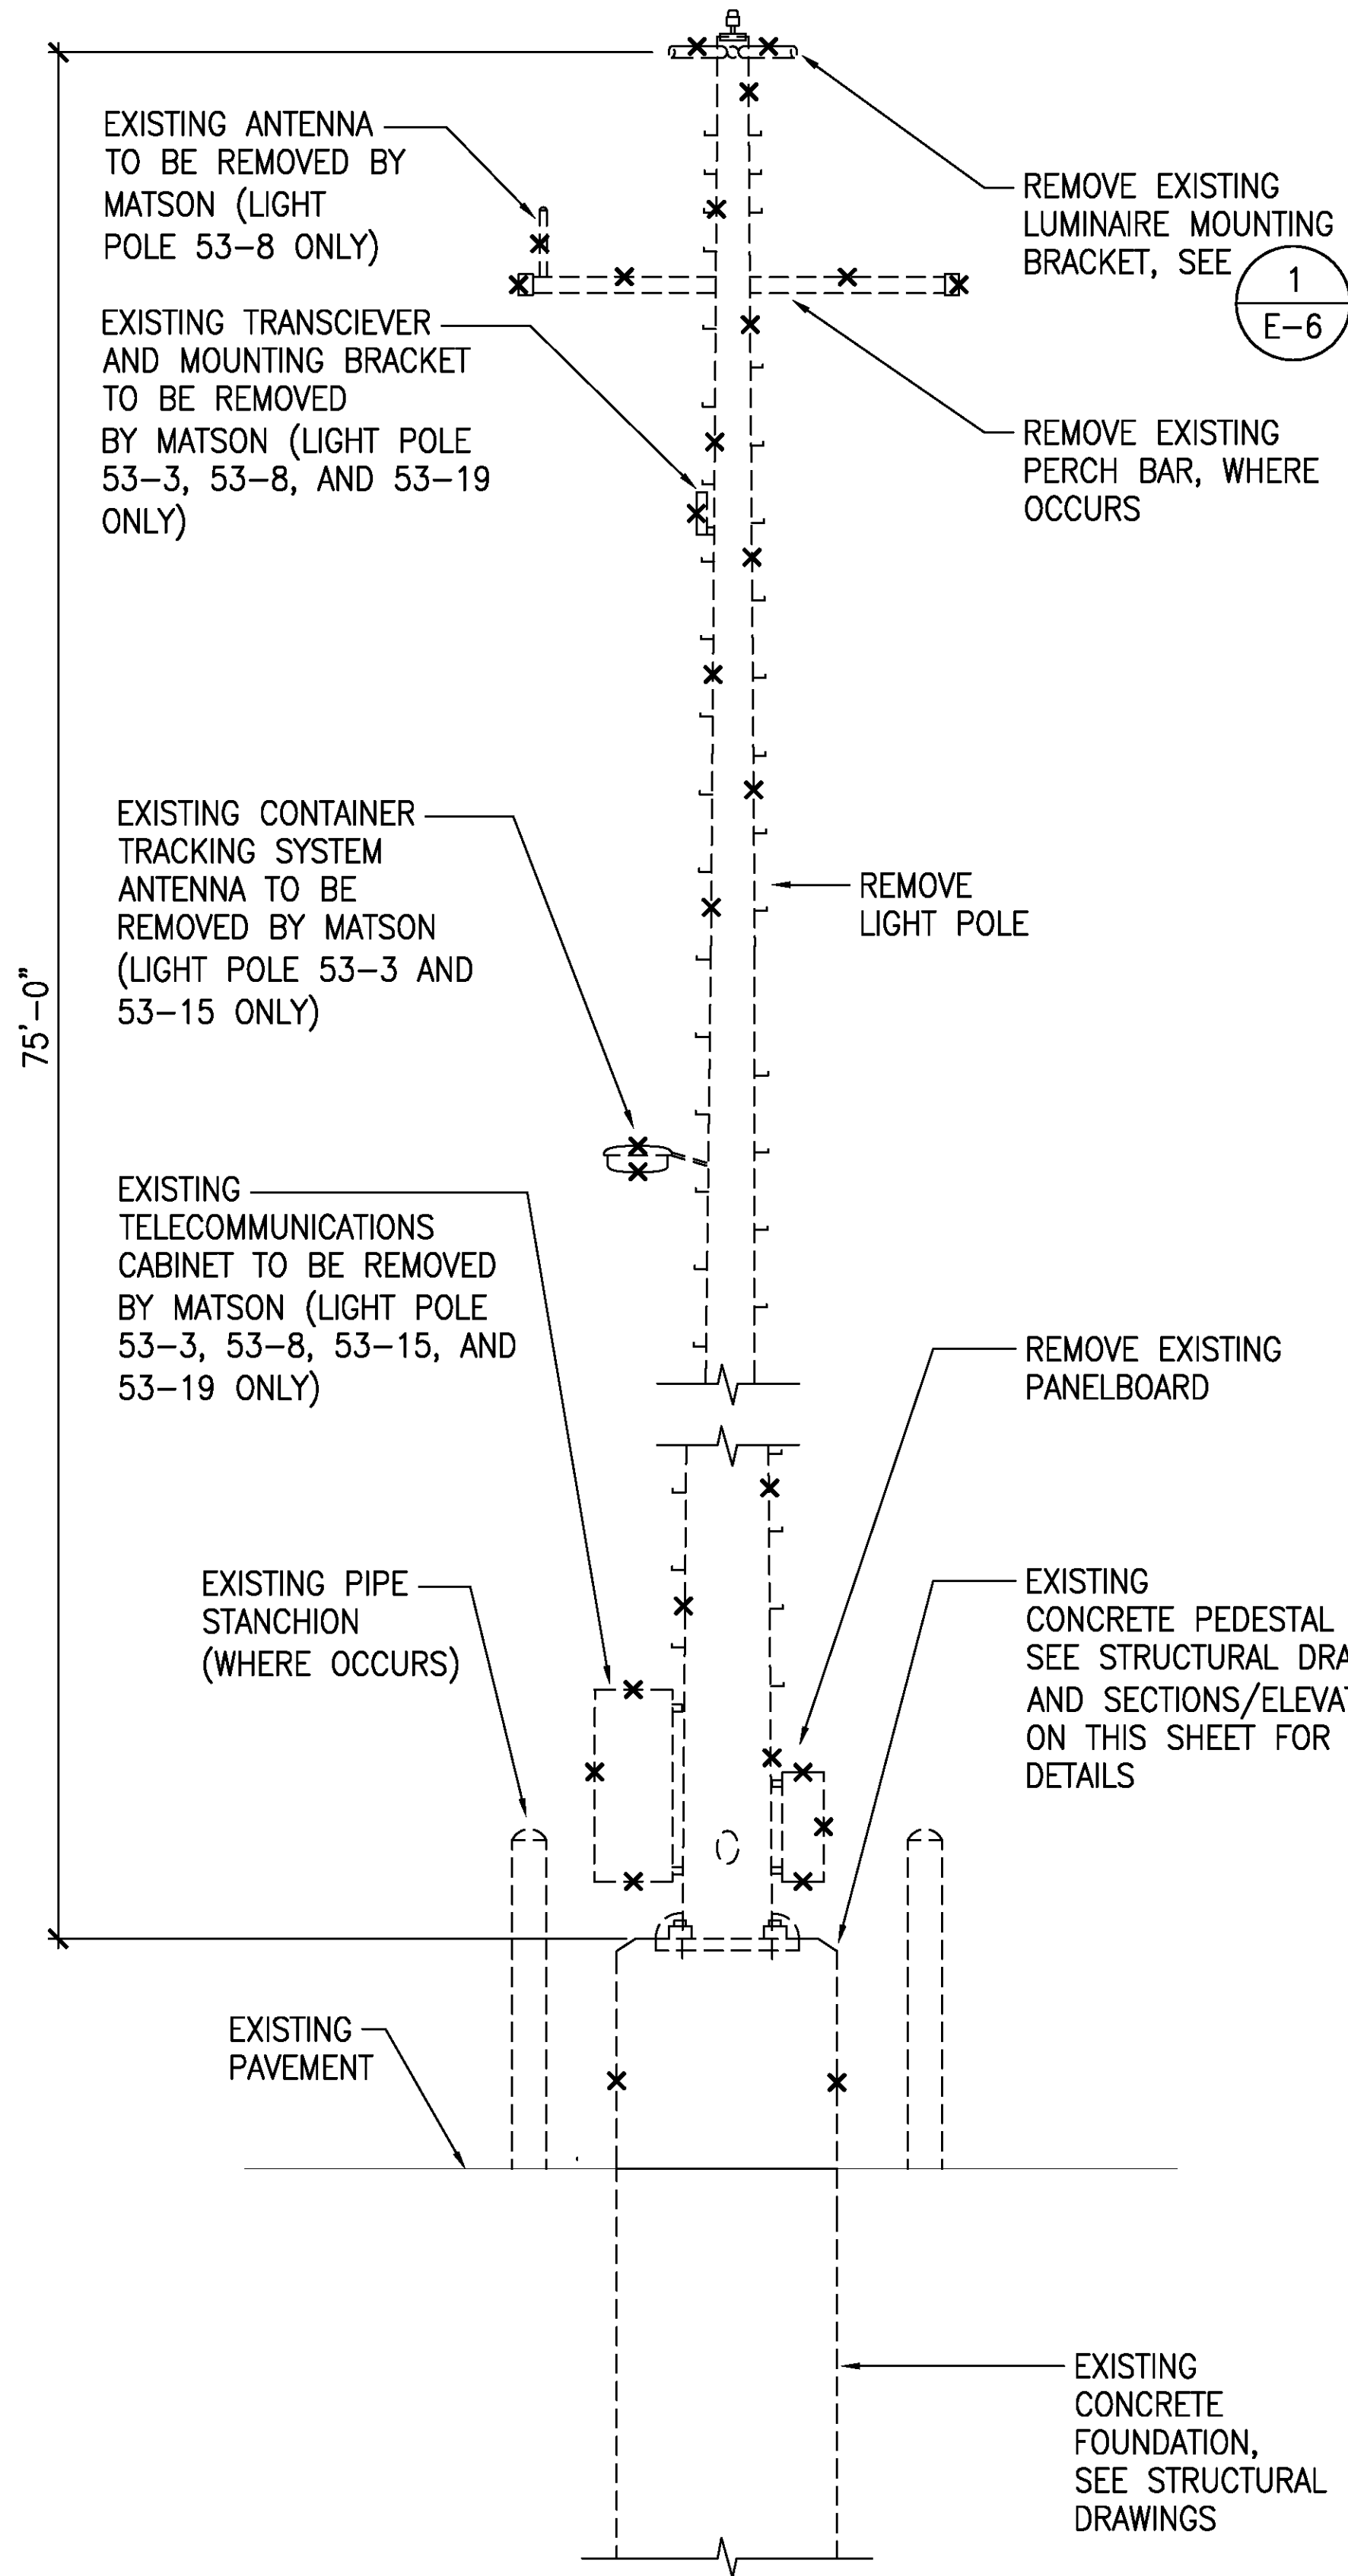

1
E-3
AREA LIGHT POLE DEMOLITION DETAIL
NOT TO SCALE

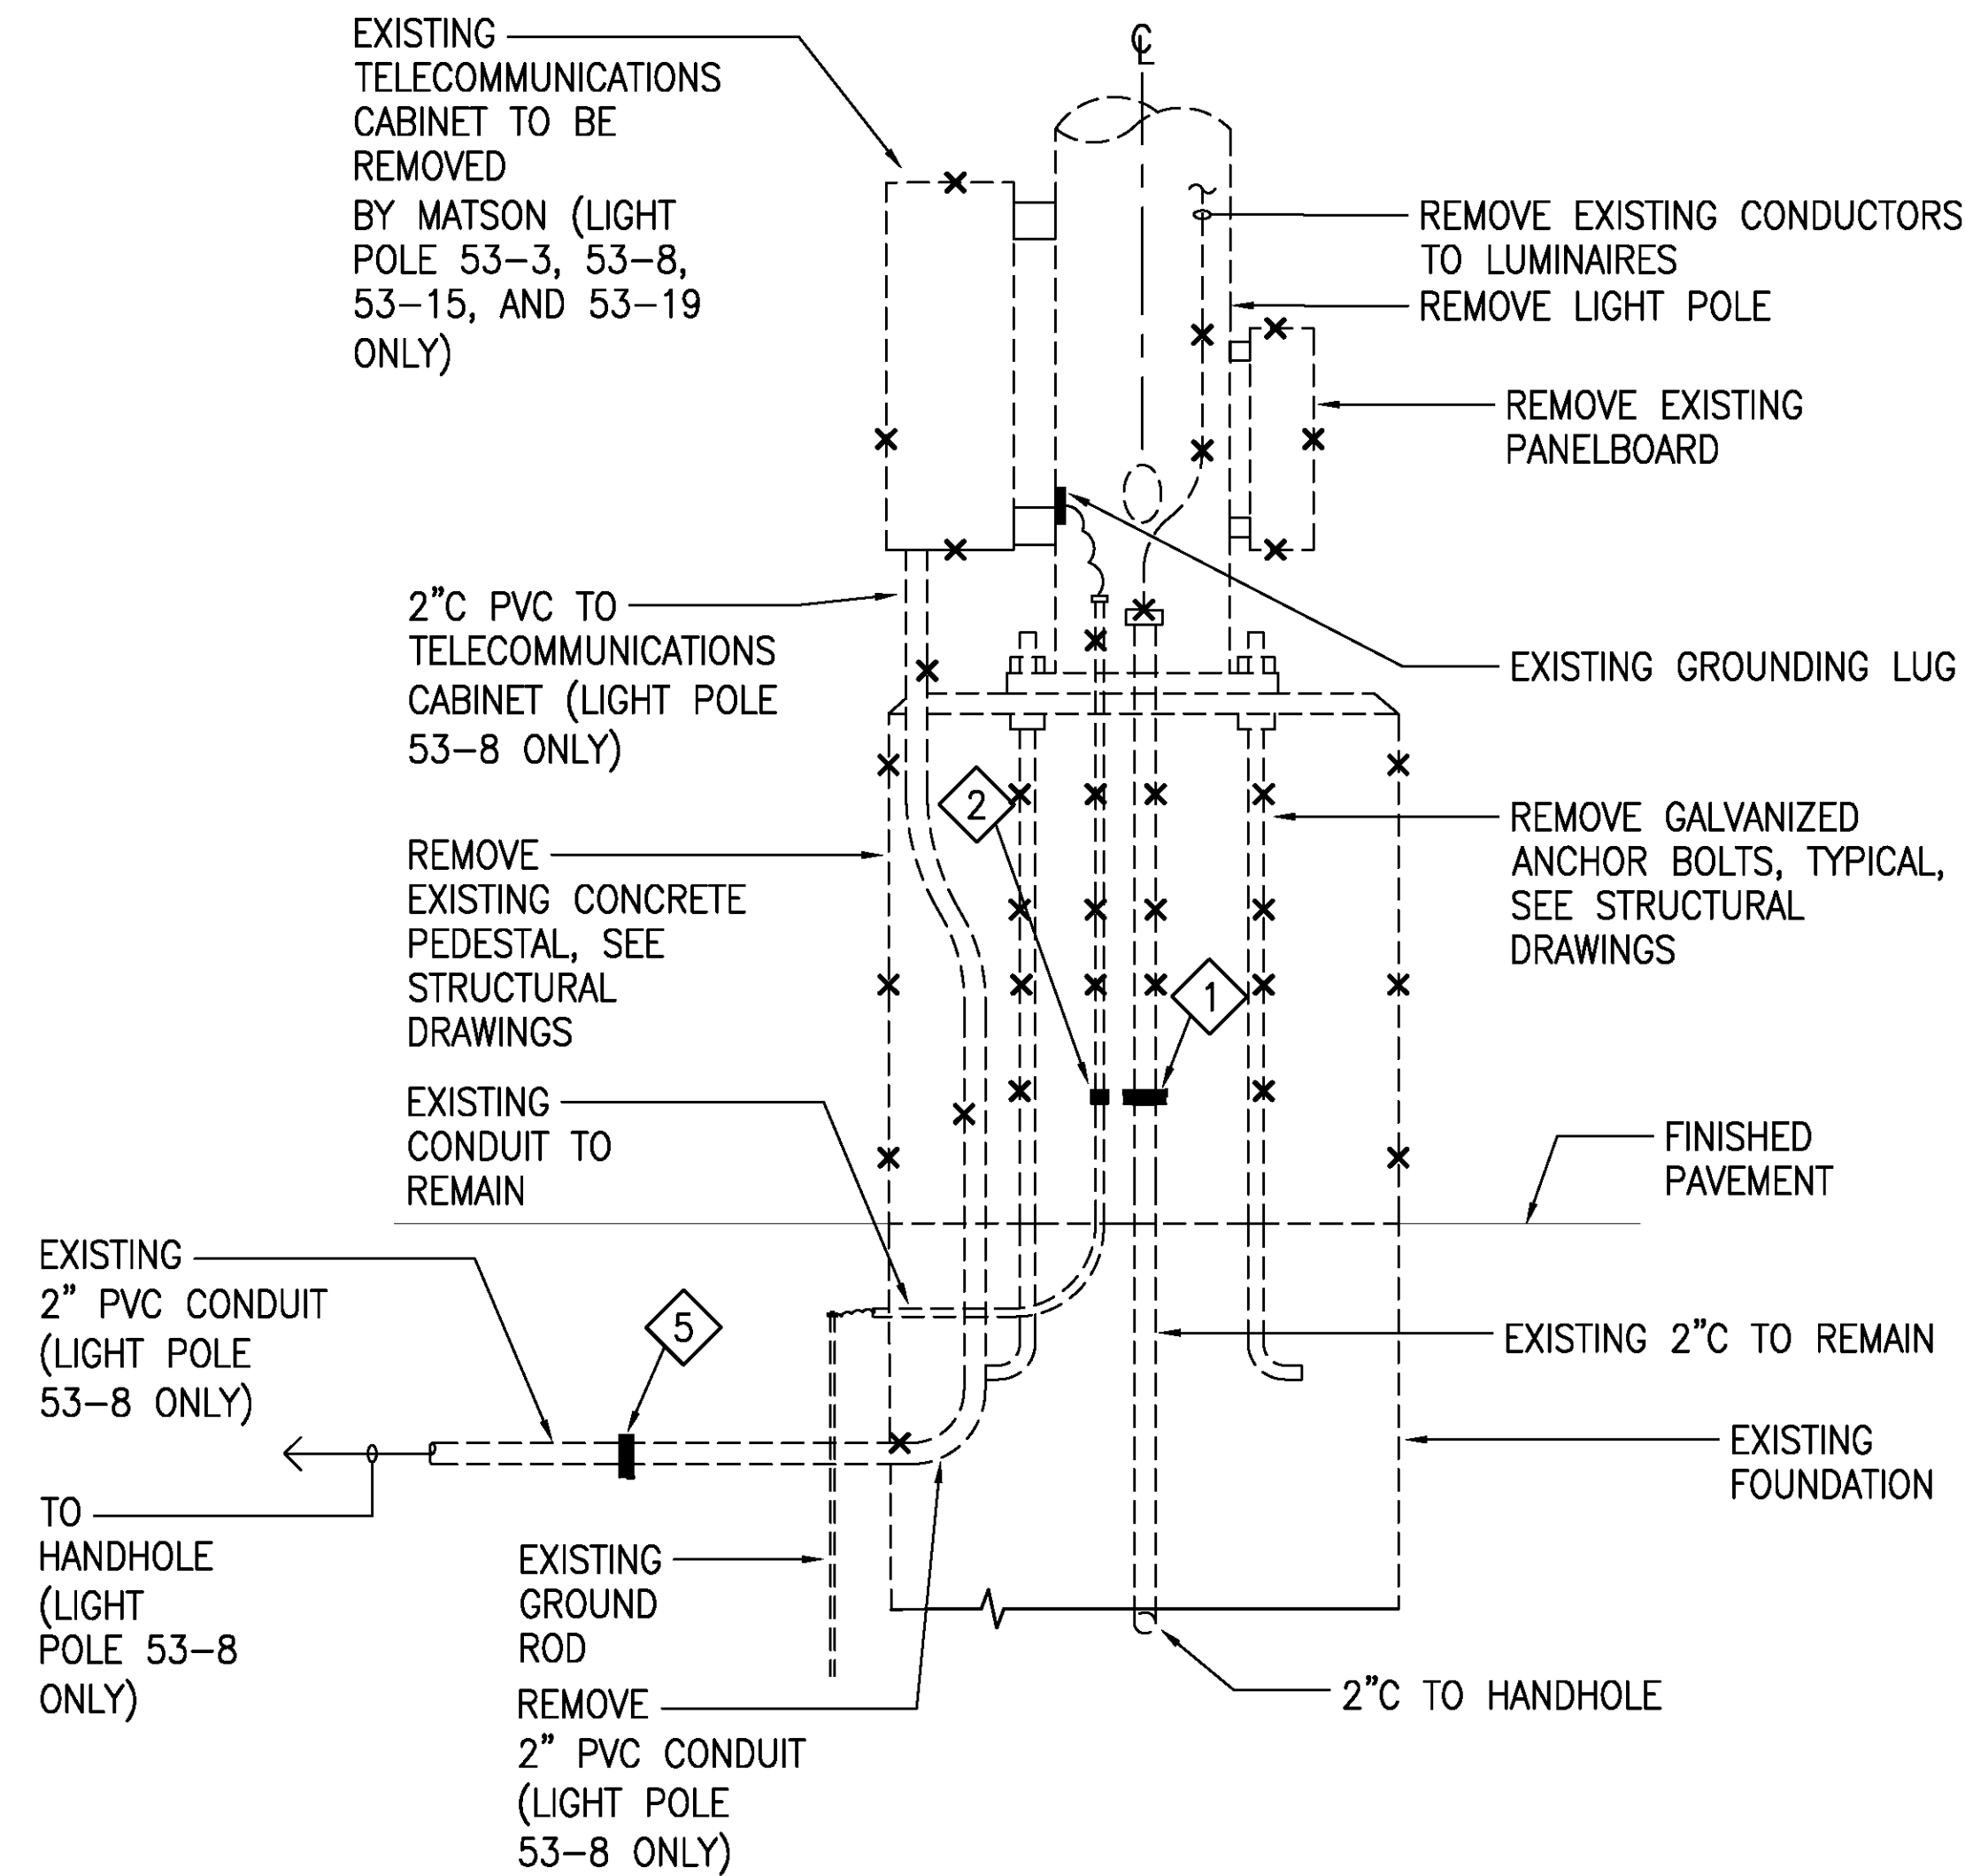


2
E-3
TYPICAL CONCRETE PEDESTAL SECTION -
DEMOLITION DETAIL
NOT TO SCALE

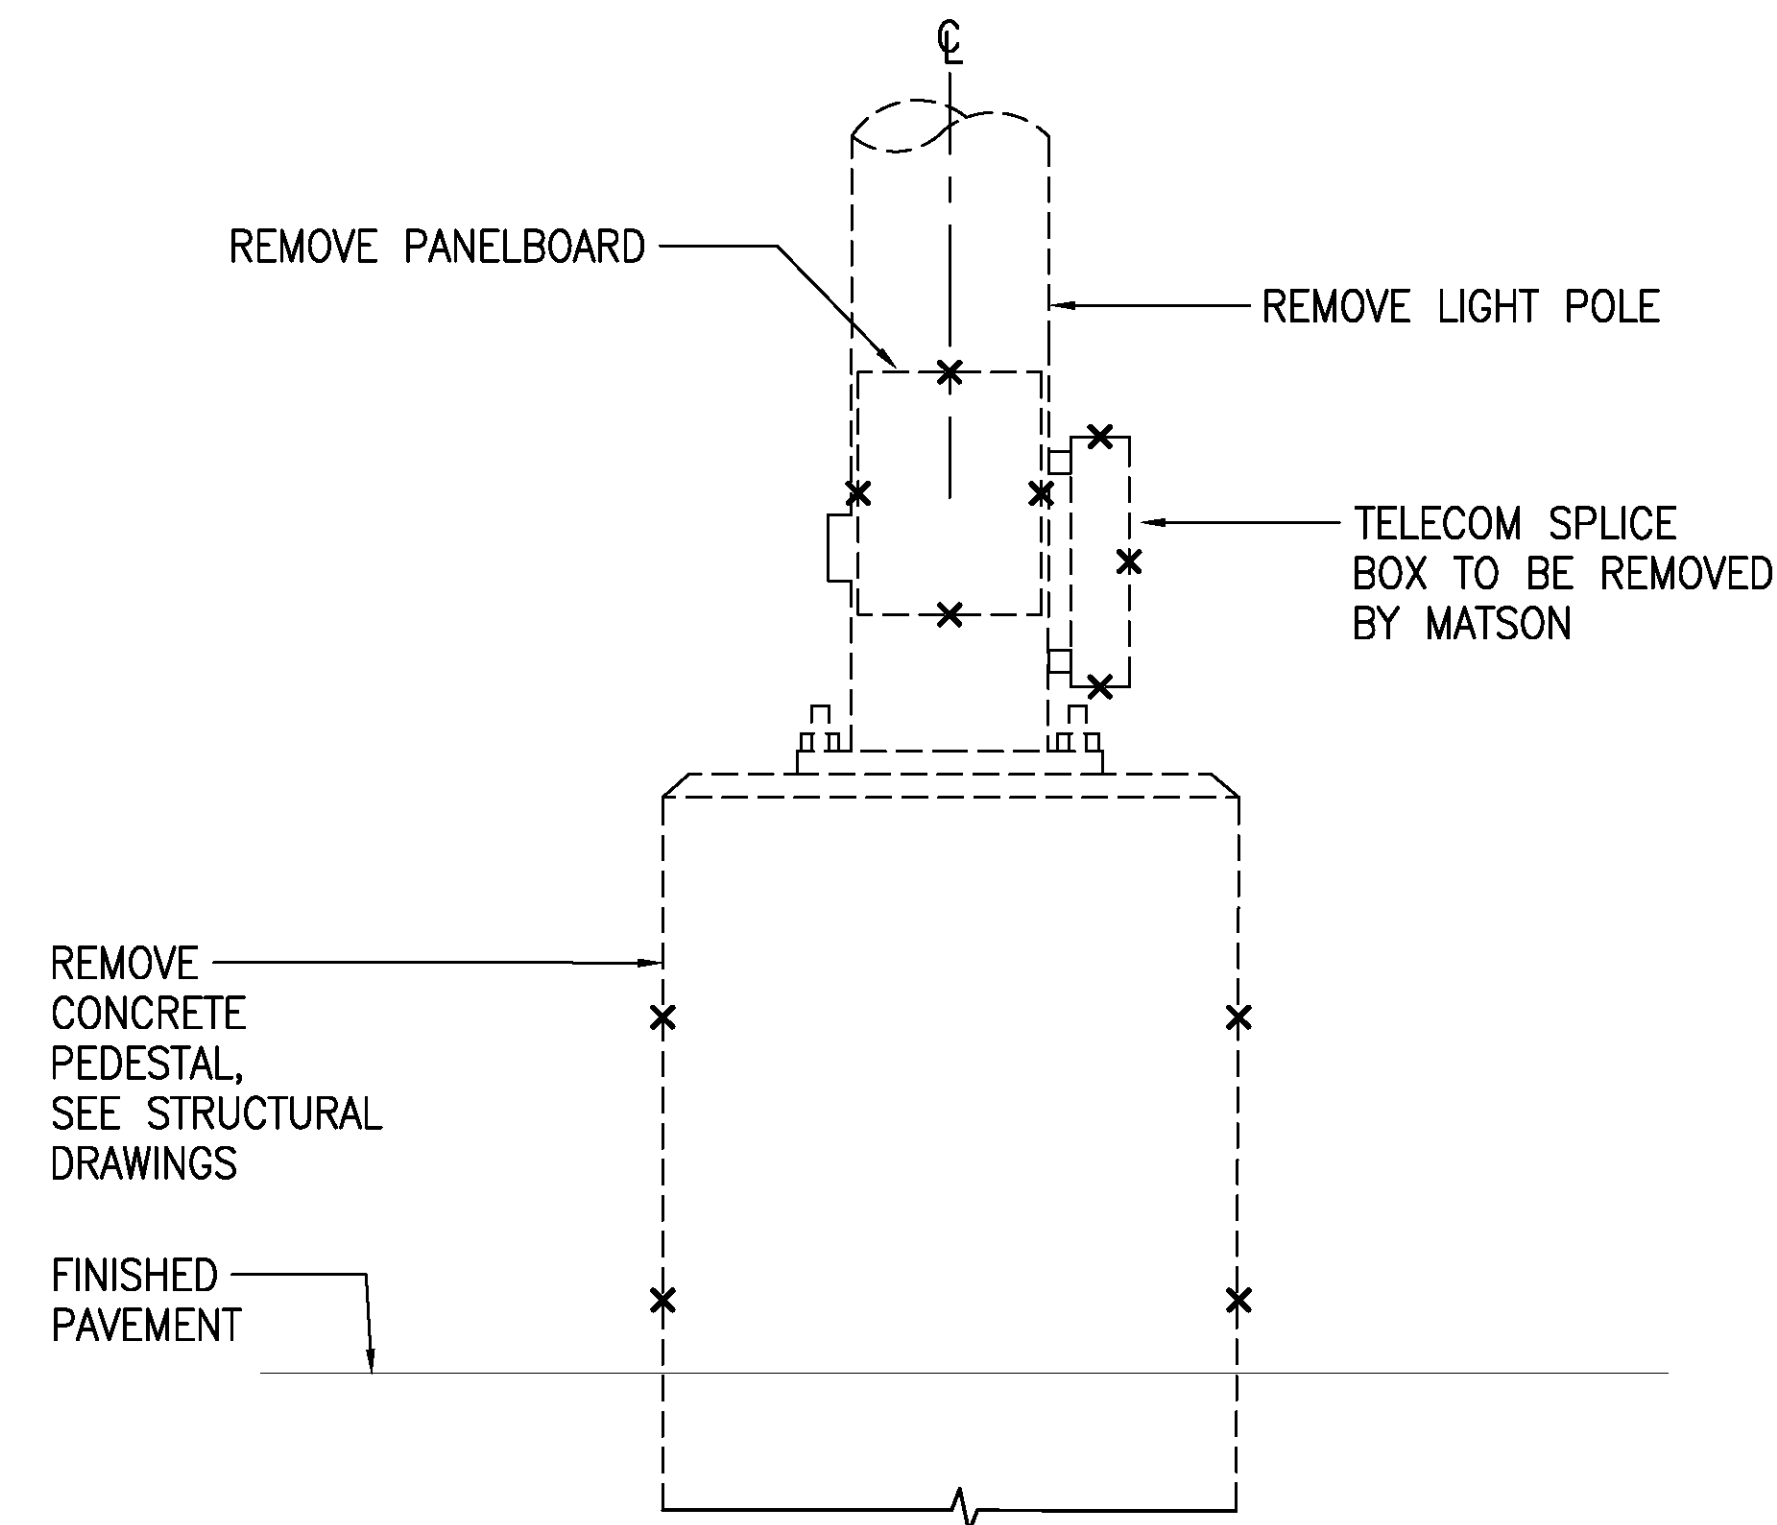


4
E-3
LIGHT POLE 53-14 PEDESTAL ELEVATION -
DEMOLITION DETAIL
NOT TO SCALE

NOTES:

1. PROTECT EXISTING CONDUIT STUBUP, CUT EXISTING CONDUIT +12" ABOVE FINISHED PAVEMENT.
2. PROTECT EXISTING CONDUIT STUBUP AND EQUIPMENT GROUNDING CONDUCTOR DURING DEMOLITION. CUT EXISTING CONDUIT +12" ABOVE FINISHED PAVEMENT AND COIL GROUNDING CONDUCTOR FOR REUSE.
3. QUANTITY OF STUBUPS PER POLE IS BASED OFF BEST AVAILABLE RECORD DRAWINGS. CONTRACTOR SHALL VERIFY QUANTITY OF STUBUPS FOR EACH POLE AND THEIR RESPECTIVE PURPOSE BEFORE CUTTING EACH STUBUP.
4. PROTECT EXISTING CONDUIT STUBUP AND CONDUCTORS DURING DEMOLITION, CUT EXISTING CONDUIT +12" ABOVE FINISHED PAVEMENT AND COIL CONDUCTORS.
5. REMOVE EXISTING 2" PVC CONDUIT UNDER FINISHED PAVEMENT AS REQUIRED TO ADJUST CONDUIT STUBUP LOCATION. SAWCUT FINISHED PAVEMENT AS REQUIRED AND PROTECT EXISTING CABLING IN EXISTING CONDUIT. FOR ADDITIONAL INFORMATION, SEE 3 E-4

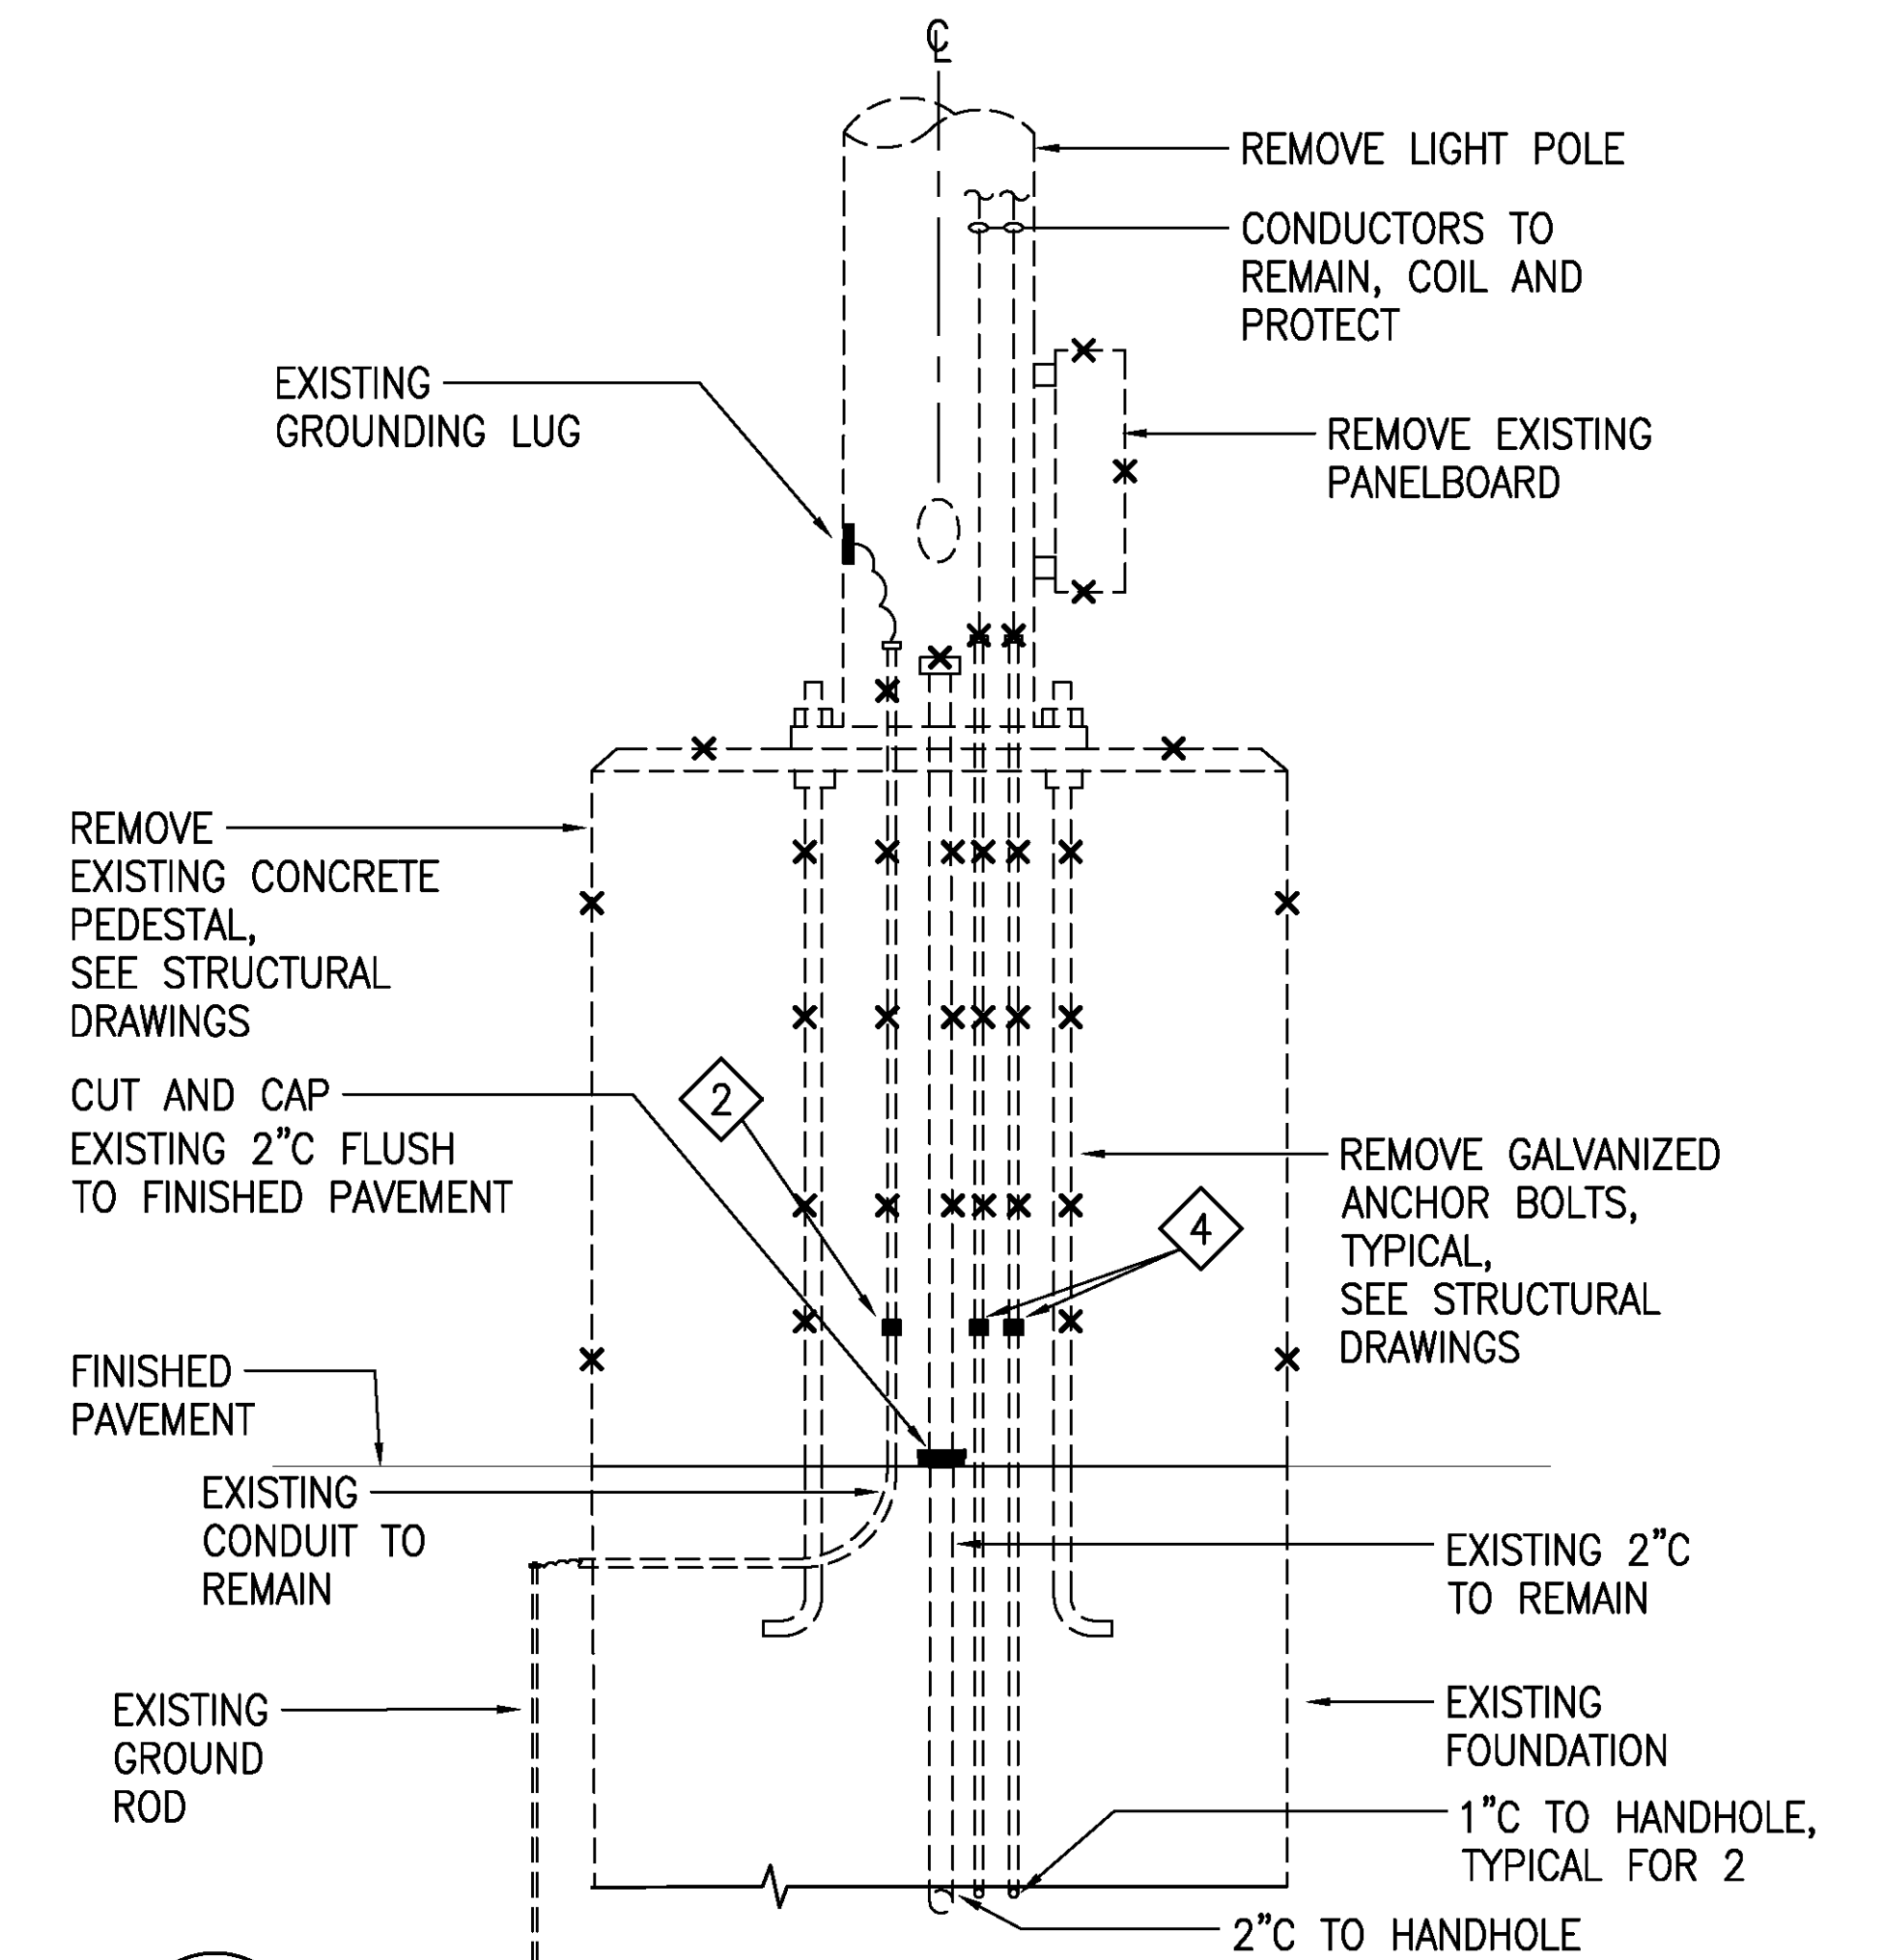

3
E-3
LIGHT POLE 53-7 CONCRETE PEDESTAL
SECTION- DEMOLITION DETAIL
NOT TO SCALE

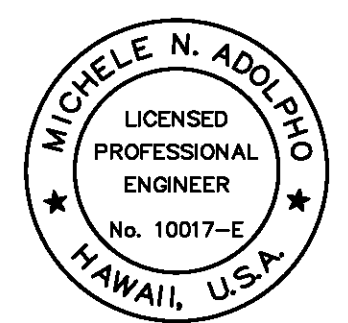 THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION EXP. 4-30-24 Michele N. Adolp ECS, INC.	REVISION	DATE	DESCRIPTION	BY	APPROVED
	STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HARBORS DIVISION				
	JOB TITLE REPAIR LIGHT POLES AND PEDESTALS AT PIER 53 HONOLULU HARBOR, OAHU, HAWAII				
	SHEET TITLE EXISTING LIGHT POLE DETAIL - DEMOLITION PLAN				
	DESIGNED BY: JC DRAWN BY: CAD CHECKED BY: M.A. DATE: 04/2023 SCALE: AS SHOWN				
JOB NUMBER S10859					SHEET E-3 8 of 18 SHTS.