

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

COMPLAINT/REQUEST

Tracking Number:

Time:

Date:

Name:

Company Name

Address:

City:

Zip Code:

Phone

Home:

Business:

Complaints:

Area:

Route:

Loc.:

Remarks:

Route Name:

Call Rec. By:

Ref. To:


Act. taken:

Comp. date:

Sign:

Ref. W/O:


Tort:

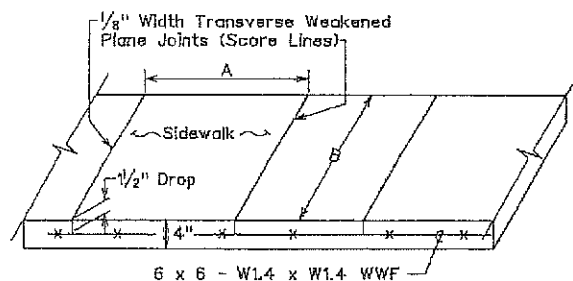


Notes:

1. Joint Dimensions or (B/A or A/B) < 1.25 and (A or B) not to exceed 7'-0"
2. Longitudinal Joints shall be similar to Transverse Joints.
3. Special Design to be used where A or B > 7'-0"


SIDEWALK CONTRACTION JOINT DETAIL

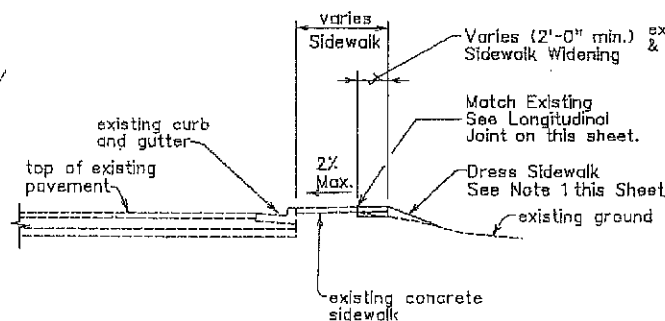

SIDEWALK WIDENING SECTION

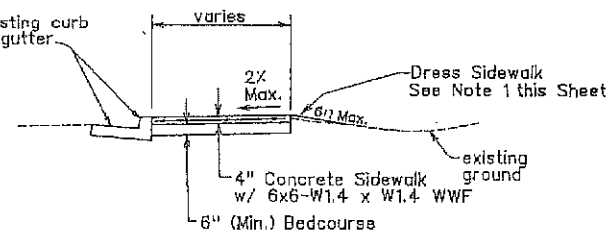


SIDEWALK DETAIL

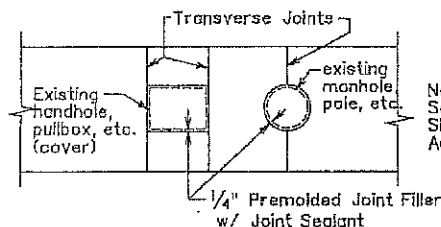


SIDEWALK ISOLATION JOINT DETAIL


1/2" x 12" Long Smooth Dowel @ 12" o.c.
Note: See Std. Plan Sheet D-23 for Additional details.

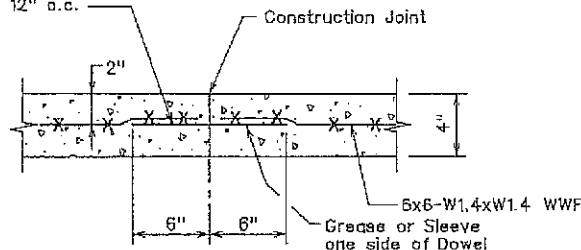


TRANSVERSE CONSTRUCTION JOINT DETAIL

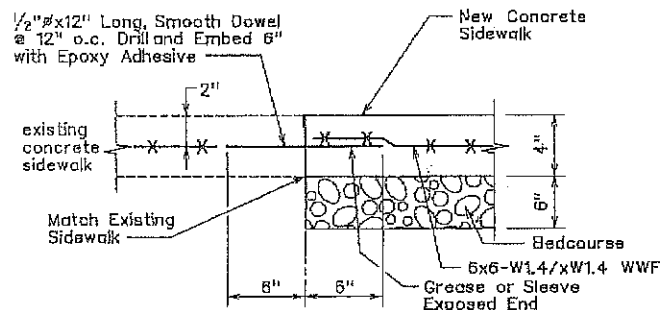

TRANSVERSE JOINT AT EXISTING SIDEWALK

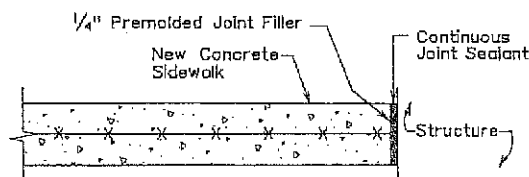

TRANSVERSE JOINT AT STRUCTURE DETAIL

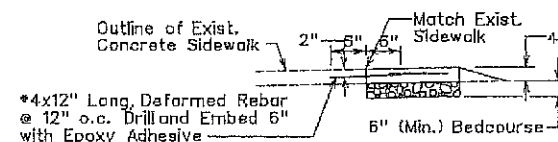

Note:

1. Do not install rebars within 6" of any planned transverse contraction or transverse construction joint.

LONGITUDINAL JOINT AT EXISTING SIDEWALK

NOTES:

1. Dressing of sidewalk shall consist of clearing, grubbing, grading, reshaping and compacting the area adjacent to the improvement with suitable materials shown on the plans and/or as directed by the Engineer. If existing ground is asphalt or concrete surface, dress sidewalk with A.C. pavement, Mix No. V. This work shall be considered incidental to the new sidewalk.
2. Transverse and longitudinal weakened plane joints for sidewalk shall be considered incidental to the new sidewalk.
3. Installation of dowels and tie bars, including drilling and epoxy grout, shall be incidental to Sidewalk.
4. Concrete shall be Class "A".

X	X	
DATE	REVISION	APP'D.

**STANDARD PLAN D-15
CONCRETE SIDEWALK**

STANDARD PLAN D-15 05/31/07

FIGURE 3

Addendum No. 1
r12/1/11