## CALL BOX GENERAL NOTES

- 1. The scope of work consists of providing: 1) accessible features for call boxes including demolishing existing pavement, constructing walkways, ramps and landings, reconstructing pavement, and replacing existing call boxes with new call box assemblies and 2) providing systemwide incorporation of the replacement call boxes including providing new maintenance and answering computers, new digital wireless service and reconnection of hard—wired call boxes along H—3.
- 2. The Contractor is reminded of the requirements of Subsection 108.01 Subletting of Contract, which requires him to perform work amounting to not less than 30 percent of the total contract cost less deductible items. Non-compliance with this Subsection may be grounds for rejection of bid.
- 3. The Contractor's attention is directed to the following Sections of the Special Provisions: Subsection 107.13 Public Convenience and Safety; Subsection 107.21 Contractor's Responsibility For Utility Property And Services; and Section 645 Traffic Control.
- 4. At the end of each day's work, the Contractor shall remove all equipment and other obstructions to permit free and safe passage of public traffic.
- 5. The existence and location of underground utilities, manholes, monuments, Buried railroad tracks, and concrete pavements, and other structures as shown on the plans are from the latest available data but the accuracy is not guaranteed. The Contractor shall make an independent check on the ground by probing and/or with the various utility companies and governmental agencies to verify the exact locations and depths of the existing utilities and obstructions. The Contractor shall exercise proper care in excavating in the area. Whenever connections of new utilities to existing utilities are shown on the plans, the Contractor shall expose the existing lines at the proposed connection to verify their location and depth prior to excavating for the new lines. The Contractor shall be held liable for any damages incurred to the existing facilities and/or improvements as a result of his operations.
- 6. The exact locations and limits or areas to be reconstructed shall be determined in the field by the Engineer.
- 7. The Contractor shall notify the Engineer in writing, two (2) weeks prior to starting paving operations.
- 8. The Contractor shall provide and maintain for access to and from all existing driveways, sidewalks and ADA access routes, and side streets and cross streets at all times. This work shall be considered incidental to the various contract items and will not be paid for separately.
- 9. Smooth riding connections shall be constructed at all limits of resurfacing, including the beginning and end of project, connecting approaches, side streets and driveways as shown on the plans and/or as directed by the Engineer.
- 10. Existing drainage system will be functional at all times during construction. The Contractor is to furnish materials, equipment, labor, tools and incidentals necessary to maintain flow. This work shall be considered incidental to the various contract items.
- 11. The Contractor shall remove and dispose of all existing raised pavement marker, thermo line markings, traffic tapes, and epoxy adhesives prior to the overlaying of Asphalt Concrete Pavement, Mix No. IV and will not be paid for separately. These work items shall be considered incidental to the various contract items.

- 12. The Contractor shall clean and remove any accumulation of aggregates and debris along the roadside within 10 feet of the edge of pavement. This work shall be considered incidental to the various contract items.
- 13. Base Course for Roadway Pavement Sections shall be either Plant Mix Asphalt Concrete Base Course, Recycled Plant Mix Asphalt Concrete Base Course, or Plant Mix Glassphalt Concrete Base Course. Selection will be based on the least expensive base course alternative.
- 14. No material and/or equipment shall be stockpiled or otherwise stored within the highway right—of—way except at locations designated in writing and approved by the Engineer. If use of location is approved by the Engineer, the Contractor shall obtain a permit to use the property within the State Right—of—Way from the State Right—of—Way Branch at telephone no. 692—7332.
- 15. All saw cutting work shall be considered incidental to the various contract items.
- 16. Temporary bench marks indicated on the plans may fall within the new Ramps, Landing or Walkways. The Contractor shall establish new temporary benchmarks, under the supervision of a licensed surveyor, outside the limits of the new work. This work shall be considered incidental to the various contract items.
- 17. The Contractor shall be solely responsible for the protection of adjacent properties, utilities and existing structures from the damages due to construction. Repairing of any damage shall be at the Contractor's own expense, to the satisfaction of the owner.
- 18. Removal and disposal of existing concrete, asphalt concrete pavement and any debris shall be considered incidental to Sections 608 Sidewalks, 650 Curb Ramps and 664 Emergency Telephones and will not be paid for separately.
- 19. Concrete sidewalk shall be reinforced with 6x6 W1.4xW1.4 welded wire fabric, unless otherwise noted on the plans.
- 20. Dressing of shoulder shall consist of clearing and grubbing, grading, reshaping and compacting with suitable material the area adjacent to the improvement as shown on the plans and/or as directed by the Engineer and shall be considered incidental to Section 608 Sidewalks.
- 21. Provide smooth transition where new sidewalk construction meets the existing grade or sidewalk.


#### 22. GENERAL SPECIFICATIONS

Hawaii Standard Specifications for Road, Bridge, and Public Works Construction 1994 and Special Provisions prepared for this project.

- 23. After the project is completed, the Contractor shall restore grades and ground cover disturbed as a result of the project to a condition equal or better than existing before such damage or injury was done.
- 24. Existing utilities shall remain in service and in place at all times. If relocation of the existing utilities is required by the Contract Documents or for the Contractor's convenience, interruption of service shall be kept to a minimum and shall be done at the Contractor's expense with the approval of the affected utility company.

FED. ROAD	STATE	FED. AID	FISCAL	SHEET	TOTAL
DIST. NO.		PROJ. NO.	YEAR	NO.	SHEETS
HAWAII	HAW.	CMAQ-0300(100)	2004	ADD. 4	75

- 25. The Contractor shall verify all dimensions and details shown on the drawings prior to the start of construction. Any discrepancy shall be immediately brought to the attention of the Engineer.
- 26. Construction outside the Hawaii Department of Transportation (HDOT) right—of—way and State acquired parcels are subject to approval by HDOT and the affected owner.
- 27. All construction work shall be done in accordance with the standards and specifications of the HDOT as amended, unless otherwise specified by the contract plans and specifications.
- 28. No Contractor shall perform any construction operation so as to cause falling rocks, soil or debris in any form to fall, slide or flow into existing County drainage systems, or adjoining properties, streets or natural watercourses. Should such violations occur, the Contractor may be cited and the Contractor shall immediately make all remedial actions necessary.
- 29. Benchmark and elev. are indicated on each Site Plan.
- 30. Tack coat shall be incidental to the various asphalt concrete pavement items.
- 31. The Contractor shall be held liable for any damages incurred to the existing landscaping as a result of his operations.
- 32. The Contractor shall hire a professional surveyor with a current license to practice in the State of Hawaii to establish and verify boundary lines.
- 33. Contractor shall notify the State construction inspector before commencement of work on any site with trees in close proximity (20'±).
- 34. Contractor shall comply with conditions as stated in the project NPDES Notice of General Permit Coverage (NGPC).
- 35. The Contractor must notify the Cadastral Section prior to removal of any State Survey Monument (Brass Disk) so that Cadastral can reference the monument prior to demolition of the existing monument. The Contractor shall bear all costs involved in restoring the State Survey Monuments which are affected by their work.
- 36. The Contractor shall notify H-3 Tunnels, Highways Division, Department of Transportation, Engineer—in—Charge, five (5) calendar days prior to commencing work on the Emergency Telephone System (Phone: 485–6260).



"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16-115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS".

DEPARTMENT OF TRANSPORTATION

CALL BOX GENERAL NOTES

ADA Compliance for Emergency Telephones
at Various Locations on Oahu
Federal Aid Project No. CMAQ-0300(100)

Scale: As Shown

Date: AUGUST 27, 2004

10/18/04 REVISED NOTES #1

DATE


FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	CMAQ-0300(100)	2004	5	75

# CALL BOX, LANDING, RAMP AND WALKWAY NOTES

- 1. Typical details shown on CB-19 to CB-22 are intended as Call Box quidelines for design and construction.
- 2. A 2% maximum cross slope shall be maintained in the direction of pedestrian traffic.
- 3. Subject to field conditions, the Engineer shall determine the final location of Call Boxes, Landing and Ramps.
- 4. Transitions from ramps to gutters and roadways shall be flush.
- 5. Walkways, Ramps and Landings shall be constructed to eliminate ponding to the maximum extent feasible.
- 6. The maximum slopes of adjoining gutters or road surface immediately fronting the curb ramp shall not exceed 5% unless otherwise noted on the plans.
- 7. There shall be a 60"x60" level ground surface (2% max. cross slope, both directions) for a forward or side approach, as appropriate, to a Call Box.
- 8. All Walkways, Landing and Ramps shall be reinforced with 6x6 W1.4/W1.4 welded wire fabric, unless otherwise noted in the plans.
- 9. Surface of Walkways, Landings and Ramps shall be firm, stable, and slip- resistant.
- 10. Bed course material is required for ramps, sidewalks, and landings, unless otherwise noted on the plans.
- 11. All Walkways shall provide a minimum clear width of 3'-0" (excluding curb) for pedestrian circulation. If this cannot be met, a minimum 32-inch clear width is allowed for a distance of 24-inches.
- 12. Objects protruding from utility poles and walls adjacent to the walkways (i.e. wall mounted fire hydrants, telephones, meters on poles, etc.) shall be mounted to meet the current American with Disabilities Act Accessibility Guidelines (ADAAG) and will be subject to Engineer's approval.
- 13. If a Ramp, Landing or Walkway is not constructed according to the plans, the Contractor shall reconstruct the Ramp, Landing or Walkway at no cost to the State. Construction tolerance for Portland Cement Concrete shall be based on 1/4 inch per 10 ft. (0.2%). Remedial measures will not be accepted.
- 14. Additional information is available from:
- A. American with Disabilities Act Accessibility Guidelines (ADAAG), Jan. 1998, The Access Board.
- B. Accessible Rights-of-Way: A Design Guide, Nov. 1999, The Access Board.
- C. Designing Sidewalks and Trails for Access, Part 1, July 1999, FHWA.
- D. Designing Sidewalks and Trails for Access, Part 2, Sept. 2001,

## NOTES FOR CONSTRUCTION WITHIN STATE RIGHT-OF-WAY

- 1. The contractor shall obtain a Permit to Perform Work upon State Highway from the Oahu District, State Highways, at 727 Kakoi Street, prior to commencement of work within the State highway right-of-way.
- 2. Construction and restoration of all existing highway facilities within State right-of-way shall be done in accordance with all applicable sections of the 1994 Standard Specifications for Road, Bridges and Public Works Construction, and the Specifications for Installation of Miscellaneous Improvements within State Highways of the State Highways Division.
- 3. Work may be performed only between the hours of 8:00 a.m. and 3:30 p.m., Monday through Friday, except holidays, unless otherwise permitted by the Engineer.
- 4. The Contractor shall provide, install and maintain all necessary signs, lights, flares, barricades, markers, cones, and other protective facilities, and shall take necessary precautions for the protection, convenience, and safety of public traffic. All such protective facilities and precautions to be taken shall conform with the "Administrative Rules of Hawaii Governing the use of Traffic Control Devices at Work Sites on or Adjacent to Public Streets and Highways", adopted by the Director of Transportation, and the current U.S. Federal Highway Administration "Manual on Uniform Traffic Control Devices for Streets and Highways, Part VI — Standards and Guides for Traffic Controls for Street and Highway Construction, Maintenance, Utility and Incident Management Operations" and NCHRP 350.
- 5. The Contractor shall be required to provide adequate, safe, non-skid bridging material over any trench, including shoring, when trenching in pavement areas to handle all types of vehicular traffic. The use of steel plates shall not be used in the freeway travelway.
- 6. No trench shall be open more than 200 feet in advance of the installed and tested pipe and/or ductline. No jumps or spaces will be permitted unless approved in writing by the Engineer.
- 7. Longitude drainage along the highway shall be maintained, at all times to allow free flow.
- 8. All regulatory, guide and construction signs and barricades shall be high intensity reflective sheering.
- 9. Stop work and contact the State Historic Site Office, at 587-0014 immediately should any unidentified archaeological site or remains (such artifacts, shells, bones, charcoal deposits, road or coral alignments, paving or walls) been encountered during construction.
- 10. The contractor shall inform the State Permit Office at 831–6712 at least seven (7) calander days prior to any lane closures or changes to lane closures.
- 11. All signs, pavement markings, striping, etc. removed or damaged by the contractor shall be replaced by the Contractor at no additional cost to the State.




IN CHAPTER 16-115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, RCHITECTS, SURVEYORS AND LANDSCAPE

> DEPARTMENT OF TRANSPORTATION CALL BOX, LANDING, RAMP & WALKWAY NOTES & CONSTRUCTION WITHIN STATE R.O.W. NOTES

ADA Compliance for Emergency Telephones <u>at Various Locations on Oahu</u>

Federal Aid Project No. CMAQ-0300(100) Scale: As Shown

SHEET No. CB4 OF 74 SHEETS



Date: AUGUST 13, 2004

# SEWER NOTES

- 1. All sewer construction shall be performed in accordance with the City's Standard Specifications, Sept. 1986, the Department of Public Works Standard Details, Sept. 1984, current City practices and revised ordinances of Honolulu, 1990 as amended, and the Design Standards of the Dept. of Wastewater Management, Vol. 1, July 1993.
- 2. The Contractor shall notify the inspection section, Wastewater Branch, DDC at 527-5855 or 523-4345 to arrange for inspection services and submit four (4) sets of approved construction plans seven (7) calander days prior to commencement of sewer work. The Contractor shall pay for all inspection costs.
- 3. The underground pipes, cables or ductlines known to exist by the engineer from his research of records are indicated on the plans. The Contractor shall verify the location and depth of the facilities including and affecting sewer lines, in the presence of the wastewater inspector, and exercise proper care in excavating the area. The Contractor shall be responsible and shall pay for all damaged utilities.
- 4. The Contractor shall be responsible for maintaining continuous sewer service to all affected areas during construction.
- 5. The Contractor shall be responsible for any sewage spills caused during construction. The Contractor shall notify the State Department of Health and utilize appropriate sampling and analyzing procedures. The Contractor shall be responsible for all public notifications and press releases.
- 6. Adjust all utility valve box frames and covers, water meter boxes, manhole frames and covers, etc., to new finish grade. Coordinate with private companies and City agencies for work on each respective utility.
- 7. For sewer manhole adjustments upward less than 3", see Std. Detail S—25. For smh adjustments upward greater 3" or for any adjustments downward reconstruct smh top from below the cone section.
- 8. Confined space

For entry by City personnel, including inspectors, into a permit required confined space as defined in 29 CFR part 1910.146(b), the Contractor shall be responsible for providing:


- A. All safety equipment required by the confined space regulations applicable to all parties other than the construction industry, to include, but not limited to, the following:
  - 1. Full body harnesses for up to two personnel.
  - 2. Lifeline and associated clips.
  - 3. Ingress/egress and fall protection equipment.
  - 4. Two-way radios (walkie-talkies) if out of line-of-sight.
- 5. Emergency (escape) respirator (10 minute duration).
- 6. Cellular telephone to call for emergency assistance.
- 7. Continuous gas detector (calibrated) to measure 02, H2S, CO and flammables (capable of monitoring at a distance at least 20 feet away).
- 8. Personal multi-gas detector to be carried by inspector.
- B. Continuous forced air ventilation adequate to provide safe entry conditions.
- C. One attendant/rescue personnel topside (two, if conditions warrant it).


# VERIZON HAWAII GENERAL CONSTRUCTION/DESIGN NOTES

- The Contractor shall procure and pay for all licenses and permits and shall give all notices necessary and incident to the due and lawful prosecution of the work.
- 2. The Contractor shall obtain an excavation permit and toning request from Verizon Hawaii's records section, located at 3239 Ualena Street, third floor, two weeks prior to the start construction. Hours of business are 8:00 a.m. to 11:00 a.m. and 12:00 a.m. to 3:30 p.m. Monday through Friday, except holidays.
- 3. Prior to the excavation of the ductline, the Contractor shall request Verizon Hawaii to locate existing ductline wherever required. For underground cable locating and marking, five (5) calander days advance notice is required. Three (3) calander days advance notice is required for any inspection by a designated representative.
- 4. The locations of existing utilities are approximate only. The Contractor shall exercise extreme caution and shall maintain proper clearances whenever construction crosses or is in close proximity of Verizon Hawaii facilities. The Contractor shall verify their locations and shall be liable for any damages to Verizon Hawaii facilities. Any damages shall be reported immediately to Verizon Hawaii's repair section at #611 (24 hours) or to the excavation permit section at 840–1444 (normal working hours, Monday through Friday, except holidays). As a result of his operations, adjustments to the new ductline alignment, if required, shall be made to provide the required clearances.
- 5. The Contractor shall take necessary precaution not to damage existing cables or ducts. A Verizon Hawaii inspector or designated representative is required to be at any job site whenever there will be a breakage into or entry into any structure that contain Verizon Hawaii facilities. Temporary cable and duct supports shall be provided wherever necessary.
- 6. The Contractor shall notify Verizon Hawaii's inspector or designated representative a minimum of 72 hours prior to excavation, bracing, or backfilling of Verizon Hawaii's structures or facilities.

Verizon Hawaii's Inspectors As Follows:
Moanalua To Koko Head To Laie:
Larry Caetano, 840-2979
Puuloa To Pearl City, Mililani To Mokuleia/Sunset Beach:
Colman Nyuha, 840-2995
Waipahu To Waianae/Kaena Point:
Joe Correia, 840-2994

- 7. All applicable construction work shall be done in accordance with the "Verizon Hawaii Standard Specifications for Placing Underground Telephone Systems", dated March 1999. All subsequent amendments and additions, and all other pertinent standards for telephone construction. Contractor shall familiarize his personnel by obtaining applicable specifications.
- 8. When excavation is adjacent to or beneath Verizon Hawaii's existing structures or facilities, the Contractor shall:
- A. Sheet and/or brace the excavation to prevent slides, cave—ins, or settlements to ensure no movement to Verizon Hawaii's structures or facilities.
- B. Protect existing structures and/or facilities with beams, struts, or underpinning while excavating beneath them to ensure no movement to Verizon Hawaii's structures or facilities.





"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16-115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS"

DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

SEWER NOTES, VERIZON HAWAII


GENERAL CONSTRUCTION/DESIGN NOTES

ADA Compliance for Emergency Telephones
at Various Locations on Oahu
Federal Aid Project No. CMAQ-0300(100)

Scale: As Shown

Date: AUGUST 13, 2004

SHEET No. CB5 OF 74 SHEETS



FED. ROAD	STATE	FED. AID	FISCAL	SHEET	TOTAL
DIST. NO.		PROJ. NO.	YEAR	NO.	SHEETS
HAWAII	HAW.	CMAQ-0300(100)	2004	7	75

# VERIZON HAWAII GENERAL CONSTRUCTION / DESIGN NOTES (CONT'D)


- 9. The underground pipes, cables, or ductlines known to exist by the engineer from his search and records are indicated on the plans. The Contractor shall verify the locations and depths of the facilities and exercise proper care in excavating in the area.
- 10. The Contractor, at his own expense, shall keep the project and surrounding area free from dust nuisance. The cost for supplementary measures, which will be required by the City and County, shall be borne by the Contractor.

## CATV NOTES:


- 1. The Contractor shall procure and pay for all licenses and permit and shall give all necessary and incident to the due and lawfull prosecution of the work.
- 2. The Contractor shall take necessary precaution not to damage existing cables or ducts. Any work involving existing cables or ducts shall be done in the presence of the Time Warner Oceanic Cable Company inspector or his representative.
- 3. The Contractor shall notify the Time Warner Oceanic Cable Company inspector 48 hours prior to start of pullbox adjustments.
- 4. Contractor shall provide all materials and furnish all labor and equipment necessary to re—adjust the pullbox.
- 5. The location of CATV facilities shown on plans are from existing records with varying degrees of accuracy as to its actual fixed location. The Contractor shall use extreme caution when working in close proximity of CATV.
- 6. The Contractor shall obtain Excavation Permit clearance from Oceanic's Engineering Section located at 200 Akamainui st., Mililani Tech Park.
- 7. Any work required to relocate CATV facilities shall be done by Time Warner Oceanic Cable and the Contractor shall be responsible for all coordination requirements and associated costs.
- 8. Any damage to Time Warner Oceanic's facilities shall be reported to OCl's Repair Dispatch Department at 625–8282 or 625–8666.
- 9. At no time shall cement mortar, wood, or any other material be used between precast sections. Leveling or raising of boxes to grade must be done at brickwork section using cement mortar. The permanent installation of wooden wedges to accomplish this purpose will not be accepted.
- 10. Trenching to be by hand digging near and across existing utility lines.
- 1. For underground cable locating and marking, seven (7) calander days advance notice is required. Five (5) calander days advance notice is required for any inspection by a designate representative. Contractor shall take necessary precaution not to damage any existing cables or ducts. Oceanic's inspector or designated representative is required to be at any job site whenever there will be a breakage into or entry into any structure that contain Time Warner Oceanic facilities.

## WATER NOTES

- 1. Unless otherwise specified, all materials and construction of water system facilities and appurtenances shall be in accordance with the STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, dated 1994, as amended, of the Hawaii Highways Division, Department of Transportation, and the City and County of Honolulu Board of Water Supply's "WATER SYSTEMS STANDARD", DATED 2002, THE "WATER SYSTEM EXTERNAL CORROSION CONTROL STANDARDS", VOLUME 3, DATED 1991, and all subsequent amendments and additions.
- 2. All plans approved by the Board of Water Supply are based solely on the adequacy of the water supply. All other features of the water system, such as lines, grades, fittings, drainage, etc., and other features of improvements shall not be the responsibility of the Board of Water Supply.
- 3. The Contractor shall notify BWS maintenance Unit—Engineering, Construction Section one week prior to commencing work on the water system.
- 4. The existence and location of underground utilities and structures as shown on the plans are from the latest available data but is not guaranteed as to the accuracy of encountering of other obstacles during the course of the work. The Contractor shall be responsible and pay for all damages to existing utilities. The Contractor shall not assume that where no utilities are shown, that none exist.
- 5. Re—approval shall be required if this project is not under construction within a period of two years.
- 6. Prior to any excavating, the Contractor shall verify in the field the location of existing water mains and appurtenances.
- 7. The Contractor shall adjust all manhole frames/valve boxes/meter boxes within the project limits. The Contractor shall be responsible for "referencing" these manholes/valves boxes/meter boxes to facilitate the adjustments.
- 8. The Contractor shall be responsible for the protection of all water lines during construction. The Contractor shall be especially careful when excavating behind water lines, trees, and bends wherever there is a possibility of water line movement due to the removal of the supporting earth beyond the existing reaction blocks. The Contractor shall take whatever measures necessary to protect the water lines, such as construction special reaction blocks (with BWS approval) and/or modifying his construction method.
- 9. Contractor shall cut and plug all existing unused laterals at the main whether or not shown on the plans. Meter and valve boxes to be or already abandoned shall be demolished or removed and properly disposed of. The damaged area shall be repaired to an equal or better condition than the immediate area. All work shall be done at the expense of the Contractor.
- 10. The Contractor shall verify all existing service lateral locations whether shown or not shown on plans prior to commencing with any of the work and shall not assume that where no services are shown, none exist.
- 11. Maintain 3'-0" minimum cover for all existing waterlines (18" minimum for service laterals) from new finish grade. The contractor shall probe the waterline and service laterals and submit the probing data to BWS Maintenance Unit-Engineering Construction Section. Any adjustments to the existing water system to meet the minimum cover and there requirements of the BWS Standards, whether shown on plans or not, shall be done by the contractor at no cost to BWS.



"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16-115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS"



DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

VERIZON NOTES CONTINUED,


CATV NOTES AND WATER NOTES

ADA Compliance for Emergency Telephones
at Various Locations on Oahu
Federal Aid Project No. CMAQ-0300(100)

Scale: As Shown

Date: AUGUST 13, 2004

SHEET No. CB6 OF 74 SHEETS



# HECO NOTES

#### 1. Location of HECO Facilities

The location of HECO's overhead and underground facilities shown on the plans are from existing records with varying degrees of accuracy and are not guaranteed as shown. The contractor shall verify in the field the locations of the facilities and shall exercise proper care in excavating and working in the area. The contractor shall be responsible for any damages to HECO's facilities whether shown or not shown on the plans.

2. Compliance with Hawaii Occupational Safety and Health Laws

The contractor shall comply with the state of Hawaii's Occupational Safety and Health laws and regulations, including without limitation, those related to working on or near exposed or energized exposed or energized electrical lines and equipment.

#### 3. Excavation Permit

The contractor shall obtain an excavation permit from HECO's Technical Division (543—5654) located at 820 Ward Avenue, 4th floor, two weeks prior to starting construction. Please refer to our request number at that time.

4. Caution!!! Electrical Hazard!!!

Existing HECO overhead and underground lines are energized and will remain energized during construction unless prior special arrangements have been made with HECO. Only HECO personnel are to handle these energized lines and erect temporary guards to protect these lines from damage. the contractor shall work cautiously at all times to avoid accidents and damage to existing HECO facilities, which can result in electrocution.

#### 5. Overhead Lines

State law requires that a worker and the longest object he or she may contact cannot come closer than a minimum radial clearance of 10 feet when working close to or under any overhead lines rated 50KV and below. For each additional KV above 50KV, an additional 0.4 inch shall be added to the 10—foot clearance requirement. The preceding information on line clearance requirements is provided as a convenience and it is the contractor's responsibility to be informed of and comply with any revisions or amendments to the law.

Should the contractor anticipate that his work will result in the need to encroach within the minimum required clearance at any time, the contractor shall notify HECO at least four (4) weeks prior to the planned encroachment so that, if feasible, the necessary protections (e.g. relocate, de-energize, or blanket HECO lines) can be put in place. HECO's cost of safeguarding its lines will be charged to the contractor.

Contact HECO's customer installations department at 543-7846 for assistance in identifying and safeguarding overhead power lines.

Refer to Section X of HECO's Electric Service Installation Manual for additional guidelines when working around HECO's facilities. A copy may be obtained from HECO's Customer Installations Department.

#### 6. Pole Bracing

A minimum clearance of 10 feet must be maintained when excavating around utility poles and/or their anchor system to prevent weakening or pole support failure.

Should work require excavating within 10 feet of a pole and/or its anchor system, the contractor shall protect, support, secure, and take all other precautions to prevent damage to or leaning of these poles. The contractor is responsible for all associated costs to brace, repair, or straighten poles. All means of structural support for the pole proposed by the contractor shall first be reviewed by HECO before implementation. For pole bracing instructions, the contractor shall call the HECO Construction and Maintenance Dept., customer & system

superintendent at 543–4223 a minimum of two (2) weeks in advance.

#### 7. Underground Lines

The contractor shall exercise extreme caution whenever construction crosses or is in close proximity of underground lines. HECO's existing electrical cables in the area are energized and will remain energized during construction. Only HECO personnel are to handle these cables and erect temporary guards to protect these cables from damage. The cost of HECO's assistance in providing proper support and protection of its underground lines will be charged to the contractor. The contractor shall exercise due care and precautions to avoid disturbing any energized cables and temporary guards and shall work cautiously at all times to avoid accidents. For verification of underground lines or for assistance in providing proper support and protection of these lines, the contractor shall call HECO's Construction & Maintenance Dept., Customer & System Superintendent, at 543–4223, a minimum of two (2) weeks in advance.

#### 8. Underground Fuel Pipelines

The contractor shall exercise extreme caution whenever Construction Crosses or is in close proximity of HECO's Underground fuel oil pipelines. Special precautions are required when excavating near HECO's underground fuel oil pipeline (see HECO instruction consultants / contractors on "excavation near HECO's underground fuel pipeline

#### 9. Excavations

When trench excavation is adjacent to or beneath HECO's existing structures or facilities, the contractor is responsible for:

- A. Sheeting and bracing the excavation to prevent slides, cave—ins, and settlements.
- B. Protecting existing structures or facilities with beams, struts, or under-pinnings.
- C. Backfilling with proper backfill material including special thermal backfill where existing (refer to engineering department for thermal backfill specifications).

  borne by the contractor.


#### 10. Relocation of HECO facilities

Any work required to relocate or modify HECO facilities shall be done by HECO, or by the contractor under HECO's supervision. The contractor shall be responsible for all coordination, and shall provide necessary support for HECO's work, which may include, but not be limited to, excavation and backfill, permits and traffic control, and restoration of pavement, sidewalks, and other facilities.

All costs associated with any relocation or modification (either temporary or permanent) for the convenience of the contractor, or to enable the contractor to perform his work in a safe and expeditious manner in fulfilling his contract obligations shall be borne by the contractor.

#### 11. Conflicts

The contractor acknowledges that HECO is not responsible for any delay or damage that may arise as a result of any conflicts discovered or identified with respect to the location or construction of HECO's electrical facilities in the field, regardless of whether the contractor has met the requested minimum advance notices. In order to minimize any delay or impact arising from such conflicts, the contractor shall notify HECO immediately upon discovery or identification of such conflict.



"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16—115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS".

FED. ROAD DIST. NO.

HAW.

FED. AID PROJ. NO.

CMAQ-0300(100) 2004

FISCAL YEAR

SHEETS

# DEPARTMENT OF TRANSPORTATION


#### HECO NOTES

ADA Compliance for Emergency Telephones
at Various Locations on Oahu
Federal Aid Project No. CMAQ-0300(100)

Scale: As Shown

Date: AUGUST 13, 2004

SHEET No. CB7 OF 74 SHEETS



# HECO NOTES (CONT'D)

## 12. Damage to HECO facilities

The Contractor shall be responsible for the protection of all HECO surface and subsurface utilities and shall be responsible for any damages to HECO's facilities as a result of his operations. The Contractor shall immediately report such damages to HECO's trouble dispatcher at 548–7961. Repair work shall be done by HECO or by the contractor under HECO's supervision. Costs for damages to HECO's facilities shall be borne by the contractor.

#### 13. HECO Stand-By Personnel

The Contractor may request HECO to provide an inspector to stand—by during Construction near HECO facilities. The cost of such inspection will be charged to the Contractor.

The Contractor shall call HECO Construction and Maintenance Dept., Customer & systems superintendent at 543–4223 a minimum of seven (7) calander days in advance to arrange for HECO stand-by-personnel.

#### 14. Clearances

The following clearances shall be maintained between HECO's ductline and all adjacent structures (charted and uncharted) in the trench:

Structure Type	Minimum Clearance (Inches)
Water lines, parallel	36
Water lines, crossing	12(a)
Sewer lines, parallel	<i>36(b)</i>
Sewer lines, crossing	24(c)
Drain lines, parallel	12
Drain lines, crossing	6(d) 12
Electrical and gas lines, parallel	12
Electrical and gas lines, crossing	12
Telephone lines, parallel	6(d)
Telephone lines, crossing	6(d)
Chevron oil lines, parallel	36
Chevron oil lines, crossing	48 below oil line (e)

- a. The minimum vertical clearances to water lines crossing electrical ductlines can be reduced to 6 inches if the electrical ductline structure is smaller than 16 inches, is concrete encased, and is below the water line.
- b. A minimum horizontal clearance of 36 inches is required between new handholes and existing sewer laterals.
- c. The minimum vertical clearances to sewer pipes crossing electrical ductlines can be reduced to 12 inches if the sewer pipe is jacketed in concrete.
- d. The minimum clearances shall be increased to 12 inches if the electrical ductline is direct buried.
- e. The minimum vertical clearances to oil lines crossing electrical ductlines can be reduced to 24 inches below oil lines if the crossings are encased in 6 inches of concrete.

  f. The contractor shall notify the construction manager & HECO of any heat sources (power)
- f. The contractor shall notify the construction manager & HECO of any heat sources (power cable duct bank, steamline, etc.) encountered that are not properly identified on the drawing.

The following clearance shall be maintained between HECO's fuel oil pipelines and all adjacent structures: 24—inches, parallel or crossing. The minimum clearance can be reduced to 12 inches (parallel and below only) if the structure is jacketed in concrete.

# 15. Indemnity

The contractor shall indemnify, defend and hold harmless HECO from and against all losses, damages, claims, and actions, including but not limited to reasonable attorney's fees and costs based upon or arising out of damage to property or injuries to persons, or other tortious acts caused or contributed to by contractor or anyone acting under its direction or control or on its behalf; provided contractor's indemnity shall not be applicable to any liability based upon the sole negligence of HECO.

Additional Notes When Work Involves Constr. of HECO Facilities

#### 16. Schedule

Contractor shall furnish his construction schedule \_ working days prior to starting work on HECO facilities. Contractor shall give HECO, in writing, \_ working days notice to proceed with HECO's portion of work.

### 17. Authority

All construction, restoration work, and inspection shall be subject to whichever governmental agency has authority over the work.

#### 18. Specifications

Construction of HECO's underground facilities shall be constructed in accordance with the latest revisions of HECO specifications cs7001, cs7003, cs7202, cs9301, and cs9401 and applicable HECO standards.

#### 19. Construction

Contractor shall furnish all labor, materials, equipment, and services to properly perform and fully complete all work shown on the contract, drawings, and specifications. All materials shall be new and manufactured in the United States of America. All manhole, handhole, and ductline installations shall be inspected and approved by HECO prior to excavation and prior to placing concrete. Contractor shall notify HECO's Inspection Division at 543–4356 at least 48 hours prior to placing concrete.

#### 20. Stakeout

The contractor shall stakeout all proposed HECO facilities within the project area so as to not conflict with any utility (existing or proposed) and any proposed construction or improvement work for verification by HECO before proceeding with HECO work.

#### 21. Ductlines

All ductline installations shall be pvc schedule 40 encased in concrete, unless otherwise noted. All completed ductlines shall be mandrel tested by the contractor in the presence of HECO's inspector using HECO's standard practice. The contractor shall install a 1/8" polyolefin pull line in all completed ductlines after mandrel testing is complete.

#### 22. Joint Pole Removal

The last joint pole occupant off the poles shall remove the poles.



"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16-115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE

FED. ROAD DIST. NO.


STATE

FISCAL YEAR

FED. AID

PROJ. NO.

HAW. CMAQ-0300(100) 2004



STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION


HECO NOTES CONTINUED

ADA Compliance for Emergency Telephones
at Various Locations on Oahu
Federal Aid Project No. CMAQ-0300(100)

Scale: As Shown

Date: AUGUST 13, 2004

SHEET No. CB8 OF 74 SHEETS



FED. ROAD	STATE	FED. AID	FISCAL	SHEET	TOTAL
DIST. NO.		PROJ. NO.	YEAR	NO.	SHEETS
HAWAII	HAW.	CMAQ-0300(100)	2004	10	75

## GAS COMPANY NOTES

- 1. The Gas Company gas pipelines in the project area are plastic coated and cathodically protected. The Contractor shall be extremely careful when working near these gas pipelines.
- 2. Written clearances must be obtained from The Gas Company, Maps and Records Department, 515 Kamakee Street, at least seven (7) calander days prior to starting excavation near these gas pipelines.
- 3. Since gas line locations on field maps are approximate, the Contractor, after obtaining written clearance, shall call USA North a minimum of two (4) calander days before starting excavation to arrange for field location of the existing gas pipelines. The telephone number is 1-800-227-2600.
- 4. The Contractor shall excavate and backfill around gas pipelines in the presence of a representative of The Gas Company and HDOT. All backfill within six inches of any gas pipeline shall be select cushion material approved by The Gas Company.
- 5. For relocation of any gas pipeline, the Contractor shall notify HDOT and The Gas Company seven (7) calander days before starting work. The telephone number is 594-5574. The Contractor shall provide the necessary excavation and backfill, obtain traffic permits, and restore pavement, sidewalks, and other facilities. Any relocation of gas facilities shall be done by The Gas Company and paid for by the Contractor.
- 6. The Contractor shall notify The Gas Company immediately after any damage has been caused to existing gas pipelines, coatings, or its cathodic protection devices. The telephone number is 535-5933, 24 hours a day. The Contractor shall be liable for any damage to The Gas Company facilities. Repair work on such damage shall be done by The Gas Company with payment for this work to be borne by the Contractor.
- 7. Minimum vertical and horizontal clearance between the gas pipelines and other pipelines, conduits, ductlines, or other facilities shall be 12 inches. Adequate support and protection for gas pipelines exposed in the trench shall be provided by the Contractor and approved by The Gas Company.
- 8. The Contractor shall work in an expeditious manner in order to keep the uncovered gas pipelines exposed for as short a period of time as possible.

# TRAFFIC SIGNAL AND TECHNOLOGY DIVISION NOTES


- The contractor shall notify the Traffic Signal and Technology Division, Department of Transportation services, five (5) calander days prior to commencing work on the traffic signal system (phone: 523-4589)
- 2. The traffic signal system shall be kept operational during construction. Any relocation required shall be approved by the traffic signal and technology division, department of transportation services, and paid for by the contractor.
- 3. The contractor shall be responsible for any damages to the existing traffic signal facilities, including the traffic signal interconnect system. Any and all damages to these facilities shall be repaired by the contractor at his cost in accordance with the requirements of the City and County of Honolulu.
- 4. The contractor shall be responsible for any damages to the existing traffic signal fiber optic cable system. Any and all damages to these facilities shall be repaired by the contractor at his cost in accordance with the requirements of the City and County of Honolulu.

## PAVING AROUND MANHOLES

- 1. The Contractor shall place hot asphalt concrete around manholes and compact properly with a vibrating plate compactor.
- 2. If a plate compactor is not used, the Contractor shall use a pneumatic roller to roll the area around the manhole which is not rolled by the steel roller.
- 3. The Contractor shall fog seal or brush emulsion seal on the material placed as backfill on the area around the manhole that was not compacted by the roller. Black sand shall be used to blot out the area if the fog is too heavy.

# SANDWICH ISLES COMMUNICATIONS NOTES

- 1. The location of Sandwich Isles Communications, Inc.'s (SIC) facilities shown on the plans are from existing records with varying degrees of accuracy and are not guaranteed as shown. The contractor shall exercise extreme caution when the excavation and construction crosses or is in close proximity of SIC's underground lines. Contact (888) 995-7274 to request a field location of SIC underground facilities, at least 48 hours prior to beginning work in the vicinity of SIC facilities.
- 2. The contractor shall notify the SIC construction coordinator at least two weeks prior to starting construction. All work in and around existing SIC facilities shall be monitored by an SIC inspector. Contact SIC at the above contact number to arrange for inspection services, at least 48 hours in advance of any work
- 3. The contractor shall be liable for all damages to existing SIC facilities. Any SIC warning tape that is damaged should be replaced at contractors cost.
- 4. Any work required to relocate SIC's facilities shall be done by SIC and the contractor shall be responsible for all applicable coordination and construction costs. Contractor shall notify SIC of any required relocation work, at least 30 days in advance of required work.
- 5. Any damage to SIC's facilities will be immediately reported to SIC's trouble dispatcher at the above contact number.
- 6. Replacement backfill over any existing SIC facilities should be similar to existing backfill and shall be compacted to 95% of existing maximum dry density. Flowable fill (CLSM) may be used for backfill over existing SIC facilities, with the prior approval of SIC and the governmental agency that owns and maintains the right of way, at contractor's cost.
- 7. New utilities shall maintain the following offset from existing SIC underground facilities:
  - A. 5' horizontal clearance from any fiber optic cable.
  - B. 3' horizontal clearance from any copper cable.
  - C. 18" vertical clearance from any cable crossing. When crossing SIC cables, new utility lines should be concrete jacketed on 2' either side of crossing.
  - D. All work to be completed at contractor's cost.



BSERVATION OF CONSTRUCTION" IS DEFINED RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS".

DEPARTMENT OF TRANSPORTATION


MISCELLANEOUS NOTES

ADA Compliance for Emergency Telephones at Various Locations on Oahu

Federal Aid Project No. CMAQ-0300(100) Scale: As Shown

Date: AUGUST 13, 2004

SHEET No. CB9 OF 74 SHEETS



MECHANICAL	ELECTRICAL	DIVISION	NOTES	(CITY)
	 	<u> </u>	.,00	10

- 1. The contractor shall notify the joint pole committee two (2) weeks in advance of any relocation of utility pole(s) that may be necessary.
- 2. The contractor shall notify the Mechanical / Electrical Division, Department of Design and Construction, three (3) working days prior to commencing work on the street light system or fiber optic communications system. (phone: 527-5002).
- 3. The street lightiing system shall be kept operational during construction. Any relocation required shall be approved by the Mechanical / Electrical division and paid for by the contractor.
- 4. The locations of the existing underground street light facilities shown on the plans are from existing plans and are approximate only. The contractor shall exercise caution when construction crosses or is in close proximity to the existing street light facilities. The contractor shall be responsible for any damages to the existing street light facilities. Any and all damages to these facilities shall be repaired by the contractor at his cost in accordance with the requirements of the City and County of Honolulu.
- 5. The contractor shall be responsible for any damages to the City's existing communications fiber optic cable system. Any and all damages to these facilities shall be repaired by the contractor at his cost in accordance with the requirements of the City and County of Honolulu.

# NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) REQUIREMENTS

- 1. The Contractor shall obtain and comply with the National Pollutant Discharge Elimination System (NPDES) requirements for Oahu District permit projects. This is available at the Oahu District office at 727 Kakoi Street (ph. 831–6793). Due to potential cost impacts, the Contractor needs to be aware of these requirements.
- 2. The contractor shall complete and submit a contractor's certification of NPDES compliance, including completion of the best management practice (BMP) checklist and submittal of a written BMP plan and drawings, prior to issuance of the permit to perform work upon State highways.

# FREE SERVICE FOR LOCATING UNDERGROUND UTILITIES

1. A free service is available to Contractors for locating underground utilities. Service is provided by Underground Service Alert North, at toll free telephone no. 1—800—227—2600. Call Underground Service Alert North at least four (4) calander days prior to the start of any excavation work.

# PUBLIC TRANSIT DIVISION (DTS) NOTE:

1. The Contractor shall notify Oahu Transit Services, Inc., (OTS—THEBUS Contractor), ED Sniffen (848—4571) or Lowell Tom (848—4578), two weeks prior to construction, informing them of location, scope of work, proposed closure of any streets or traffic lanes, and the need to relocate any bus stops.

FED. ROAD	STATE	FED. AID	FISCAL	SHEET	TOTAL
DIST. NO.		PROJ. NO.	YEAR	NO.	SHEETS
HAWAII	HAW.	CMAQ-0300(100)	2004	11	75



"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16—115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS".

DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION


#### MISCELLANEOUS NOTES

ADA Compliance for Emergency Telephones
at Various Locations on Oahu

Federal Aid Project No. CMAQ-0300(100)

Scale: As Shown Date: AUGUST 13, 2004

SHEET No. CB10 OF 74 SHEETS

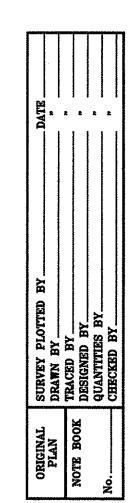

# WATER POLLUTION AND EROSION CONTROL NOTES:

#### 1. General:

The Contractor is reminded of the requirements of Section 209 — Water Pollution and Erosion Control, in the "Hawaii Standard Specifications for Road, Bridge and Public Works Construction," as amended. Section 209 describes but is not limited to: submittal requirements; scheduling of a water pollution and erosion control conference with the Engineer; construction requirements; method of measurement; and basis of payment. No work shall commence without a BMP plan approved by the Department of Health.

The Contractor shall follow the guidelines in the "Best Management Practices Manual for Construction Sites in Honolulu," dated May 1999 in developing, installing and maintaining the best management practices (BMPs) for the project. The Contractor may submit alternate methods to the Engineer for acceptance.

The Contractor shall keep a copy of the approved BMP, NOI, etc. on the project site. The BMP shall be updated to reflect any changes made during the course of construction for the duration of the project.

The Engineer may assess liquidated damages of up to \$27,500 for non-compliance of each BMP requirement and each requirement stated in Section 209, for every day of non-compliance. There is no maximum limit on the amount assessed per day.

The Engineer will deduct the cost from the progress payment for all citations received by the department for non-compliance, or the Contractor shall reimburse the State for the full amount of the outstanding cost incurred by the State, whichever is greater.

#### 2. Waste Disposal:

- A. Waste Materials: All waste materials shall be collected and stored in a securely lidded metal dumpster that does not leak. The dumpster shall meet all local and State solid waste management regulations. All trash and construction debris from the site shall be deposited in the dumpster. The dumpster shall be emptied a minimum of twice per week or as often as is deemed necessary. No construction waste materials shall be buried onsite. The Contractor's supervisory personnel shall be instructed regarding the correct procedure for waste disposal. Notices stating these practices shall be posted in the office trailer and the Contractor shall be responsible for seeing that these procedures are followed.
- B. Hazardous Waste: All hazardous waste materials shall be disposed of in the manner specified by local or State regulation or by the manufacturer. The Contractor's site personnel shall be instructed in these practices and shall be responsible for seeing that these practices are followed.
- C. Sanitary Waste: All sanitary waste shall be collected from the portable units a minimum of once per week, or as required.
- 3. Erosion and Sediment Control Inspection and Maintenance Practices:
- A. All control measures shall be inspected at least once each week and within 24 hours following any rainfall event of 0.5 inches or greater.
- B. All measures shall be maintained in good working order. If repair is necessary, it shall be initiated within 24 hours after the inspection.
- C. Built—up sediment shall be removed from silt fence when it has reached one—third the height of the fence.

- D. Silt screen or fence shall be inspected for depth of sediment, tears, to verify that the fabric is securely attached to the fence posts or concrete slab and to verify that the fence posts are firmly in the ground.
- E. Temporary and permanent seeding and planting shall be inspected for bare spots, washouts and healthy growth.
- F. The Contractor shall submit to the Engineer a maintenance inspection report promptly after each weekly inspection.
- G. The Contractor shall select a minimum of three personnel who shall be responsible for inspections, maintenance and repair activities and filling out the inspection and maintenance report.
- H. Personnel selected for the inspection and maintenance responsibilities shall receive training from the Contractor. They shall be trained in all the inspection and maintenance practices necessary for keeping the erosion and sediment controls used onsite in good working order.
- All slopes and exposed areas shall be grassed as soon as final grades have been established. Grading to final grade shall be continuous, and any area in which work has been interrupted or delayed or exposed for more than 15 days shall be grassed in order to prevent dust, erosion and silt runoff. Areas with imported soils shall be grassed not more than 5 working days after final grades have been established.
- J. Temporary erosion controls shall not be removed before permanent erosion controls are in-place and established.
- 4. Good Housekeeping Best Management Practices:
- A. Materials Pollution Prevention Plan:
- 1. Applicable materials or substances listed below are expected to be present onsite during construction. Other materials and substances not listed below shall be added to the inventory of the Construction Contractor's site—specific BMP plan.


Concrete
Detergents
Paints (enamel and latex)
Metal Studs
Tar

Fertilizers
Petroleum Based Products
Cleaning Solvents
Wood
Masonry Block

- 2. Material management practices shall be used to reduce the risk of spills or other accidental exposure of materials and substances to storm water runoff. An effort shall be made to store only enough product as is required to do the job.
- 3. All materials stored onsite shall be stored in a neat, orderly manner in their appropriate containers and if possible under a roof or other enclosure.
- 4. Products shall be kept in their original containers with the original manufacturer's label.
- 5. Substances shall not be mixed with one another unless recommended by the manufacturer.
- 6. A product shall be used up completely before disposing of the container.
- 7. Manufacturer's recommendations for proper use and disposal shall be followed.
- 8. The Contractor shall conduct a daily inspection to ensure proper use and disposal of materials onsite.

FED. ROAD DIST. NO. STATE FED. AID PROJ. NO. FISCAL YEAR NO. SHEETS

HAWAII HAW. CMAQ-0300(100) 2004 12 75



"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16—115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS"

DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION


WATER POLLUTION AND


EROSION CONTROL NOTES

ADA Compliance for Emergency Telephones

<u>at Various Locations on Oahu</u> <u>Federal Aid Project No. CMAQ-0300(100)</u>

Scale: As Shown






Date: AUGUST 13, 2004

FED. ROAD	STATE	FED. AID	FISCAL	SHEET	TOTAL
DIST. NO.		PROJ. NO.	YEAR	NO.	SHEETS
IIAWAII	HAW.	CMAQ-0300(100)	2004	13	75


# WATER POLLUTION AND EROSION CONTROL NOTES (Cont.)


- B. Hazardous Material Pollution Prevention Plan
- 1. Products shall be kept in original containers unless they are not resealable.
- 2. Original labels and Material Safety Data Sheets (MSDS) shall be retained and made available to the Engineer upon request.
- 3. Surplus products shall be disposed of according to manufacturers' instructions or local and state recommended methods.
- C. Onsite and Offsite Products Specific Plan
- 1. The following product specific practices shall be followed onsite:
- a. Petroleum Based Products: All onsite vehicles shall be monitored for leaks and receive regular preventive maintenance to reduce the chance of leakage. Petroleum products shall be stored in tightly sealed containers which are clearly labeled. Any asphalt substances used onsite shall be applied according to the manufacturer's recommendation.

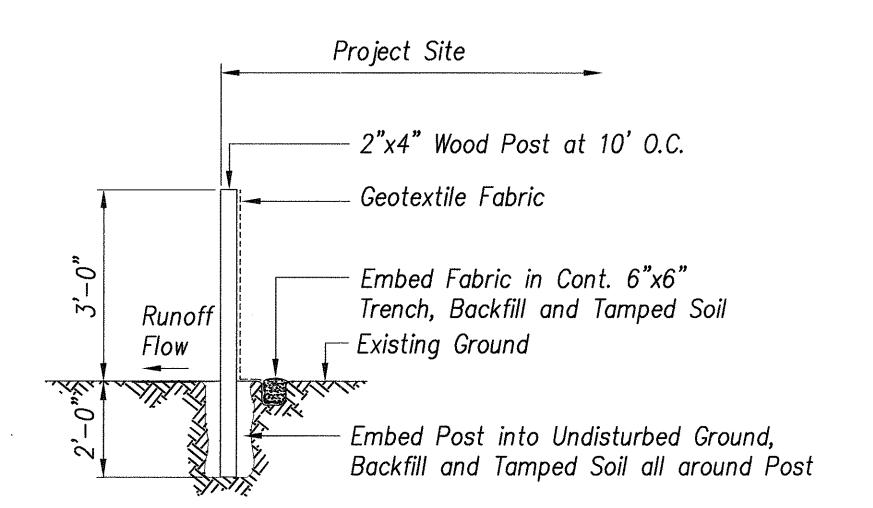


TEMPORARY SILT FENCE DETAIL

Not to scale

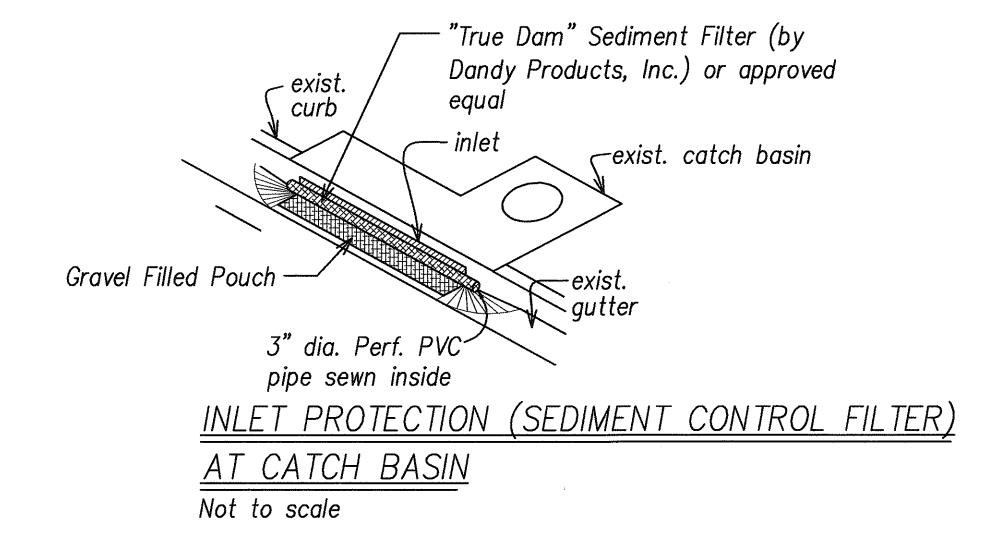

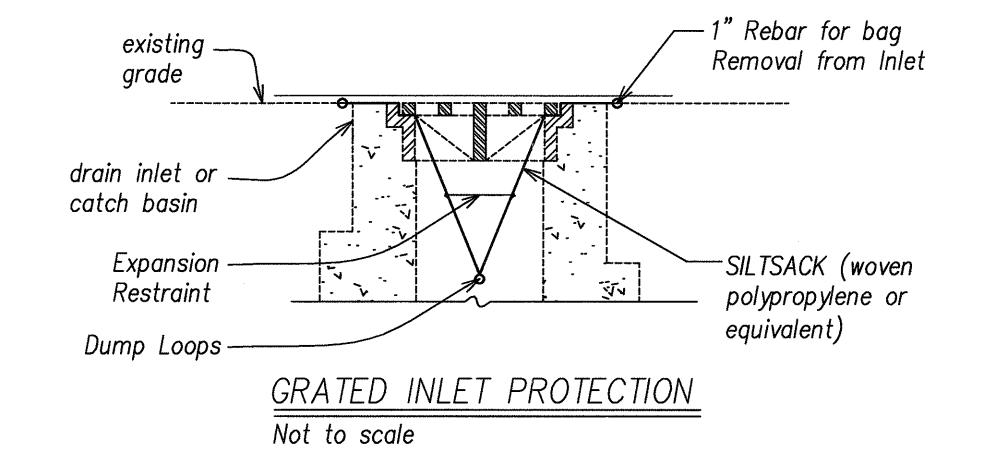



"OBSERVATION OF CONSTRUCTION" IS DEFINED IN CHAPTER 16—115, HAWAII ADMINISTRATIVE RULES ENTITLED "PROFESSIONAL ENGINEERS, ARCHITECTS, SURVEYORS AND LANDSCAPE ARCHITECTS"

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION AND CONSTRUCTION OF THIS PROJECT WILL BE UNDER MY OBSERVATION.

APRIL 30, 2006
WILSON OKAMOTO CORP. LIC. EXP. DATE

DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

EROSION CONTROL NOTES CONTINUED

AND INLET PROTECTION DETAIL

ADA Compliance for Emergency Telephone

ADA Compliance for Emergency Telephones
at Various Locations on Oahu
Federal Aid Project No. CMAQ-0300(100)

Scale: As Shown

Date: AUGUST 13, 2004

SHEET No. CB12 OF 74 SHEETS

