

GENERAL NOTES

1. The scope of work consists of but is not limited to:

- 1) Remove and clear all abandoned office furniture, construction debris and materials, trees and vegetation and basketball backstops from project site inside chainlink fenced area.
- 2) Construct drain gutter, grating, accessible parking stalls, accessible aisle , sign and sign posts.
- 3) Construct concrete accessible ramp and rail. Modify chainlink fence, light post and pedestal. Replace damaged concrete slab and built-up ramps at door threshold.
- 4) Repair concrete masonry curb wall and concrete floor slab.
- 5) Demolish and remove existing wall and window plywood infill, doors and windows, partition walls, concrete stage platform, stair and rail.
- 6) Renovate Office Building "A".
- 7) Renovate Office Building "B".
- 8) Clear all existing underground sewer lines to connection at property line, clear all debris from existing drain line and gutter to daylight. Replace all existing downspout system.
- 9) Additive Alternate No. 1: Reconstruct lanai and walkway. Construct underground downspout drainage system and related work.
- 10) Additive Alternate No. 2: Construct office work station partitions in Building A and Building B.
- 11) Additive Alternate No. 3: Renovate Storage Building C. Replace entry door and frame. Repaint exterior complete.
- 12) Additive Alternate No. 4: Install bird control devices at underside of viaduct.

2. The Contractor is reminded of the requirements of Subsection 105.16 Subcontracts, which requires him to perform work to not less than 30% of the total contract cost less deductible items. Non-compliance with this Subsection may be grounds for rejection of bid.
3. The Contractor's attention is directed to the following Sections of the Special Provisions: Subsection 107.06 - Contractor Duty Regarding Public Convenience; Subsection 107.12 - Protection of Persons and Property; and Section 645 - Work Zone Traffic Control.
4. At the end of each day, the Contractor shall clear and remove all equipment and other obstructions to permit free and safe passage of public traffic.
5. The existence and location of underground utilities, manholes, monuments and structures as shown on the plans are from the latest available data, but the accuracy is not guaranteed. The encountering of other obstacles during the course of work is possible. The Contractor shall tone for the exact locations and depths of all underground facilities, either shown on omitted from the plans, in areas where work, such as the placement of sign posts, traffic signal conduits, etc. may affect these properties. Toning shall be considered incidental to the various contract items and will not be paid for separately. The Contractor shall be held liable for any damages incurred to the existing facilities and/or improvements as a result of his operations.

6. The Contractor shall notify the Engineer in writing, two (2) weeks prior to starting construction operations.
7. The Contractor shall obtain a Community Noise permit from the State Department of Health, Noise and Radiation Branch, 591 Ala Moana Blvd., Room 136, Honolulu, HI 96813-2498; Telephone No. 586-4700. Construction has to comply with State of Hawaii, Department of Health, Hawaii Administration Rule Title II, Chapter 46, Community Noise Control. This shall be considered incidental to the various contract items and will not be paid for separately.
8. The Contractor shall indemnify the state, and be solely responsible for the protection of adjacent properties, utilities, and existing structures from damages due to construction. Repairing any damage shall be at the Contractor's own expense, to the satisfaction of the Engineer.
9. Existing drainage system will be functional at all times during construction. The Contractor shall furnish materials, equipment, labor, tools and incidentals necessary to maintain flow. This work shall be considered incidental to any culvert work or the various contract items and will not be paid for separately.
10. Earth swale shall be graded to drain. This work shall be considered incidental to various contract items.
11. Smooth riding connections shall be constructed at all limits of project, including the beginning and end of project, connecting approaches, side streets, walkways and driveways as shown on the plans and/or as directed by the Engineer. This work shall be considered incidental to asphalt concrete and will not be paid separately.
12. The Contractor shall clean and remove any accumulation of aggregates along the roadside within 10-feet of the edge of pavement. This work shall be considered incidental to bulk of work or the various contract items and will not be paid for separately.
13. Removal and disposal of existing concrete curb and gutter, curb, sidewalk and asphalt concrete pavement, curb, sidewalk and any debris shall be considered incidental to their respective bid items.
14. All saw cutting work shall be considered incidental to the Building Structures and will not be paid for separately.
15. Prior to placement of new aggregate subbase course, the existing subbase shall be compacted to a relative compaction greater than or equal to 95%.
16. The top of the Plant Mix Glassphalt Concrete Base Course prior to placement of the new A.C. Pavement, Mix No. IV shall comply with the ten-foot straight edge requirement. The variation of the surface from a straight edge with two contacts with the surface, shall not exceed 3/16".
17. All curbing angle points within the curb ramps shall be rounded with R=6" unless otherwise noted.
18. The Contractor shall provide and maintain for access to and from all existing driveways, sidewalks and ADA access routes complying with ADAAG Chapter 4, and side streets and cross streets at all times. This work shall be considered incidental to Building Structures and will not be paid for separately.

19. No material and/or equipment shall be stockpiled or otherwise stored within the highway right-of-way except at locations designated in writing and approved by the Engineer. If use of location is approved by the Engineer, the Contractor shall obtain a permit to use the property within the highway right-of-way from the Oahu District Office at telephone no. 831-6712.

20. Coordinate work with the PE.

21. Hazmat: Refer to Specifications Sections 801 and 802.

SERVICES FOR SPECIAL INSPECTIONS

Contractor shall include in his base bid the service of certified special inspector(s) and monitoring work hired by the Contractor for air monitoring and record for removal and disposal of hazardous material abatement.

Contractor shall include in his base bid the notification and coordination of certified inspector(s) hired by the State for special inspection prior to the work.

Special inspection shall include but not limited to the followings:

1. Installation of reinforced steel bar and structural concrete and masonry work.
2. Concrete pavement slab and pavement reinforcing steel inspectors specified in Structural Notes 10A and B on plan sheet 46.
3. Welding and installation of structural steel work.
4. Installation of gypsum board and exterior finish system work.

CONCRETE FIELD TESTING AND LAB TESTING

Contractor shall conduct their own testing (Quality Control) for plastic and hardened concrete. Contractor shall provide Concrete Field Testing Technician - Grade 1 and obtain services from a accredited testing laboratory to test concrete and grout samples. Submit copy of certified test reports to the State.

DATE	_____
SURVEY PLOTTED BY	_____
DESIGNED BY	_____
NOTED BY	_____
CHECKED BY	_____
ORIGINAL PLAN	_____
NOTE BOOK	_____
No.	_____



SEPARATION DATE OF THE LICENSE 4/30/2016
THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION

6/1/2016	Revised Notes
DATE	REVISION
STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HIGHWAYS DIVISION	
GENERAL NOTES	
MOTOR VEHICLE SAFETY OFFICE RENOVATION Project No. HWY-0-02-08R	
Scale: As Noted	Date: April, 2016
SHEET No. 61/ OF 69 SHEETS	

WATER POLLUTION AND EROSION CONTROL NOTES:

FED. ROAD DIST. NO.	STATE	PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	HWY-0-02-08R	2016	3	69

A. GENERAL:

- See Special Provision Section 209 - Water Pollution and Erosion Control. Section 209 describes but is not limited to: submittal requirements; scheduling of a water pollution and erosion control conference with the Engineer; construction requirements; method of measurement; and basis of payment. In addition, Appendix A lists potential pollutant sources and corresponding BMPs used to mitigate the pollutants.
- Follow the guidelines in the current HDOT Construction Best Management Practices Field Manual in developing, installing and maintaining the Best Management Practices (BMP) for the project. For any conflicting requirements between the Manual and applicable bid documents, the applicable bid documents shall govern. Should a requirement not be clearly described within the applicable bid documents, the Contractor shall notify the Engineer immediately for interpretation. For the purposes of clarification under Note A.2, "applicable bid documents" include the construction plans, standard specifications, Special Provisions, Permits, and the Storm Water Pollution Prevention Plan (SWPPP) when applicable.
- Follow the guidelines in the Honolulu's City & County "Rules Relating to Soil Erosion Standards and Guidelines" along with applicable Soil Erosion Guidelines for projects on Maui, Molokai, Kauai, and Hawaii.
- The Engineer may assess liquidated damages of up to \$27,500 for non-compliance of each BMP requirement and each requirement stated in Section 209 and special provisions, for every day of non-compliance. There is no maximum limit on the amount assessed per day.
- The Engineer will deduct the cost from the progress payment for all citations received by the Department for non-compliance, or the Contractor shall reimburse the State for the full amount of the outstanding cost incurred by the State.
- If necessary, install a rain gage prior to any field work including the installation of any site-specific best management practices. The rain gage shall have a tolerance of at least 0.05 inches of rainfall. Install the rain gage on the project site in an area that will not deter rainfall from entering the gage opening. Do not install in a location where rain water may splash into rain gage. The rain gage installation shall be stable and plumbed. Do not begin field work until the rain gage is installed and site-specific best management practices are in-place.
- Submit Site-Specific BMP Plan to the Engineer along with a completed Site-Specific BMP Review Checklist within 30 calendar days of contract execution. The Site-Specific BMP Review Checklist may be obtained from <http://www.stormwaterhawaii.com>.

B. WASTE DISPOSAL:

- Waste Materials
Collect and store all waste materials in a securely lidded metal dumpster or roll off container with cover to keep rain out and prevent loss of waste during windy conditions. The dumpster shall meet all local and State solid waste management regulations. Deposit all trash and construction debris from the site in the dumpster. Empty the dumpster weekly or when the container is two-thirds full, whichever is sooner. Do not bury construction waste materials onsite. The Contractor's supervisory personnel shall be instructed regarding the correct procedure for waste disposal. Post notices stating these practices in the office trailer, on a weatherproof bulletin board, or other accessible location acceptable to the Engineer. The Contractor shall be responsible for seeing that these procedures are followed. Submit the Solid Waste Disclosure Form for Construction Sites to the Engineer within 30 calendar days of contract execution. Provide a copy of all the disposal receipts from the facility permitted by the Department of Health to receive solid waste to the Engineer monthly. This should also include documentation from any intermediary facility where solid waste is handled or processed.

- Hazardous Waste
Dispose all hazardous waste materials in the manner specified by local or State regulations and by the manufacturer. The Contractor's site personnel shall be instructed in these practices and shall be responsible for seeing that these practices are followed.
- Sanitary Waste
Collect all sanitary waste from the portable units a minimum of once per week, or as required. Position sanitary facilities where they are secure and will not be tipped over or knocked down.

C. EROSION AND SEDIMENT CONTROL INSPECTION AND MAINTENANCE PRACTICES:

- For projects with an NPDES Permit for Construction Activities, inspect at the following intervals. For construction areas discharging to nutrient or sediment impaired waters, inspect all control measures at least once each week and within 24 hours of any rainfall event of 0.25 inches or greater within a 24 hour period. For construction areas discharging to waters not impaired for nutrients or sediments, inspect all control measures weekly. Inspections are only required during the project's normal working hours. The discharge point water classification may be found in the SWPPP.
- For projects without an NPDES Permit for Construction Activities, inspect all control measures weekly.
- Maintain all erosion and sediment control measures in good working order. If repair is necessary, initiate repair immediately and complete by the close of the next work day if the problem does not require significant repair or replacement, or if the problem can be corrected through routine maintenance. When installation of a new erosion or sediment control or a significant repair is needed, install the new or modified control or complete the repair no later than 7 calendar days from the time of discovery. "Immediately" means the Contractor shall take all reasonable measures to minimize or prevent discharge of pollutants until a permanent solution is installed and made operational. If a problem is identified at a time in the day in which it is too late to initiate repair, initiation of repair shall begin on the following work day.
- Remove built-up sediment from silt fence when it has reached one-third the height of the fence. Remove sediment from other perimeter sediment control devices when it has reached one-half the height of the device.
- Inspect silt screen or fence for depth of sediment, tears, to verify that the fabric is securely attached to the fence posts or concrete slab and to verify that the fence posts are firmly in the ground. Inspect and verify the bottom of the silt screen is buried a minimum of 6 inches below the existing ground.
- Inspect temporary and permanent seeding and planting for bare spots, washouts and healthy growth.
- Complete and submit to the Engineer a maintenance inspection report within 24 hours after each inspection.
- Provide a stabilized construction entrance at all points of exit onto paved roads to reduce vehicle tracking of sediments. Include stabilized construction entrance in the Water Pollution, Dust, and Erosion Control submittals. Minimum length should be 50 feet. Minimum width should be 30 feet. Minimum depth should be 12 inches or as recommended by the soils engineer and underlain with geo-textile fabric. If minimum dimensions cannot be met, provide other stabilization techniques that remove sediment prior to exit. Clean the paved street adjacent to the site entrance daily or as required to remove any excess mud, cold-planed materials, dirt or rock tracked from the site. Do not hose down the street without containing or vacuuming wash water. Cover dump trucks hauling material from the construction site with a tarpaulin. Remove sediment tracked onto the street, sidewalk, or other paved area by the end of the day in which the track-out occurs.


- Include designated Concrete Washout Area(s) in the Water Pollution, Dust, and Erosion Control submittals.
- Submit the name of a specific individual designated responsible for inspections, maintenance and repair activities and filling out the inspection and maintenance report.
- Personnel selected for the inspection and maintenance responsibilities shall receive training from the Contractor. They shall be trained in all the inspection and maintenance practices necessary for keeping the erosion and sediment controls used onsite in good working order.
- Contain, remove, and dispose slurry generated from saw cutting of pavement and concrete in accordance with approved BMP practices. Do not allow discharge into the drainage system or State waters.

D. GOOD HOUSEKEEPING BEST MANAGEMENT PRACTICES:

- Materials Pollution Prevention Plan
 - Applicable materials or substances listed below are expected to be present onsite during construction. Other materials and substances not listed below shall be added to the inventory.

Concrete	Detergents
Paints (enamel and latex)	Metal Studs
Tar	Fertilizers
Petroleum Based Products	Cleaning Solvents
Wood	Masonry Block
Herbicides and Pesticides	Curing Compounds
Adhesives	
 - Use Material Management Practices to reduce the risk of spills or other accidental exposure of materials and substances to storm water runoff. Make an effort to store only enough product as is required to do the job.
 - Store all materials stored onsite in a neat, orderly manner in their appropriate containers and if possible under a roof or other enclosure.
 - Keep products in their original containers with the original manufacturer's label.
 - Do not mix substances with one another unless recommended by the manufacturer.
 - Whenever possible, use a product up completely before disposing of the container.
 - Follow manufacturer's recommendations for proper use and disposal.
 - Conduct a daily inspection to ensure proper use and disposal of materials onsite.

DATE	_____
SURVEY PLOTTED BY	_____
DESIGNED BY	_____
QUANTITIES BY	_____
CHECKED BY	_____
ORIGINAL PLAN	_____
NOTE BOOK	_____
No.	_____

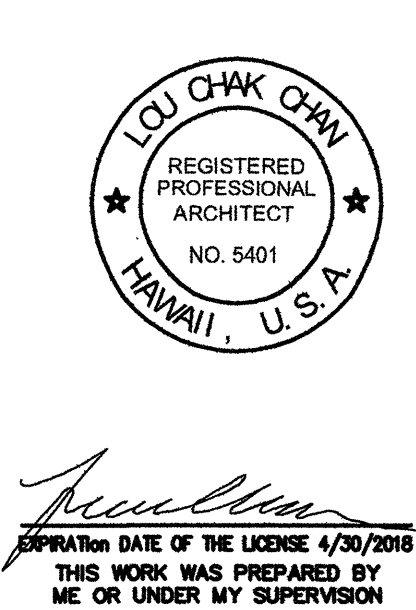

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

WATER POLLUTION AND EROSION CONTROL NOTES
MOTOR VEHICLE SAFETY OFFICE
RENOVATION
Project No. HWY-0-02-08R
Scale: As Noted Date: April, 2016

SHEET No. 612 OF 69 SHEETS

WATER POLLUTION AND EROSION CONTROL NOTES: CONT.

FED. ROAD DIST. NO.	STATE	PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	HWY-0-02-08R	2016	4	69

2. Hazardous Material Pollution Prevention Plan

- Keep products in original containers unless they are not resealable.
- Retain original labels and Safety Data Sheets (SDS) formerly Material Safety Data Sheets (MSDS).
- Dispose of surplus products according to manufacturers' instructions and local and State regulations.

3. Onsite and Offsite Product Specific Plan

The following product specific practices shall be followed onsite:

- Petroleum Based Products:**
Monitor all onsite vehicles for leaks and perform regular preventive maintenance to reduce the chance of leakage. Store petroleum products in tightly sealed containers which are clearly labeled. Apply asphalt substances used onsite according to the manufacturer's recommendation.
- Fertilizers:**
Apply fertilizers used only in the minimum amounts recommended by the manufacturer and federal, state, and local requirements. Avoid applying just before a heavy rain event. Apply at the appropriate time of year for the location, and preferably timed to coincide as closely as possible to the period of maximum vegetation uptake and growth. Once applied, work fertilizer into the soil to limit exposure to storm water. Do not apply to storm conveyance channels with flowing water. Storage shall be in a covered shed or in an area where fertilizer will not come into contact with precipitation or stormwater. Transfer the contents of any partially used bags of fertilizer to a sealable plastic bin to avoid spills.
- Paints:**
Seal and store all containers when not required for use. Do not discharge excess paint to the drainage system, sanitary sewer system, or State waters. Dispose properly according to manufacturers' instructions and State and local regulations.
- Concrete Trucks:**
Washout or discharge concrete truck drum wash water only at a designated site as far as practicable from storm drain inlets or State waters. Do not discharge water in the drainage system or State waters. Disposal by percolation is prohibited. Clean disposal site as required or as requested by the Engineer.

4. Spill Control Plan

- Post a spill prevention plan to include measures to prevent and clean up each spill.
- The Contractor shall be the spill prevention and cleanup coordinator. Designate at least three site personnel who shall receive spill prevention and cleanup training. These individuals shall each become responsible for a particular phase of prevention and cleanup. Post the names of responsible spill personnel in the material storage area on a weatherproof bulletin board or other accessible location acceptable to the Engineer and in the office trailer onsite.
- Clearly post manufacturers' recommended methods for spill cleanup. Make site personnel aware of the procedures and the location of the information and cleanup supplies.
- Keep ample materials and equipment necessary for spill cleanup in the material storage area onsite.
- Clean up all spills immediately after discovery.

- Keep the spill area well ventilated. Personnel shall wear appropriate protective clothing to prevent injury from contact with a hazardous substance.
- Report spills of toxic hazardous material to the appropriate State or local government agency, regardless of the size. Where a leak, spill, or other release containing a hazardous substance or oil in an amount equal to or in excess of a reportable quantity established under either 40 CFR Part 110, 40 CFR Part 117, or 40 CFR Part 302 occurs during a 24-hour period, the Contractor shall notify the Engineer as soon as the Contractor has knowledge of the discharge. The Engineer will notify the National Response Center (NRC) at (800) 424-8802, the Clean Water Branch during regular business hours at 586-4309, and the Hawaii State Hospital Operator at 247-2191 and the Clean Water Branch (DOH-CWB) via email at cleanwaterbranch@doh.hawaii.gov during non-business hours immediately. The Contractor shall also provide to the Engineer, within 7 calendar days of knowledge of the release, a description of the release, the circumstances leading to the release, and the date of the release. The Engineer will provide this information to the DOH-CWB. The Engineer will provide information to the NRC if requested.

E. PERMIT REQUIREMENTS:

- The calculated land disturbance area for this project based on the construction plans is 0.25 acres not including Contractor Staging and Storage areas. If the total of the disturbed area and the Contractor Staging and Storage area is one acre or greater, the Contractor shall obtain the NPDES Construction Activities Permit using HDOT's latest SWPPP template. See Hawaii Administrative Rules Chapter 11-55, Appendix C for the definition of land disturbance. The Contractor shall be responsible for obtaining the required NPDES Construction Activities Permit and complying with the requirements of HAR 11-55 including but not limited to:
 - Deadlines for initiating and completing initial stabilization
 - Increased inspection frequency and installation of rain gage if applicable
 - Deadlines to initiate and complete repairs to BMPs
 - Reporting requirements and corrective action reports

F. SITE-SPECIFIC BMP REQUIREMENTS

Each BMP below is referenced to the corresponding section of the current HDOT Construction Best Management Practices Field Manual and appropriate Supplemental Sheets. The Manual may be obtained from the HDOT Statewide Stormwater Management Program Website at <http://www.stormwaterhawaii.com/resources> under Construction Best Management Practices Field Manual. Supplemental BMP sheets are located at http://stormwaterhawaii.com/contractors/contractors_BMPmanual.aspx under Concrete Curing and Irrigation Water.

The requirements for Water Pollution, Dust, and Erosion Control submittals are included in Section 209 of the Hawaii Standard Specifications for Road and Bridge Construction dated 2005 and applicable Special Provisions. A list of pollutant sources and corresponding BMP used to mitigate the pollutants are included in Section 209 of the Special Provisions under Appendix A.

Follow the requirements below:

- Protect all Drainage Inlets receiving runoff from disturbed areas (SC-2).
- Contain on-site runoff using Perimeter Sediment Controls
 - SC-1 Silt Fence
 - SC-5 Vegetated Filter Strips and Buffers
 - SC-8 Compost Filter Berm
 - SC-13 Sandbag Barrier
 - SC-14 Brush or Rock Filter

- Control offsite runoff from entering construction area
 - EC-8 Run-On Diversion
 - SC-6 Earth Dike
 - SC-7 Temporary Drains and Swales

4. Incorporate applicable Site Management BMP

- SM-1 Employee Training
- SM-2 Material Delivery and Storage
- SM-3 Material Use
- SM-4 Protection of Stockpiles
- SM-6 Solid Waste Management
- SM-7 Sanitary/Septic Waste Management
- SM-9 Hazardous Waste Management
- SM-10 Spill Prevention and Control
- SM-11 Vehicle and Equipment Cleaning
- SM-12 Vehicle and Equipment Maintenance
- SM-13 Vehicle and Equipment Refueling
- SM-14 Scheduling
- SM-15 Location of Potential Sources of Sediment
- SM-16 Preservation of Existing Vegetation
- SM-18 Dust Control

- Contain pollutants within the Construction Staging/Storage Area BMP with applicable Perimeter Sediment Controls and Site Management BMP. Include a Stabilized Construction Entrance/Exit (EC-2) for all areas which exit onto a paved street. Restrict vehicle access to these points.
- Manage Concrete Waste including installing a Concrete Washout Area (SM-5) and properly disposing of Concrete Curing Water (California Stormwater BMP Handbook NS-12 Concrete Curing).
- Remove saw cut slurry and hydrodemolition water from the site by vacuuming. Provide storm drain protection and/or perimeter sediment controls during saw cutting and hydrodemolition work.

SURVEY PLOTTED BY	DATE
DESIGNED BY	
TRACED BY	
DESIGNED BY	
QUANTITIES BY	
CHECKED BY	
ORIGINAL PLAN	
NOTE BOOK	
NO.	



THIS WORK WAS PREPARED BY
ME OR UNDER MY SUPERVISION

STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HIGHWAYS DIVISION	
WATER POLLUTION AND EROSION CONTROL NOTES	
MOTOR VEHICLE SAFETY OFFICE RENOVATION	
Project No. HWY-0-02-08R	
Scale: As Noted	Date: April, 2016

SHEET No. 613 OF 69 SHEETS

FED. ROAD DIST. NO.	STATE	PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	HWY-0-02-08R	2016	5	69

TEMPORARY UTILITY INSTALLATION
REQUIREMENTS:

- A. General: Engage appropriate local utility company to install temporary service or connect to existing service where directed by the engineer. Where utility company provides only part of the service, provide the remainder with matching, compatible materials and equipment. Comply with utility company recommendations.
1. Arrange with utility company, the department, and existing users for time when service can be interrupted, if necessary, to make connections for temporary services.
2. Provide adequate capacity at each stage of construction. before temporary utility is available, provide trucked in services.
- B. Utility service costs during construction: the contractor shall be responsible for paying the costs for electric, water, and sewer utility services from the project's construction notice to proceed date through the project acceptance date. In lieu of arranging with the utility company, for the metering of the contractor's usage of utility services, etc. as noted in the following paragraphs of this section, the contractor may choose to pay the state's electric, water, and sewer utility bills for the facility during the period from construction notice to proceed date through the project acceptance date.
- C. Water Service: Make arrangements with the utility company for temporary use of water, and pay for all expenses. However, at the option of the contractor, a temporary tap into the facility's existing water system is allowed, subject to the following conditions:
1. Comply with the department of health's and county water provider's requirements when tapping into the existing water system.
2. Meter the tapped line and prior to water use, notify the engineer to observe an initial meter reading.
3. Take monthly meter readings. pay the state, on a monthly basis, for water used at the current rate per 1,000 gallons.
4. Payments are to be by check, made payable to the "Director Of Finance, State Of Hawaii" and mailed as directed by the Engineer.
5. Checks shall be accompanied by the following information:
- i. Name of facility, project name and title and job no.
- ii. Contractor's name.
- iii. Initial meter reading for the month and final meter reading for the month.
- iv. Volume of water used and the amount due in payment for that water.
6. Upon completion of the project and just prior to removal of the water meter, notify the Engineer to observe a final meter reading.
7. Should the contractor at any time fail to comply with any or all of the above conditions, the department may terminate the use of water. The contractor shall remove the hookup within 48 hours of notification of such termination.
- D. Electric Power Service: Provide weatherproof, grounded electric power service and distribution system of sufficient size, capacity, and power characteristics during construction period. Include meters, transformers, overload protected disconnecting means, automatic ground fault interrupters, and main distribution switchgear. Make arrangements with utility companies for temporary use of electricity for construction use. Pay for all expenses pertaining thereto. However, at the option of the contractor, use of State facilities electrical power services will be permitted as long as equipment is maintained in a condition acceptable to the Engineer and a submeter is installed.
- E. Electric Distribution: Provide receptacle outlets adequate for connection of power tools and equipment. Protect wiring, in conduits or other measures when exposed to possible damage or traffic areas.
- F. Temporary utilities shall be considered incidental to the various contract items and will not be paid for separately. The Contractor shall be held liable for any damages incurred to the existing facilities and/or improvements as a result of his operations.

ZONING PROJECT DATA:


Zoning: R-5 Residential District
TMK: 9-8-026.064, 060
Lot Size: 52,568.00 sf
Proposed Use: Public Use (Office)

Maximum Building Area @ 50% = 26,284.00 sf
Total Building Area = 7,604.00 sf

Existing Total Floor Area = 7,604.00 sf

No. of Required Stalls: $7,604 \div 400 = 19.01$
Parking Required: 19
Parking Provided: 35
Loading Required: 0
Loading Provided: 0

C. Office, Under 20,000 sf:
No Loading Stall Required

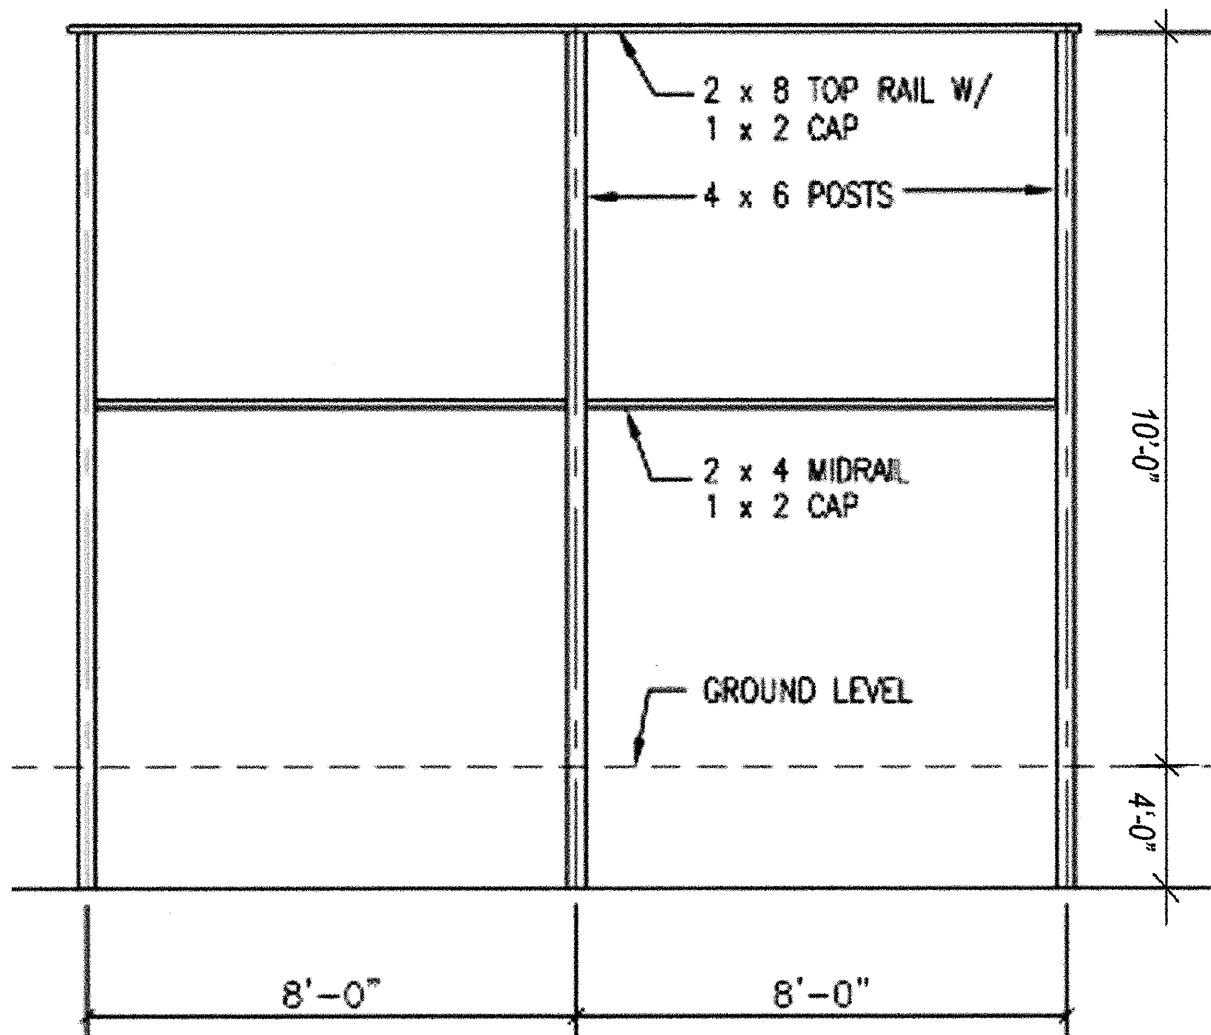


ELEVATION

NOTES:


1. CLOTH BARRIER NOT SHOWN IN FRONT VIEW.
2. CLOTH BARRIER TO BE "GEOTEXTILE" OR "NURSERY SHADE".
3. LUMBER SIZES ARE NOMINAL INCHES.
4. AS SHOWN CLOTH TO BE BURIED AT BASE TO INDICATED DIMENSION.
5. 1 x 2 CLOTH BARRIER CAPS TO BE NAILED @ 12" OC.
6. BURLAP IS NOT ACCEPTABLE AS THE CLOTH BARRIER.
7. CLOTH TO HAVE NO HORIZONTAL SEAMS.
8. VERTICAL SEAMS TO BE MADE OVER UPRIGHTS ONLY.
9. ALL SEAMS TO BE CAPPED WITH MINIMUM 1 x 2.
10. ALL JOINTS TO BE SECURELY FASTENED BY MECHANICAL MEANS.

DUST CONTROL FENCE

Not To Scale

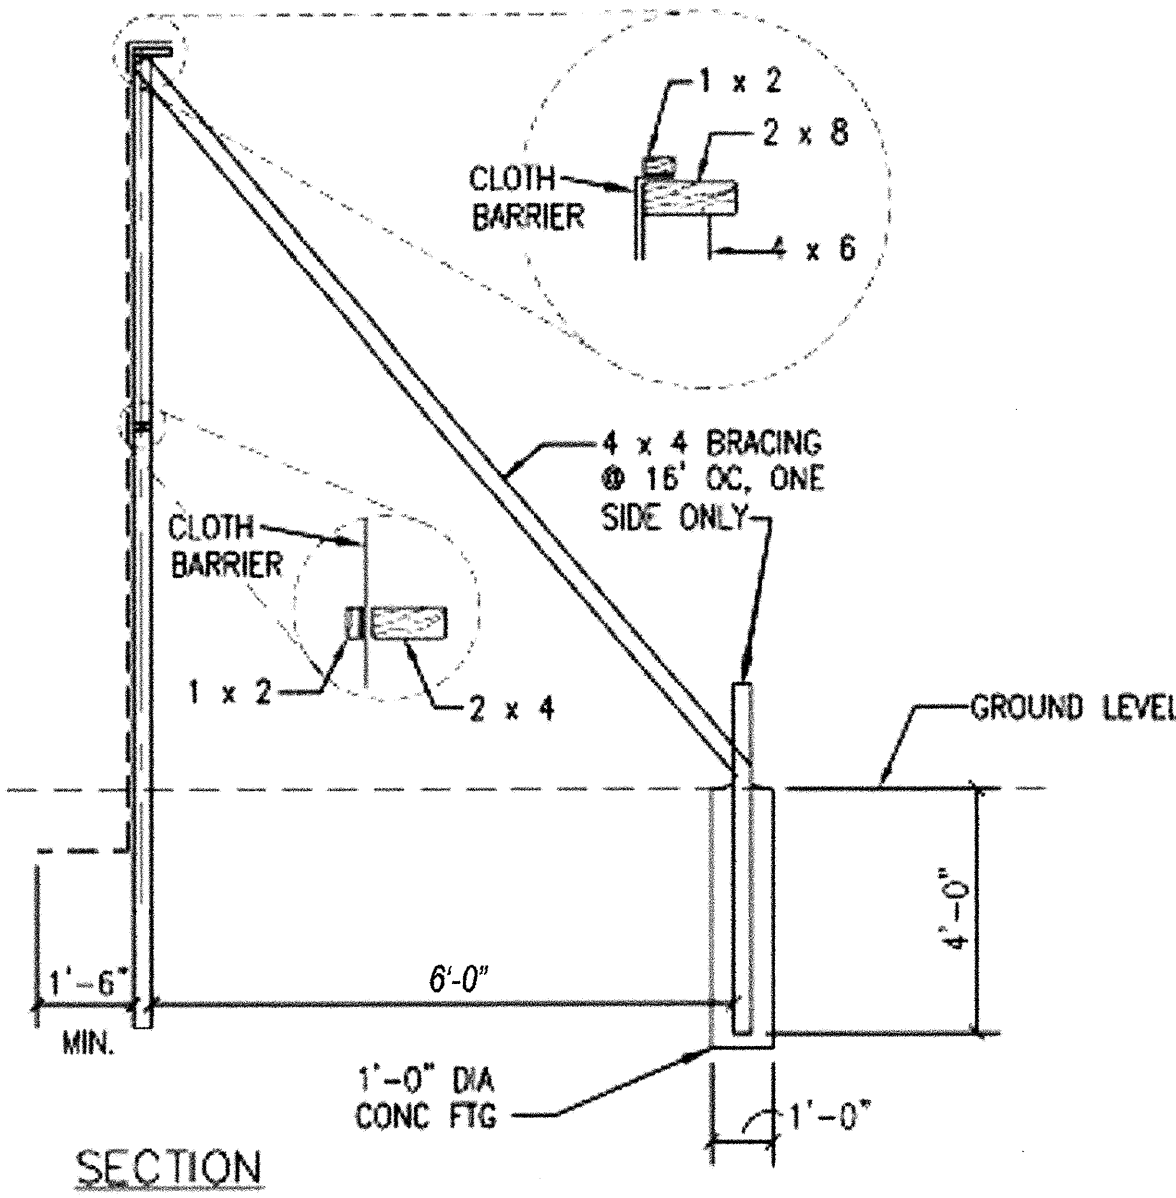

SECTION



SEAL OF THE ENGINEER
LOU O'AK OHM
REGISTERED PROFESSIONAL ARCHITECT
NO. 5401
HAWAII, U.S.A.

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

**TEMP. UTILITY INSTALL. REQ.
AND SITE PLAN**

**MOTOR VEHICLE SAFETY OFFICE
RENOVATION**

Project No. HWY-0-02-08R
Scale: As Noted Date: April, 2016

SHEET No. 69 OF 69 SHEETS