


FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW	5230(2)	1950	10	26

GENERAL NOTES

Cables shall extend at least 24" clear of curb or edge of pavement or sidewalk.

See Sheet No. 5440.12 for Lighting Standard, Pole Bracket and Regulator Platform Details.

Concrete Bases for Monotube Lighting Standard shall be Class "B-1" Concrete and shall be paid for under the item of "Bases for Light Standards."

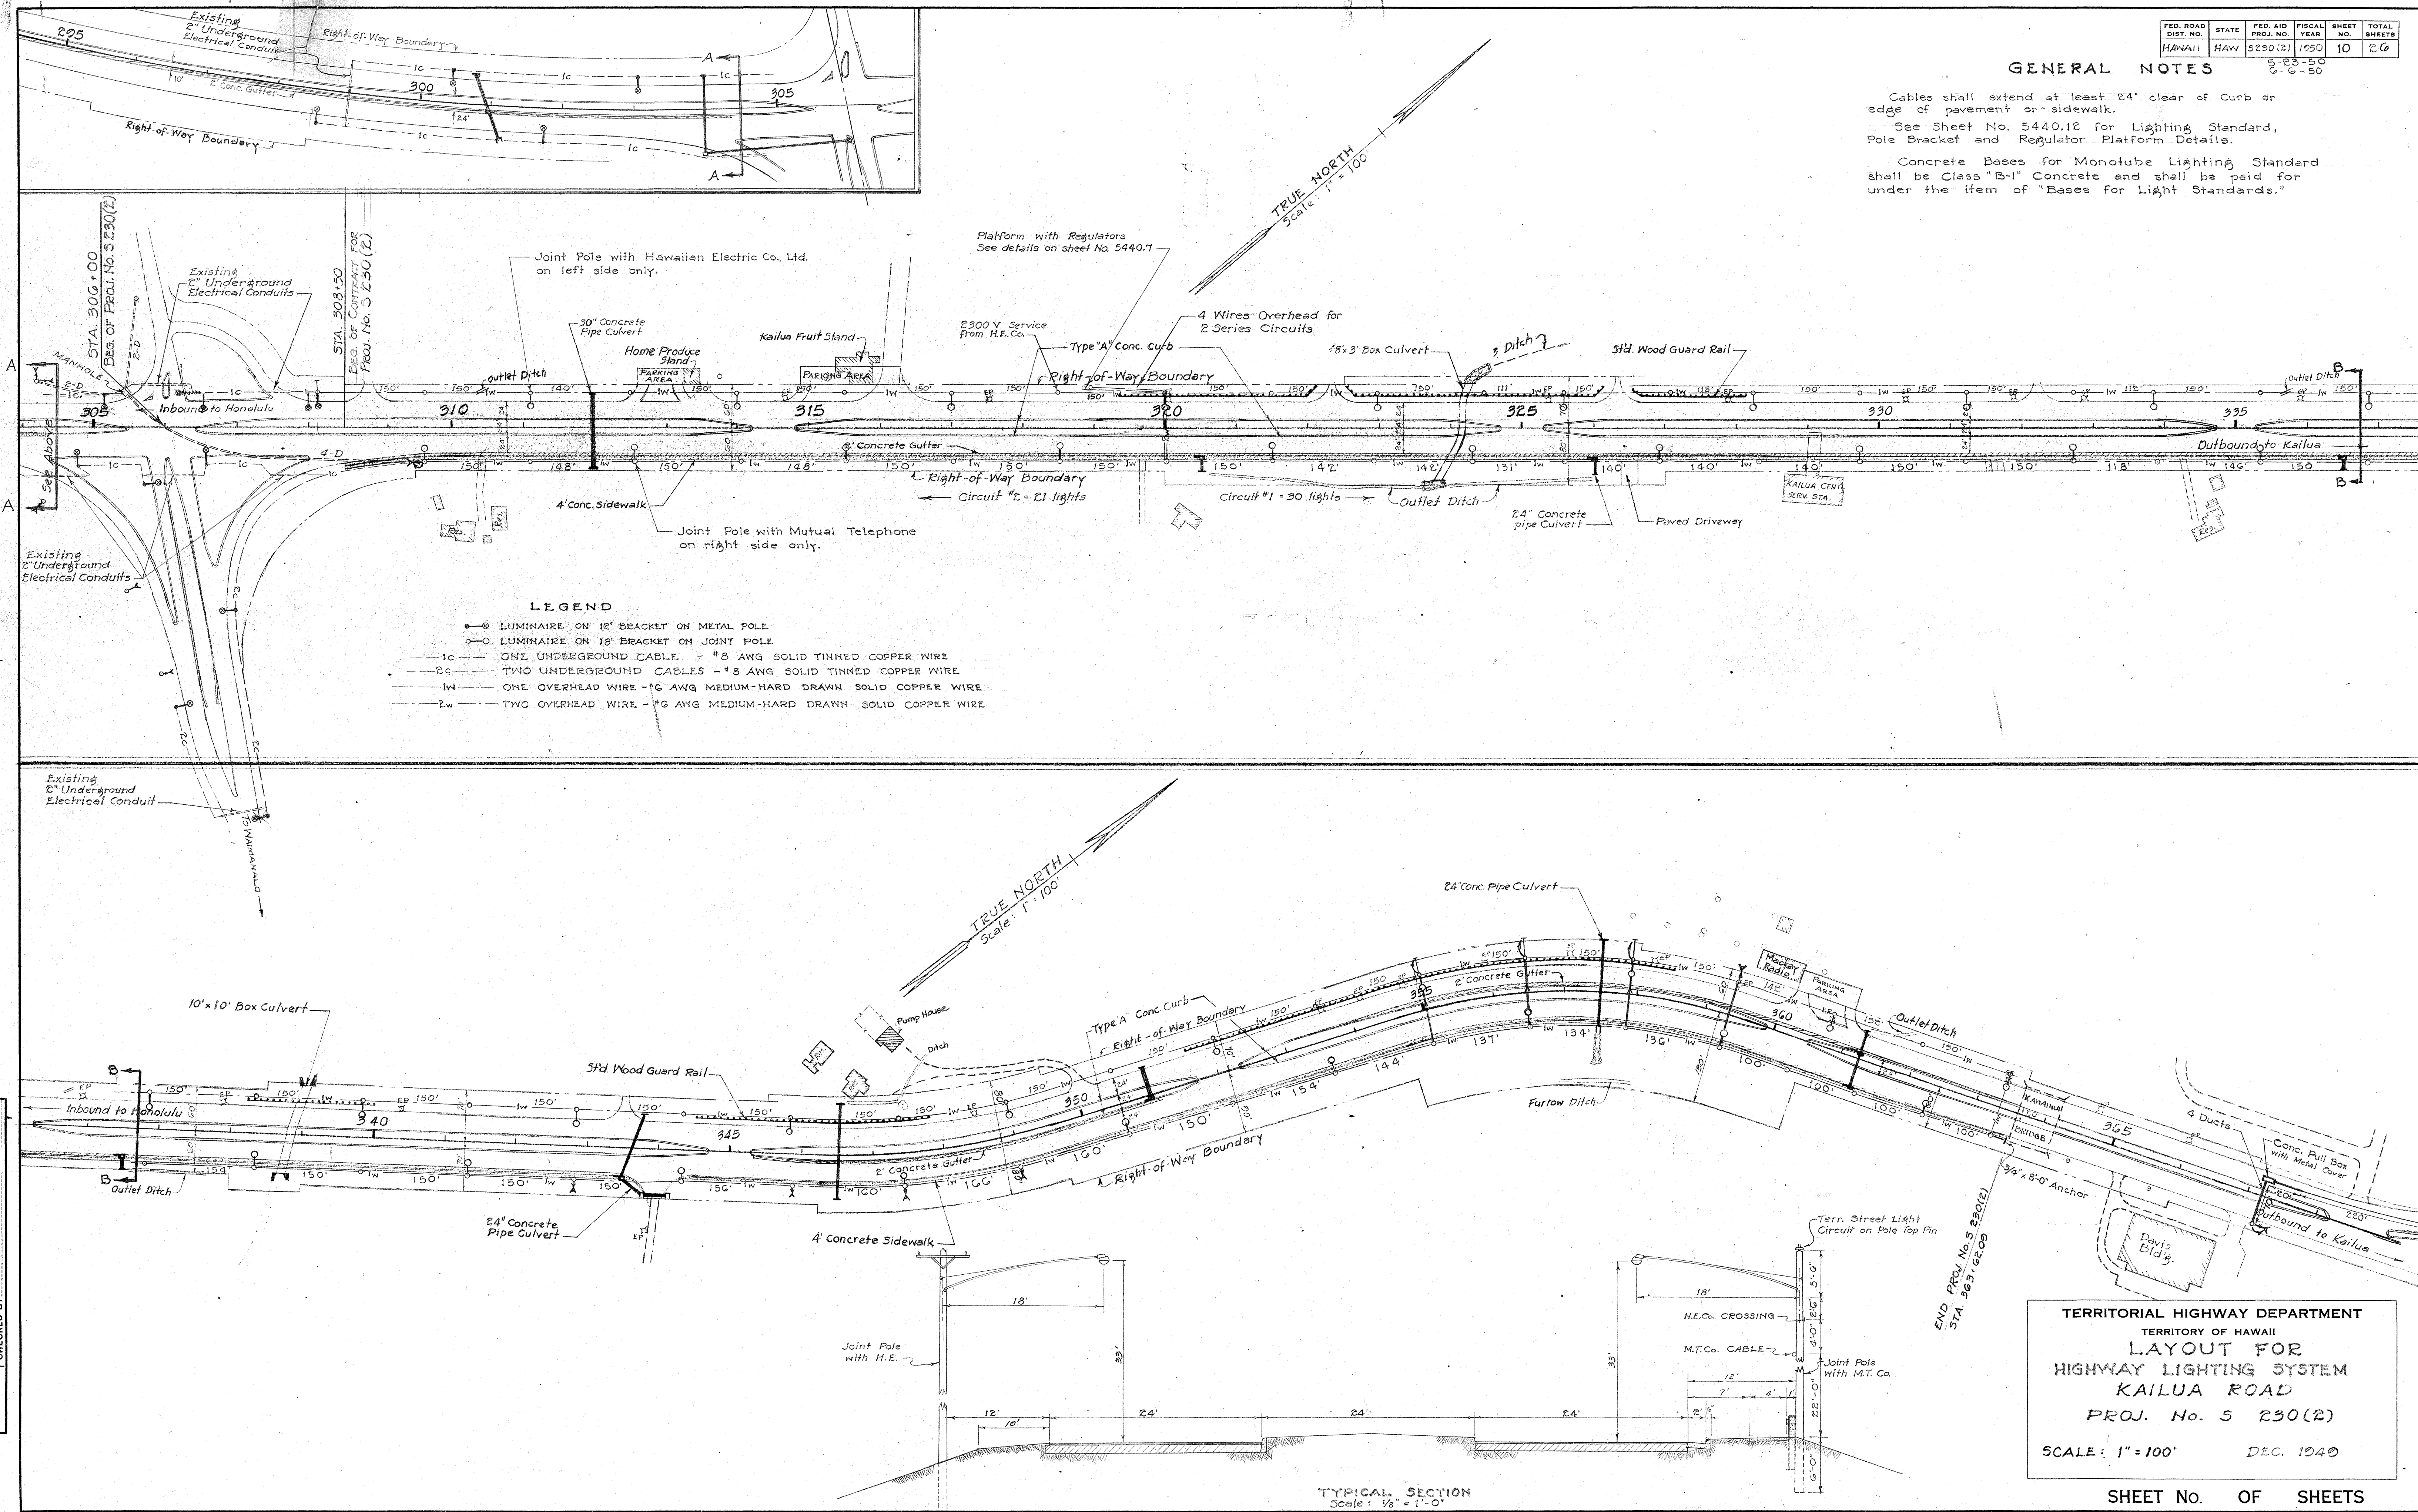

- LEGEND**
- LUMINAIRE ON 12" BRACKET ON METAL POLE
 - LUMINAIRE ON 18" BRACKET ON JOINT POLE
 - 1c ONE UNDERGROUND CABLE - #8 AWG SOLID TINNED COPPER WIRE
 - 2c TWO UNDERGROUND CABLES - #8 AWG SOLID TINNED COPPER WIRE
 - 1w ONE OVERHEAD WIRE - #6 AWG MEDIUM-HARD DRAWN SOLID COPPER WIRE
 - 2w TWO OVERHEAD WIRE - #6 AWG MEDIUM-HARD DRAWN SOLID COPPER WIRE

DATE	
SURVEY PLOTTED BY	
DESIGNED BY	
TRACED BY	
QUANTITIES BY	
NOTES BY	
CHECKED BY	
ORIGINAL PLAN	
NOTE BOOK	
No.	

TERRITORIAL HIGHWAY DEPARTMENT
TERRITORY OF HAWAII
LAYOUT FOR
HIGHWAY LIGHTING SYSTEM
KAILUA ROAD
PROJ. No. 5 230(2)
SCALE: 1" = 100' DEC. 1949

SHEET No. OF SHEETS

5440.10