



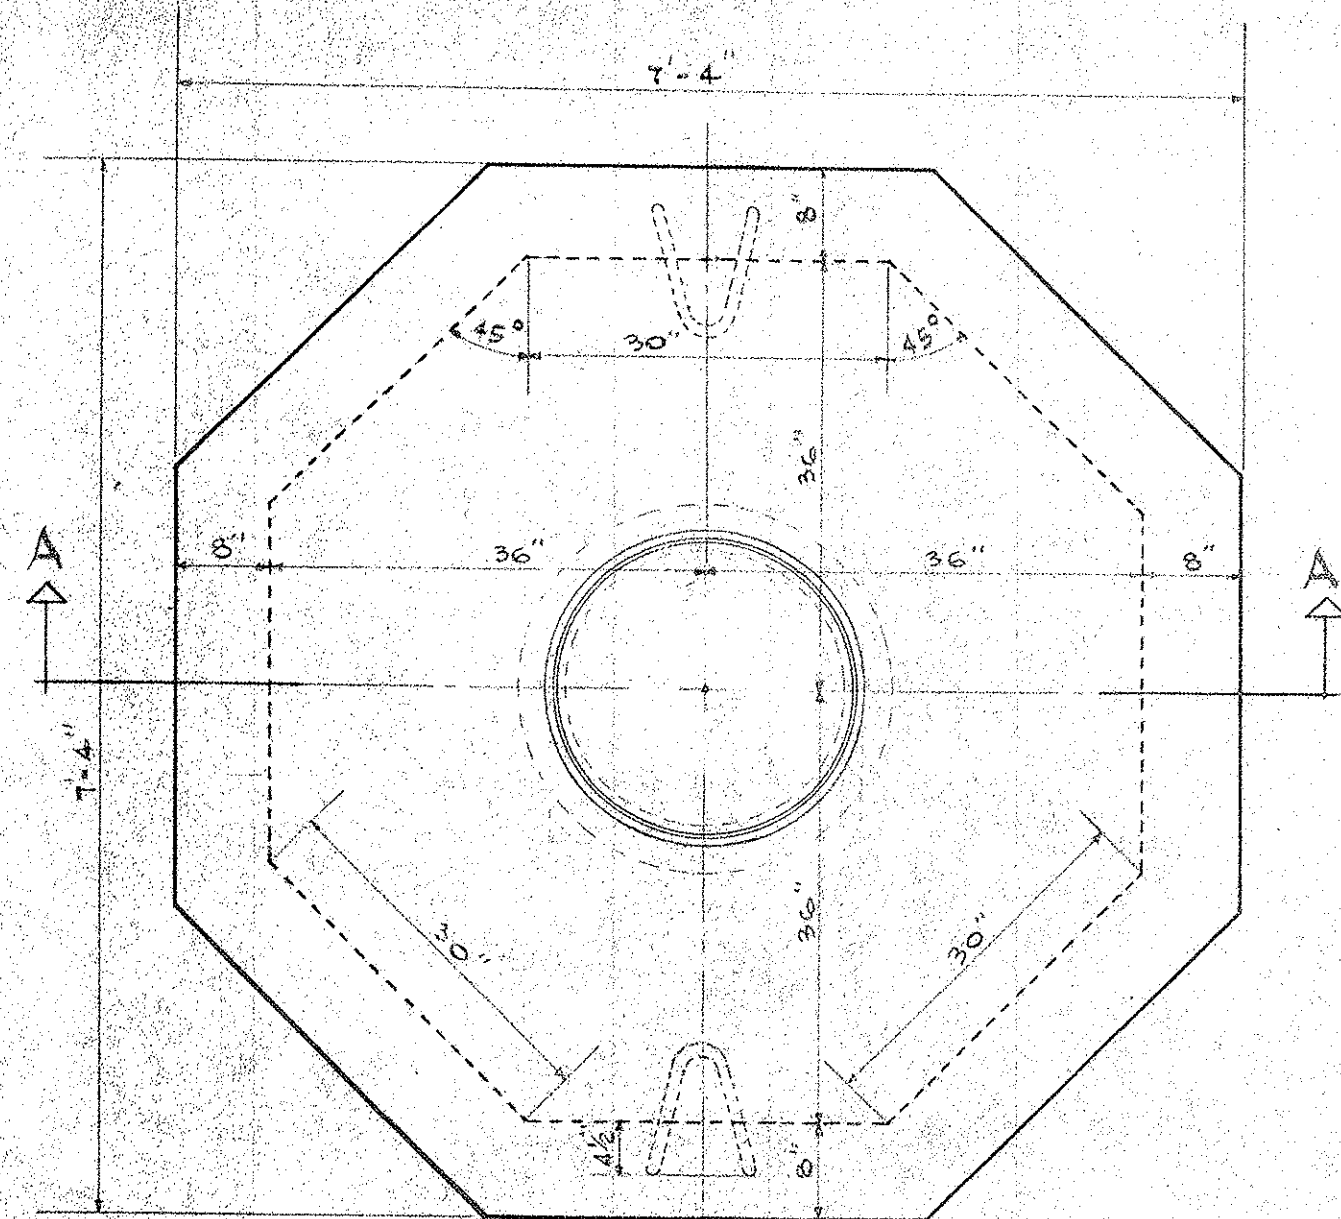


PLAN

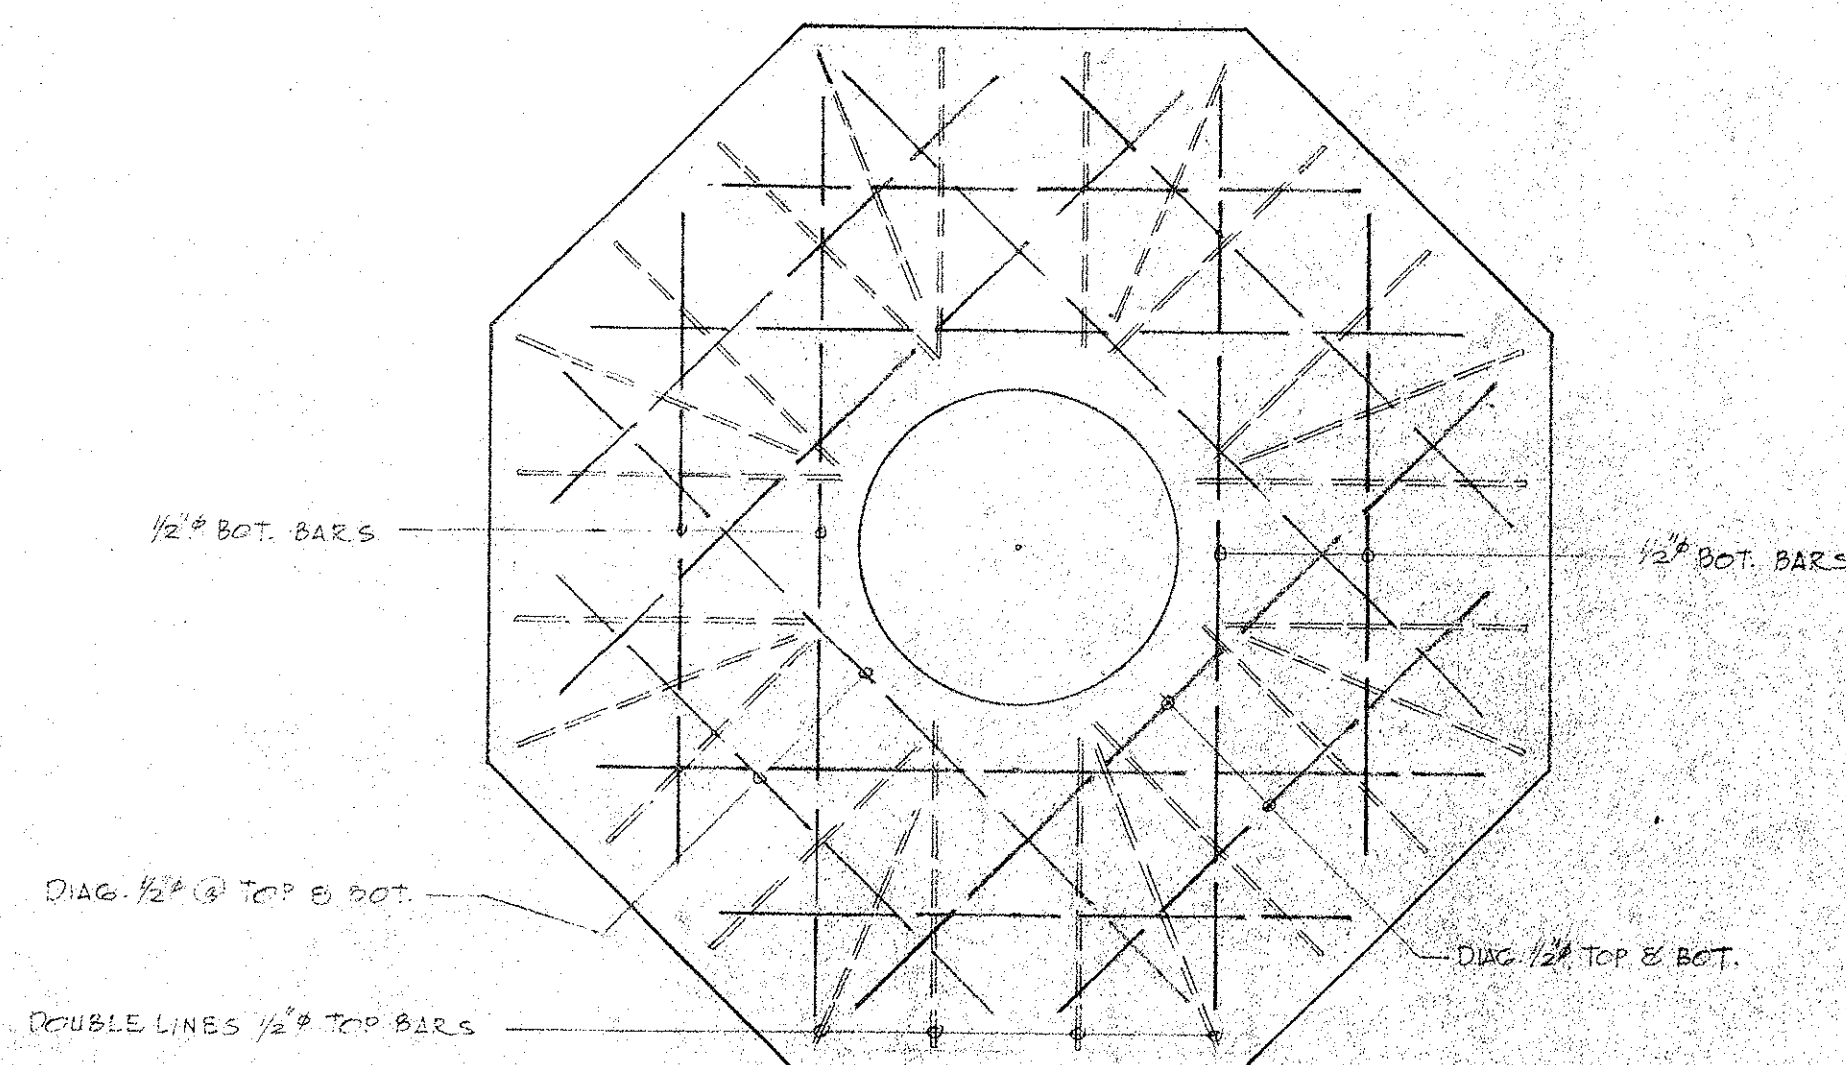


REINFORCING OF TOP SLAB

SCALE: 3/4" = 1'-0"

NOTES:
CABLE RACKS SHALL BE INSTALLED ON MANHOLE WALLS TO WITHIN 12 INCHES OF THE BOTTOM AND BE SO SPACED THAT CABLES ARE SUPPORTED APPROX. EVERY 18 INCHES.
PULL IN IRON TO BE INSTALLED OPPOSITE EACH ENTERING DUCT FACE.

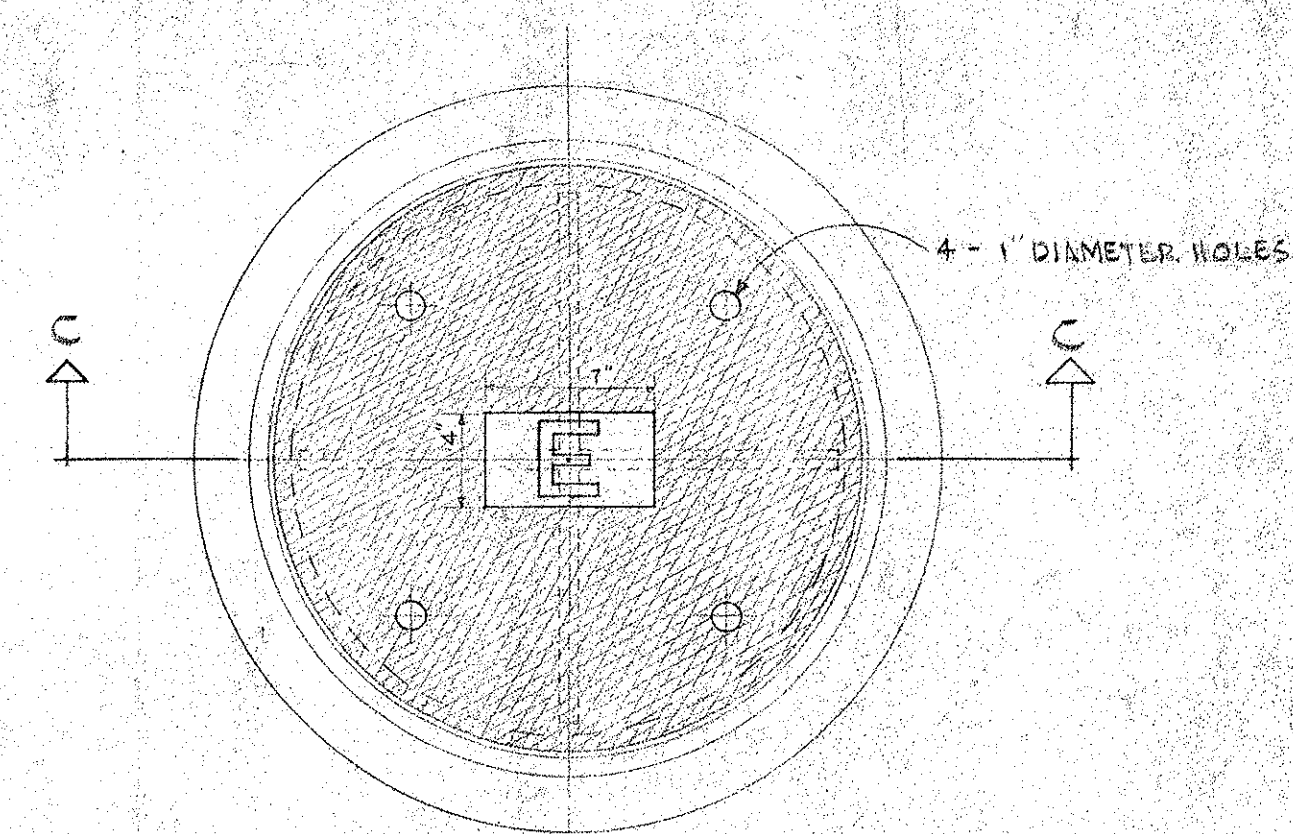


PLAN

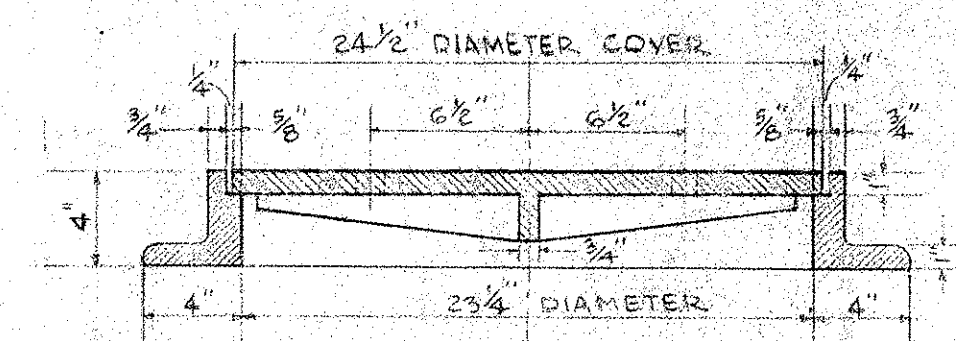

SECTION C-C

DETAIL OF MANHOLE FRAME & COVER


SCALE: 1/2" = 1'-0"

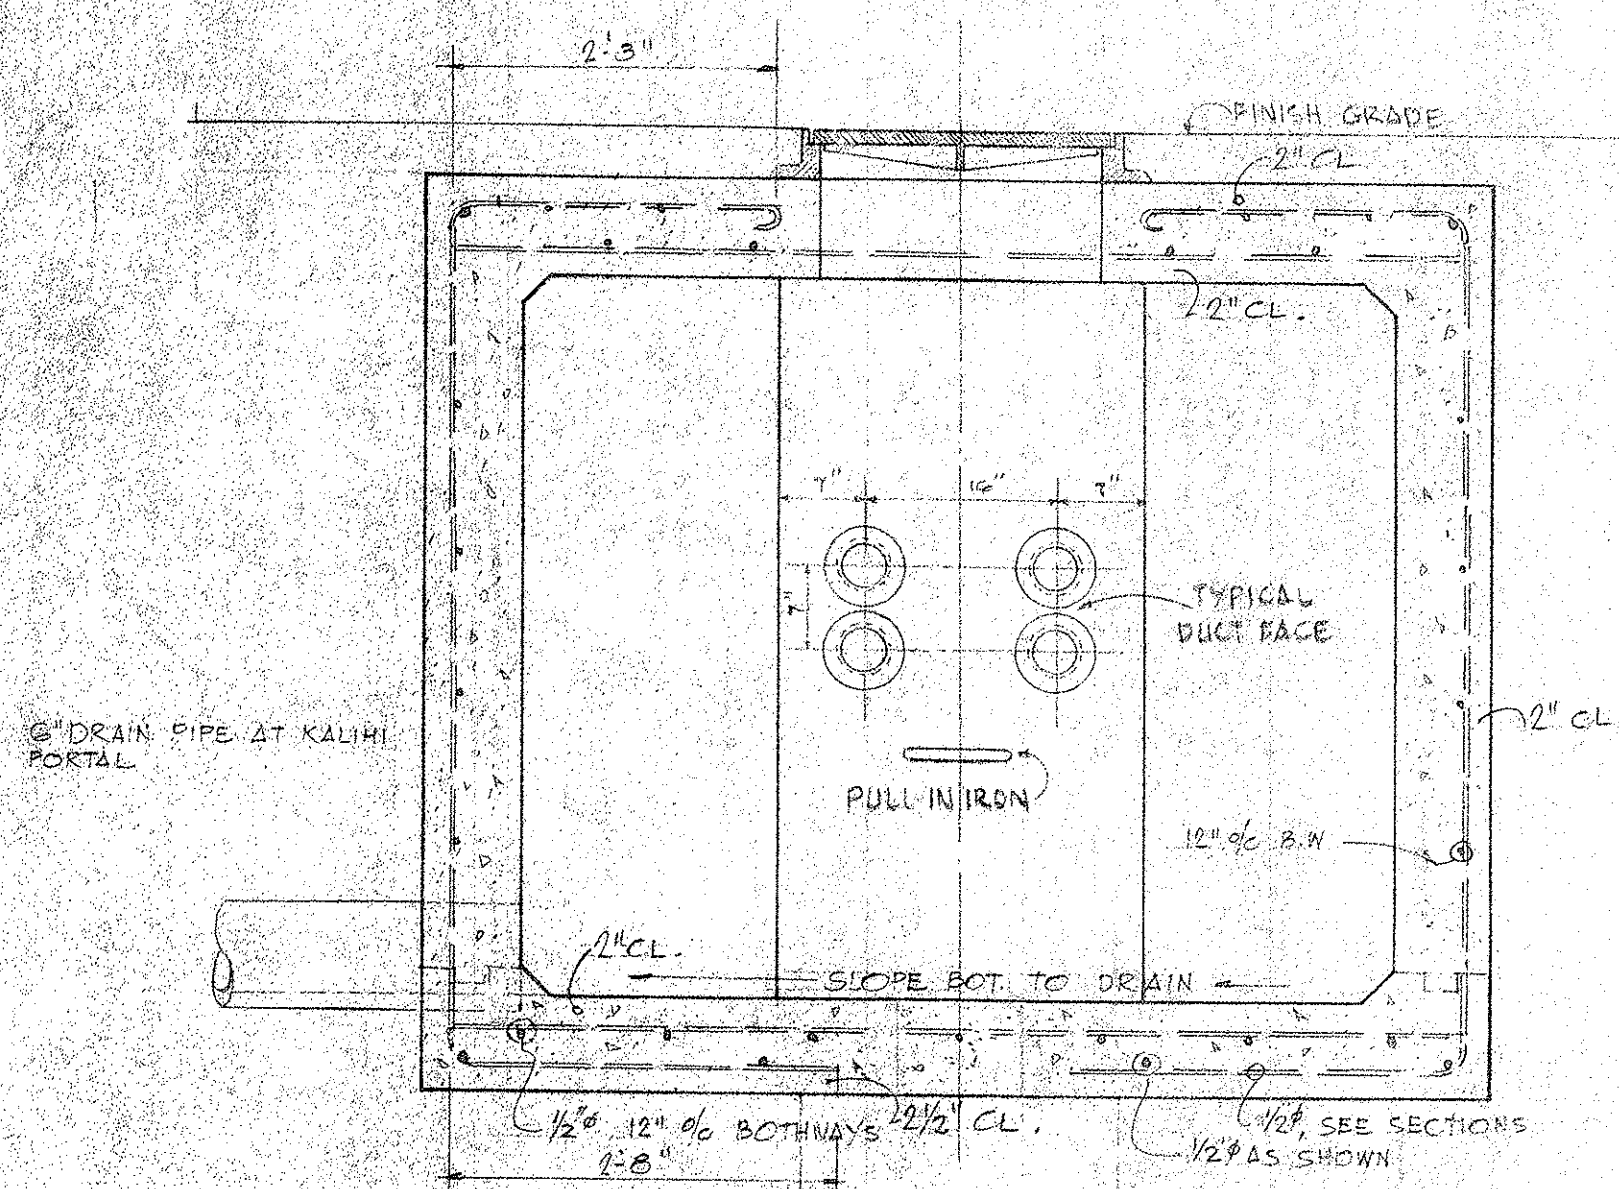

SECTION A-A


MANHOLE DETAILS

SCALE: 3/4" = 1'-0"

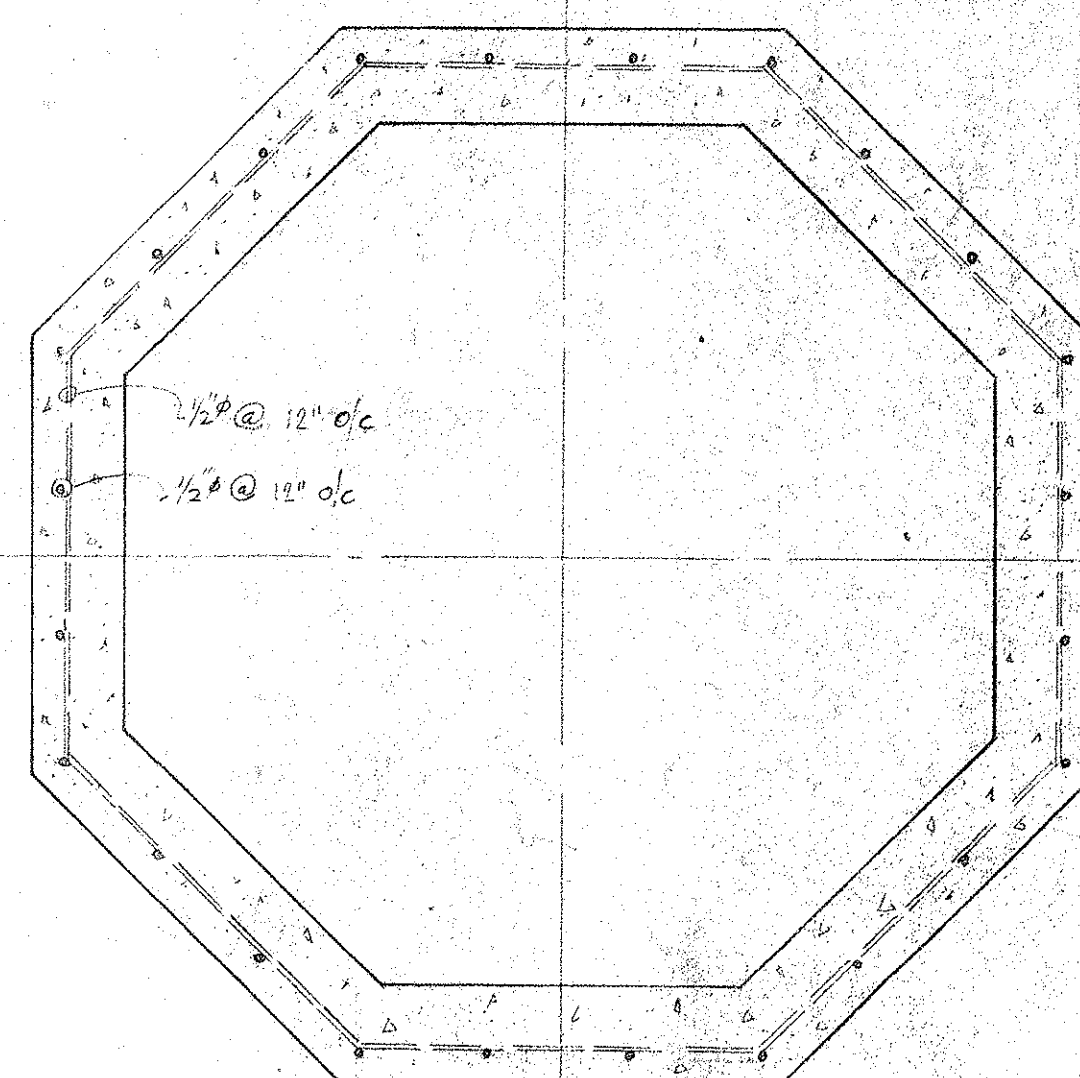

REINFORCING OF SECTION UNDER TOP

SCALE: 3/4" = 1'-0"

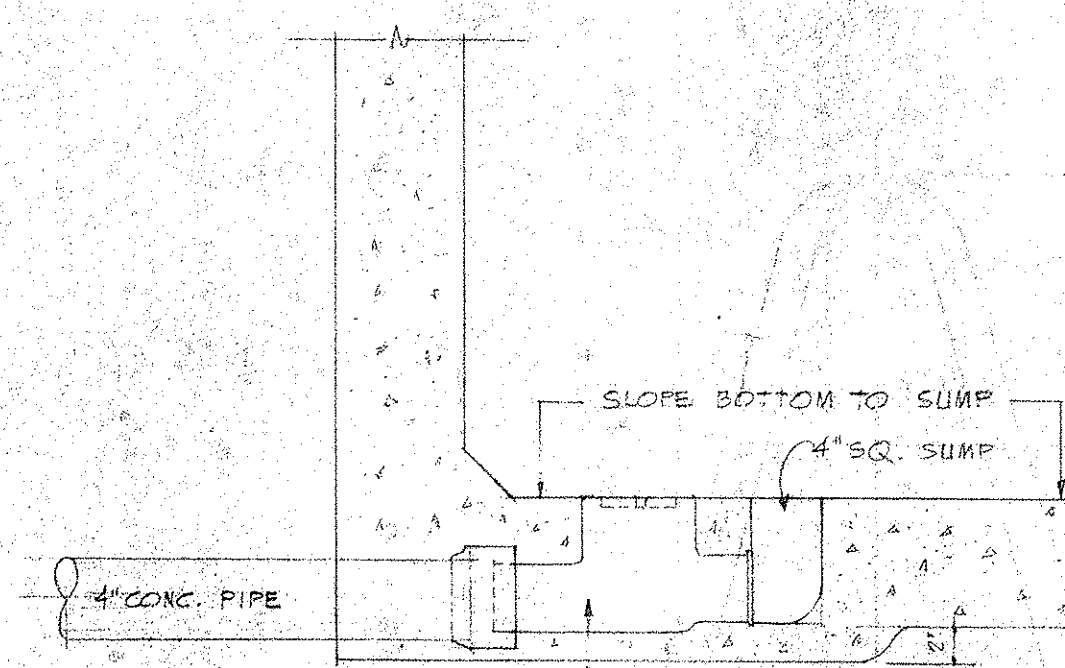

BACKWATER VALVE REQD AT BOTH KALIHI & KANEHOE E.M.H.

DETAIL: BACKWATER VALVE

SCALE: 1" = 1'-0"

NOTE:
FOR LOCATION & DEPTH OF E.M.H. SEE DWG. P-24, P-53 & VB-1
FOR DETAIL OF PULL IN IRON, SEE DWG. THIS

LAW & WILSON ARCHITECTS & ENGINEERS	
DEPARTMENT OF PUBLIC WORKS CITY AND COUNTY OF HONOLULU	
BUREAU OF PLANS	
KALIHI TUNNEL	
KALIHI PORTAL	
ELECTRICAL MANHOLE DETAILS	
ENGINEER: L.B.W.	DATE: JULY 15, 1955
DRAFTSMAN: S.H. PANG	CHECKED BY: <i>[Signature]</i>
SCALE: AS NOTED	TRACER: <i>[Signature]</i>
APPROVED: <i>[Signature]</i> CHIEF ENGINEER	APPROVED: <i>[Signature]</i> BUREAU ENGINEER

APPROVED: <i>[Signature]</i> ENGINEER KALIHI TUNNEL
--

SECTION C JOB NO. 26-53 DWG. P-26