




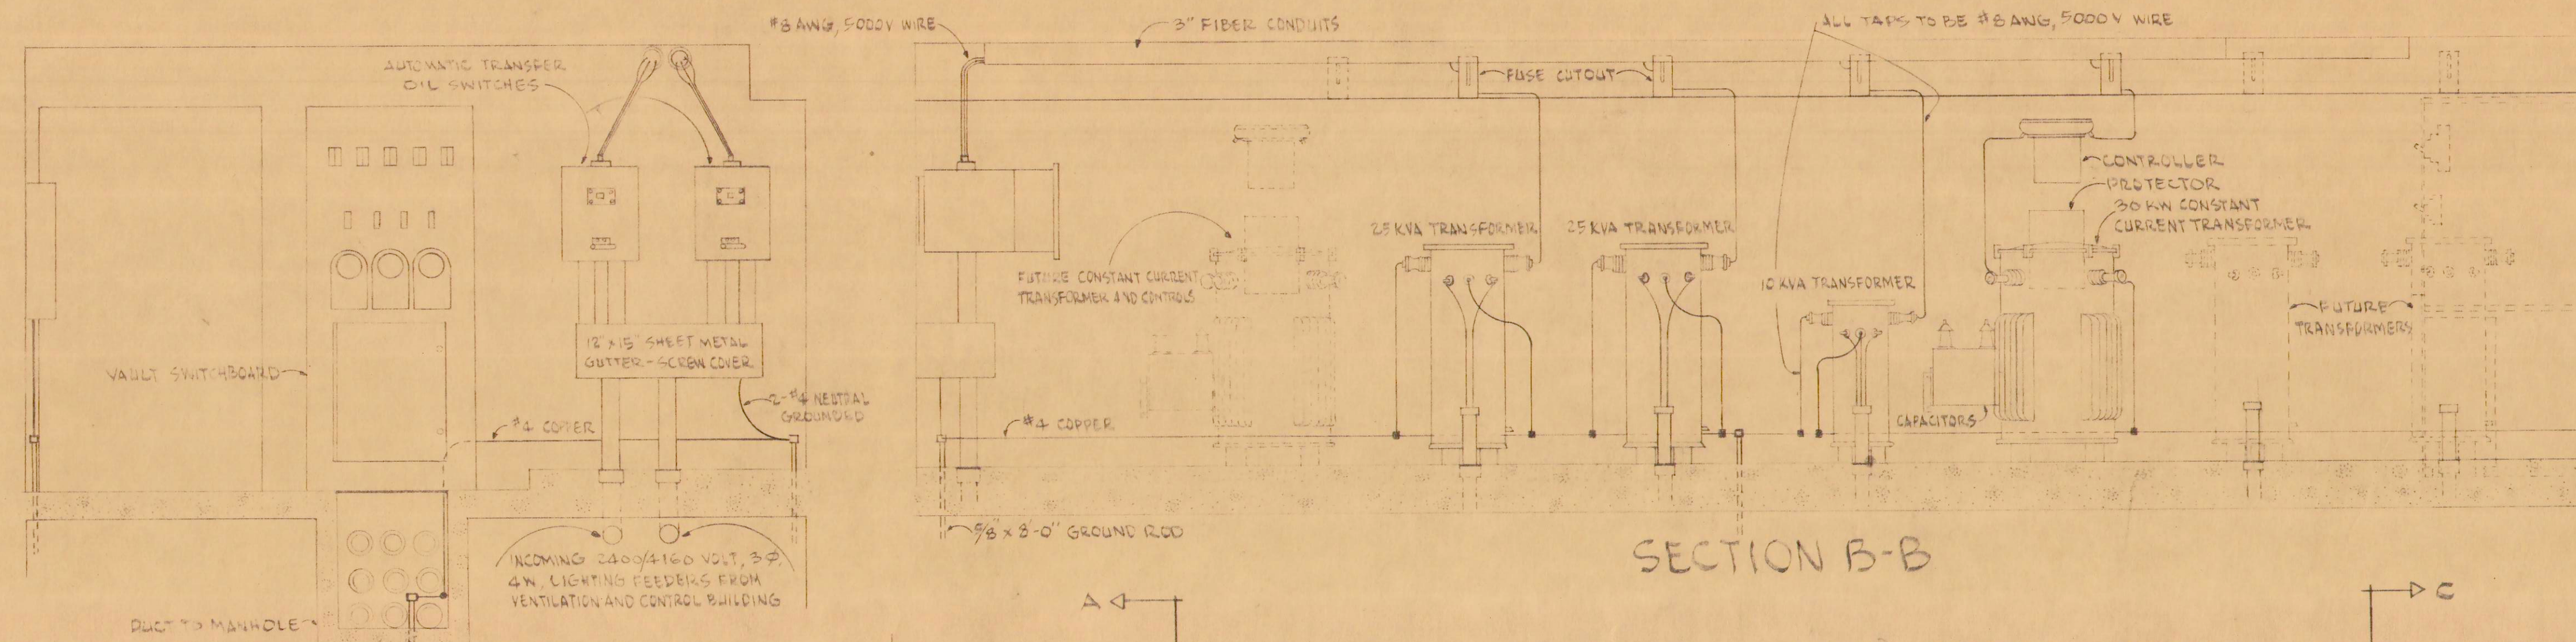


SECTION B-B

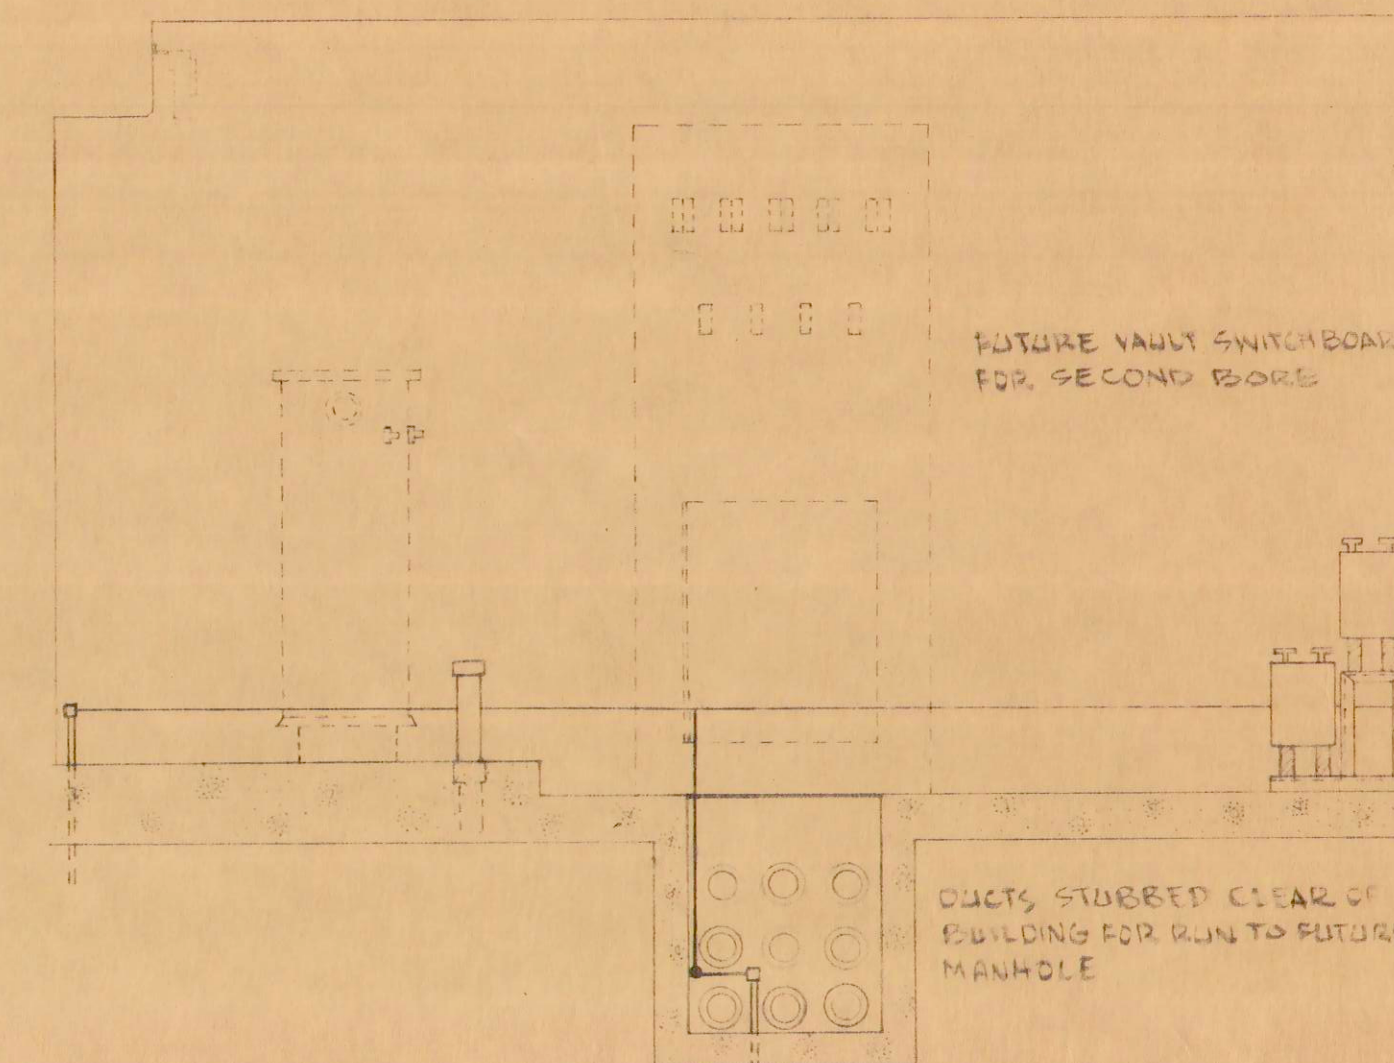

GROUND EACH TRANSFORMER TANK, VAULT SWITCHBOARD, OIL SWITCHES, ETC., WITH NOT SMALLER THAN #6 AWG COPPER WIRE.

GROUND ALL METALLIC CONDUITS ENTERING TRENCH WITH #6 AWG COPPER WIRE (EXCEPT THOSE WHICH ARE PART OF 3-WAY DUCT)

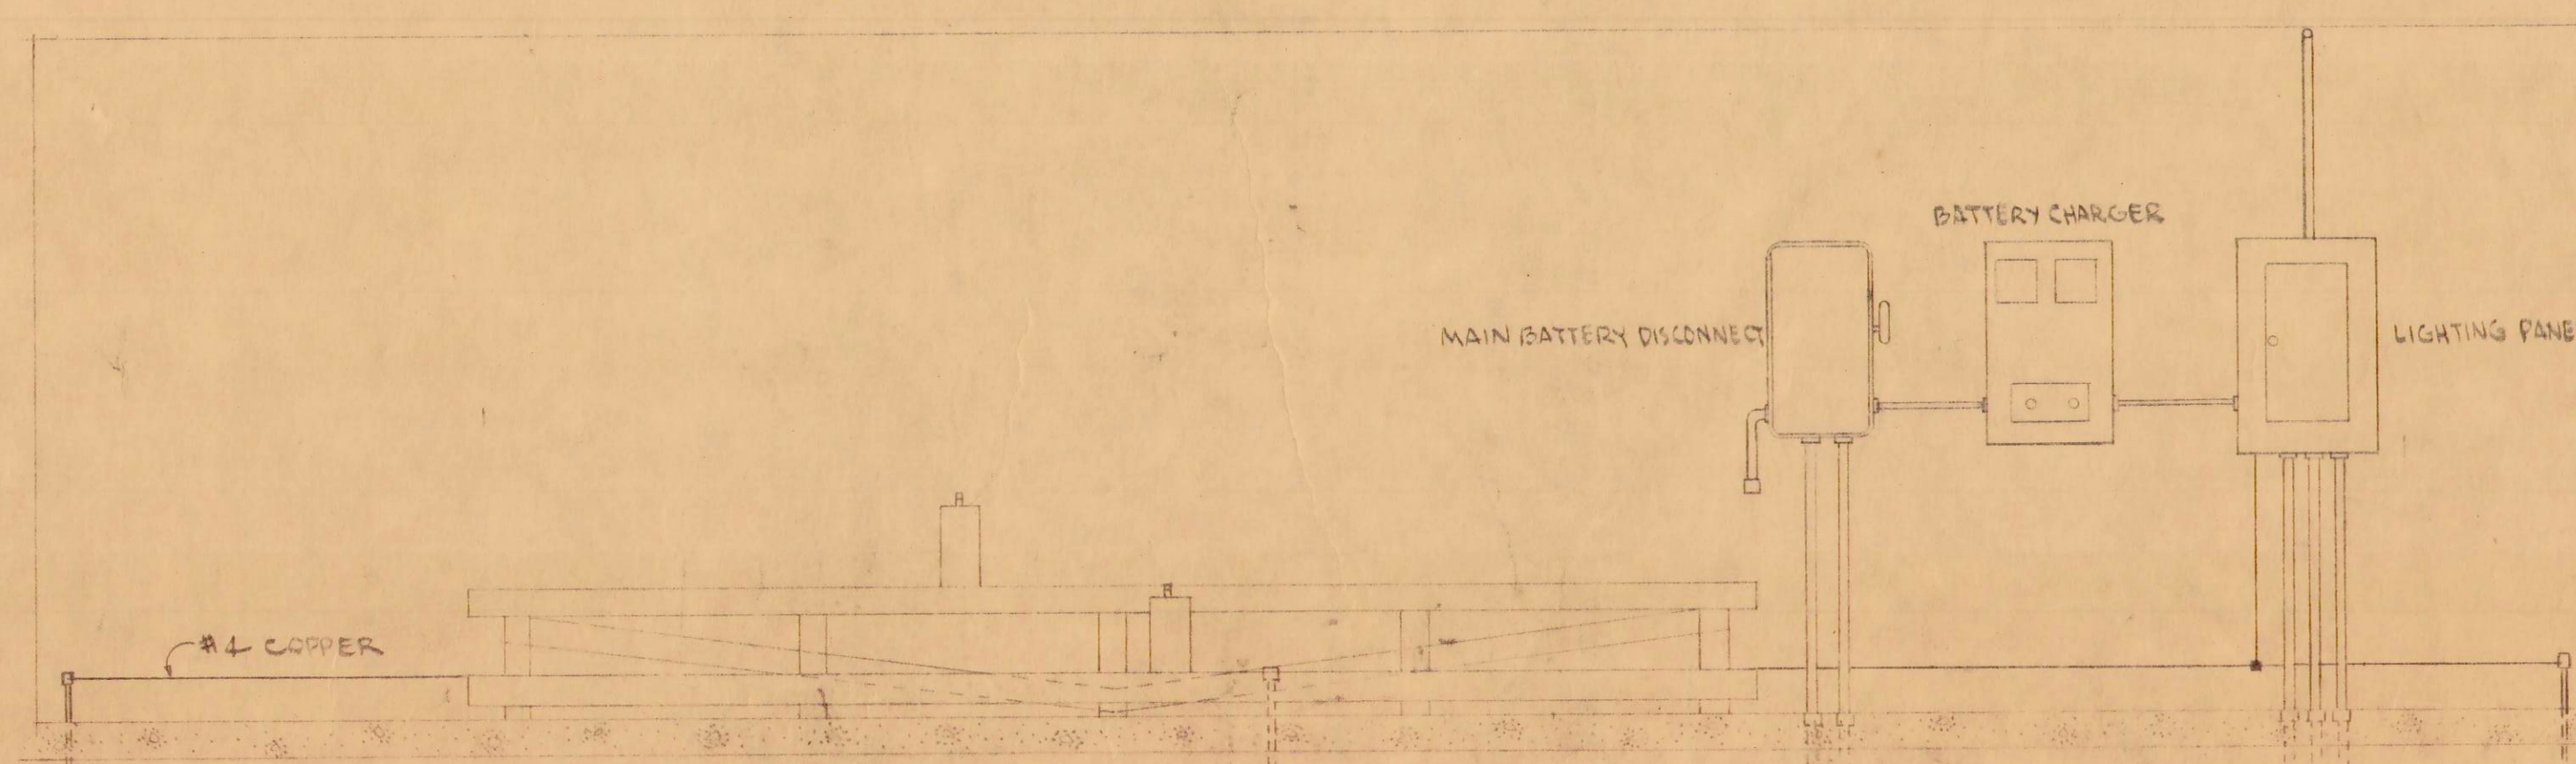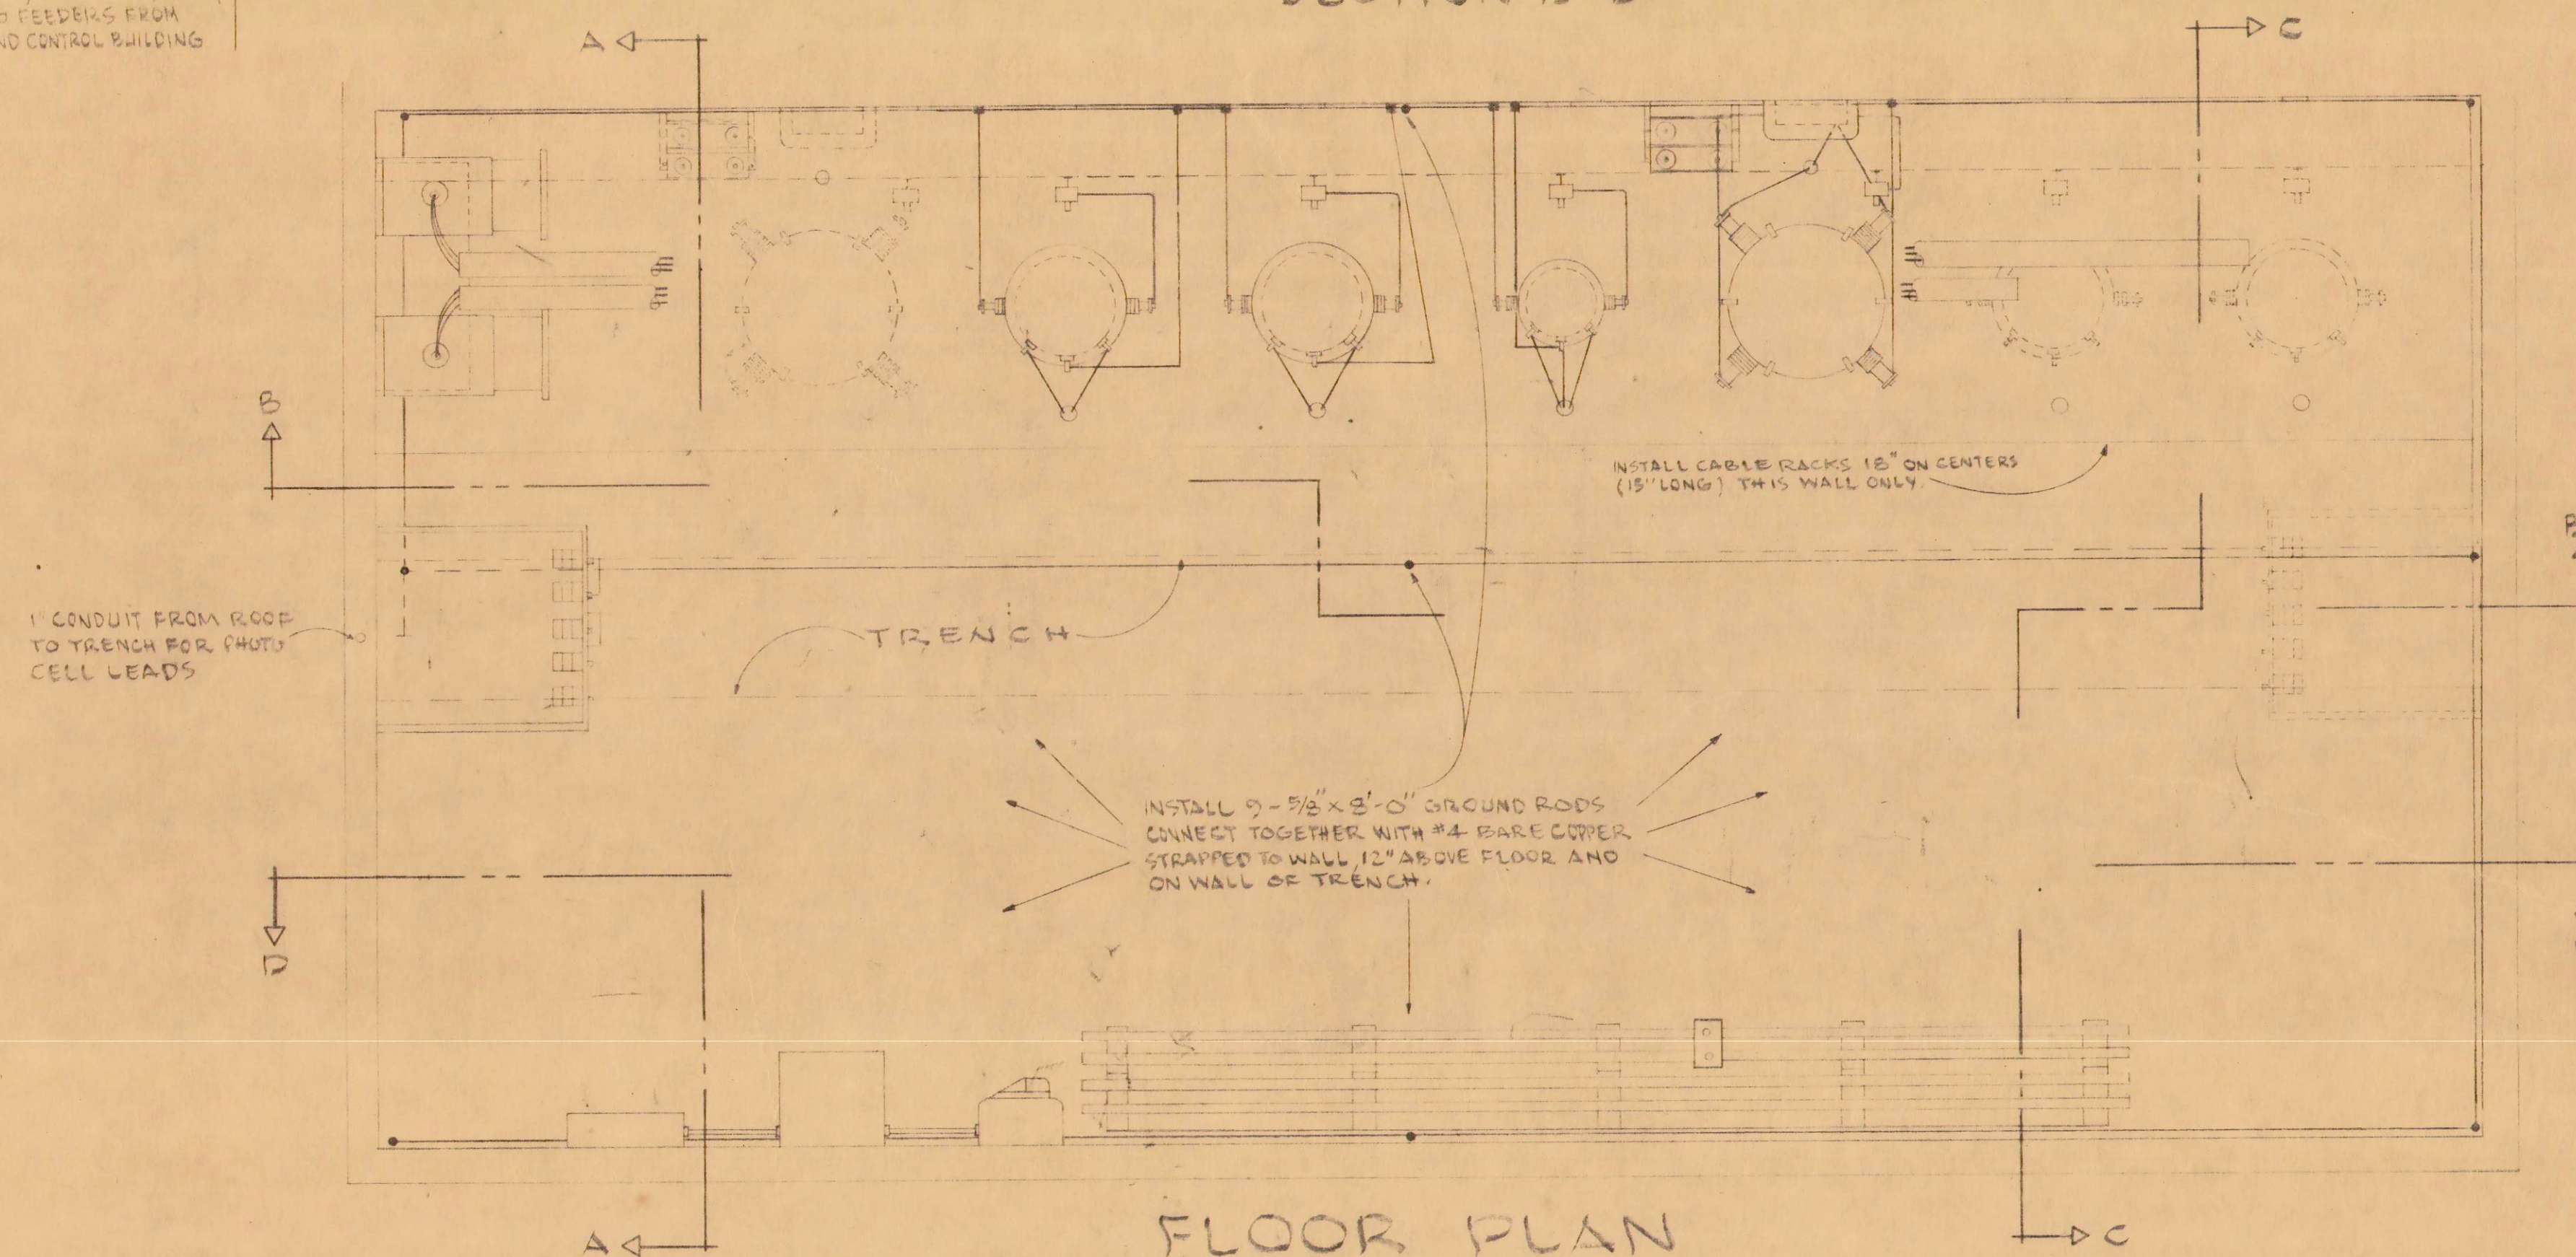

LAW & WILSON ARCHITECTS & ENGINEERS			
DEPARTMENT OF PUBLIC WORKS CITY AND COUNTY OF HONOLULU			
BUREAU OF PLANS			
KALIHI TUNNEL			
ELECTRICAL - KALIHI PORTAL			
VAULT EQUIPMENT LAYOUT			
ENGINEER: L. S. W.	DATE: JULY 15, 1928		
DRAFTSMAN: S. H. P.	CHECKED BY: [Signature]		
SCALE: NO SCALE	TRACER: [Signature]		
APPROVED: [Signature] CHIEF ENGINEER	APPROVED: [Signature] BUREAU ENGINEER		

APPROVED: [Signature] ENGINEER, KALIHI TUNNEL	PROFILE F. B. W. M. BY:	C. B. S. B. S. BY:
SECTION C	JOB NO. 26-53	DWG. E-14