




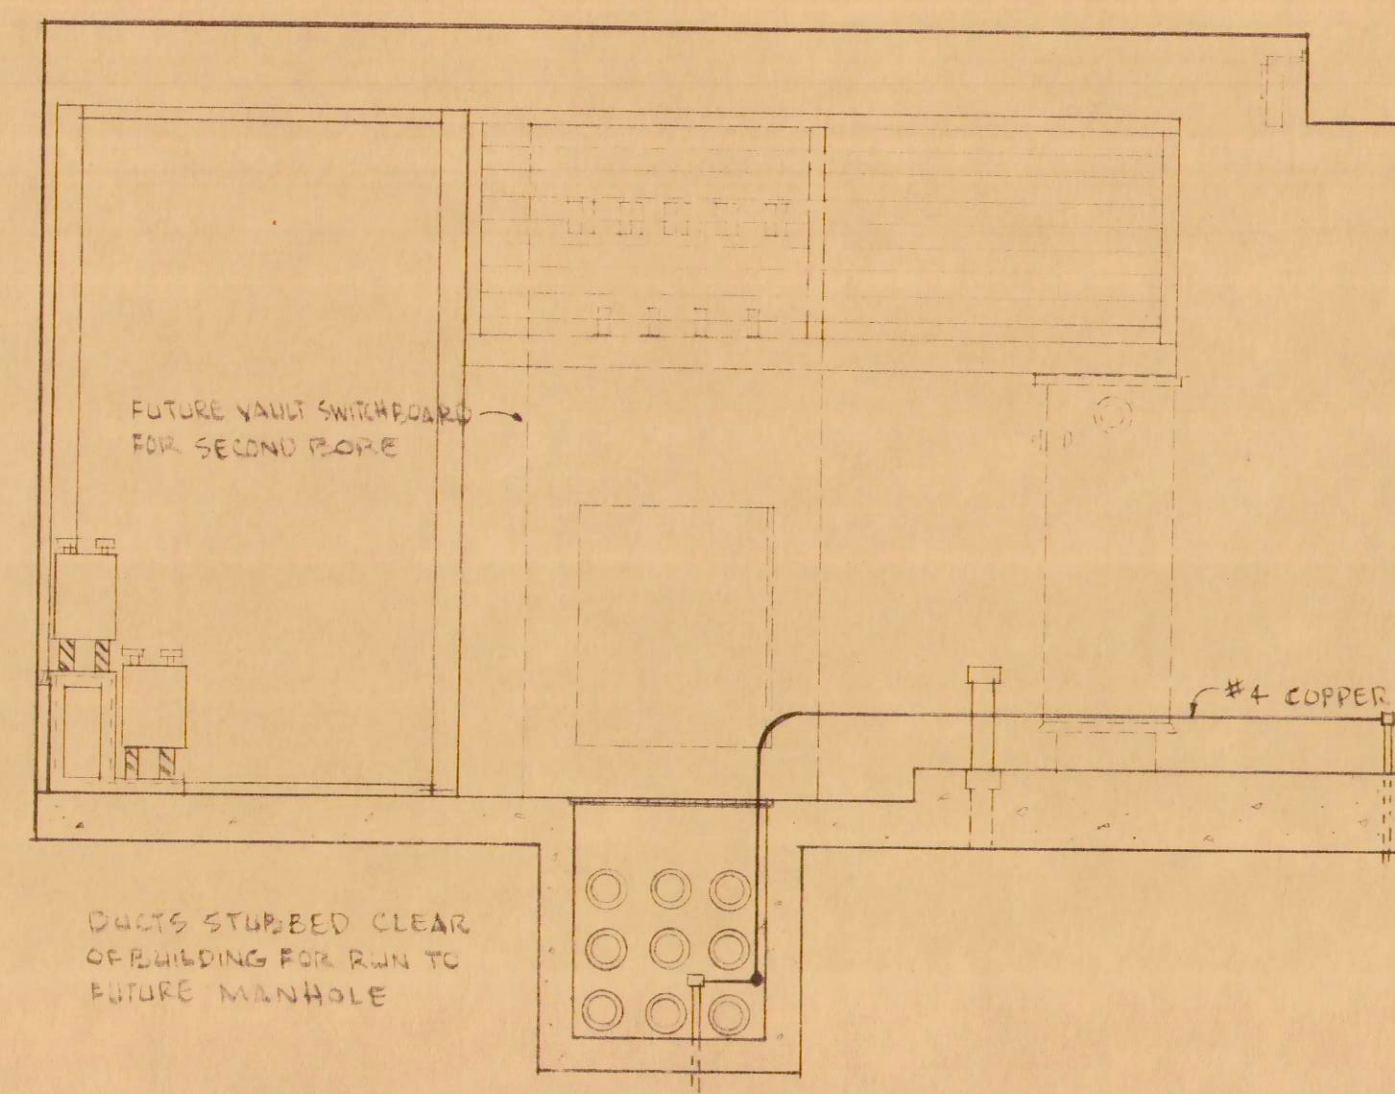


SECTION A-A

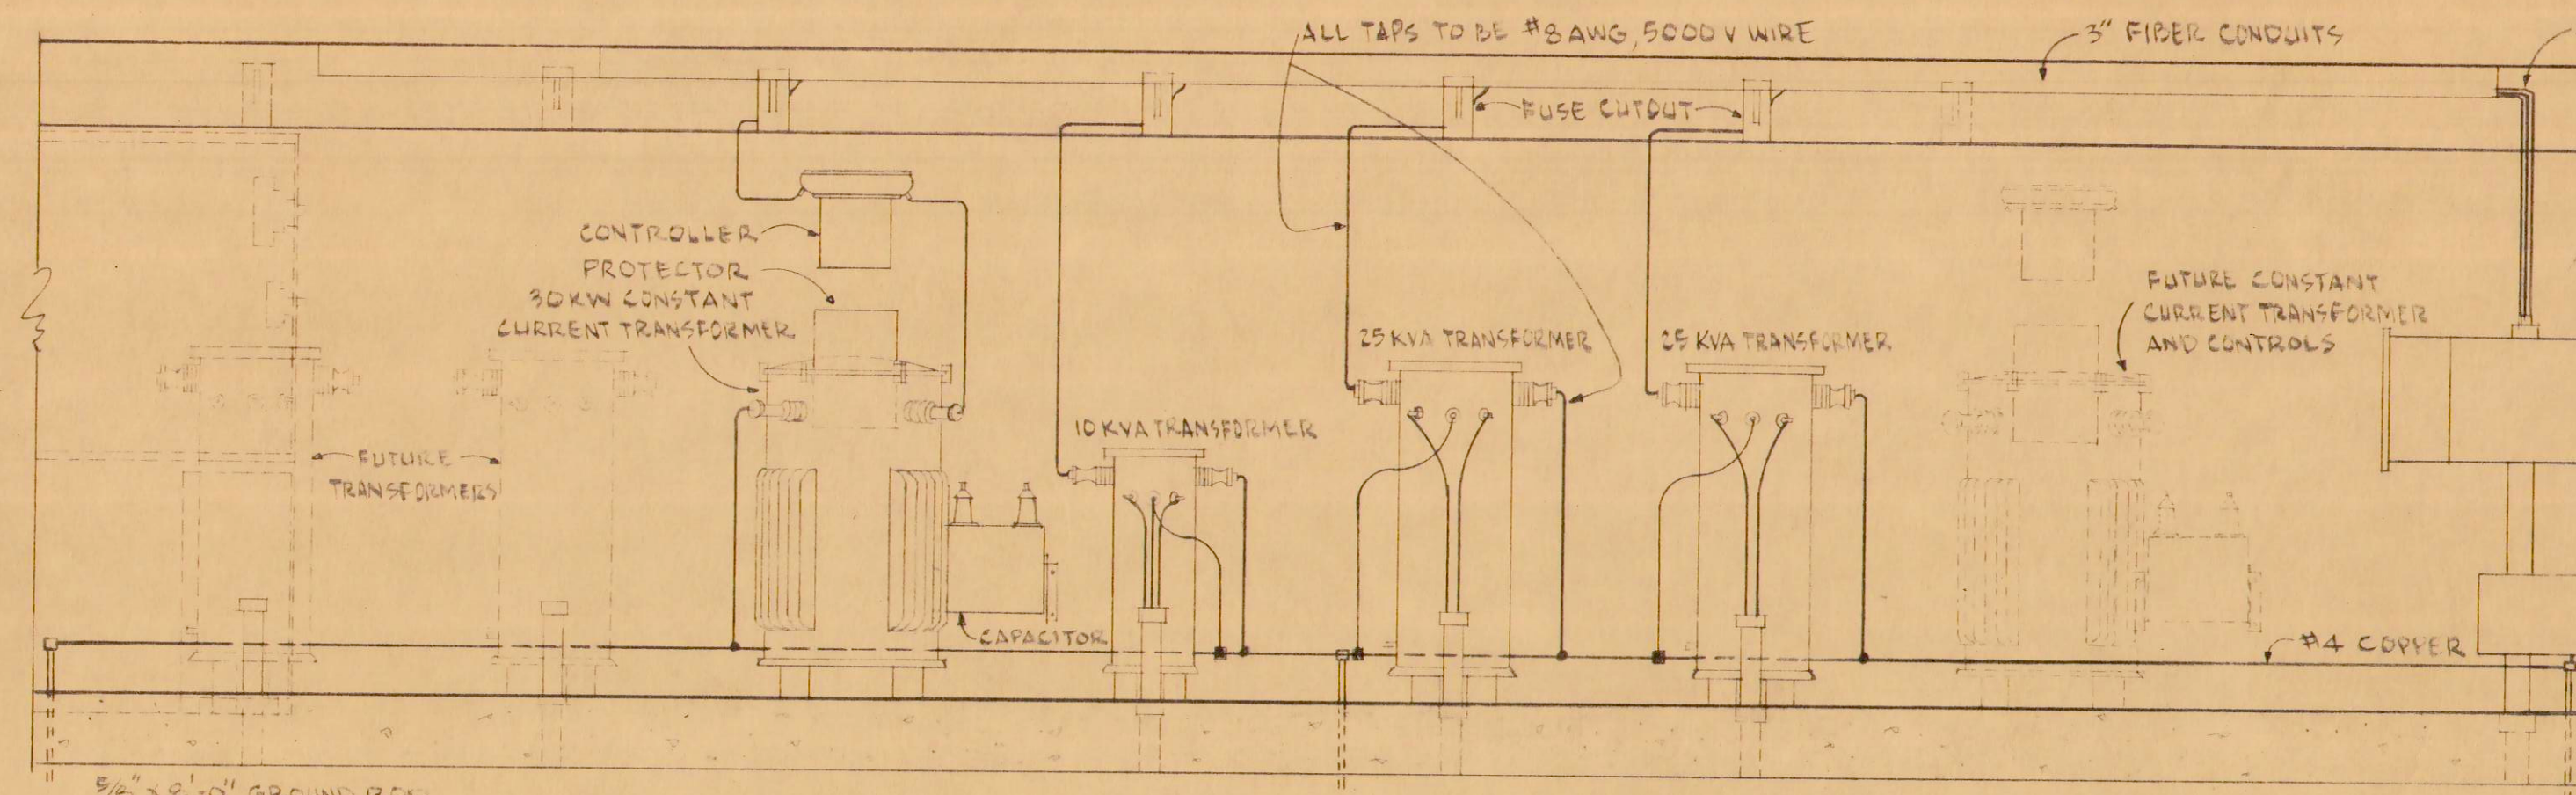


SECTION B-B

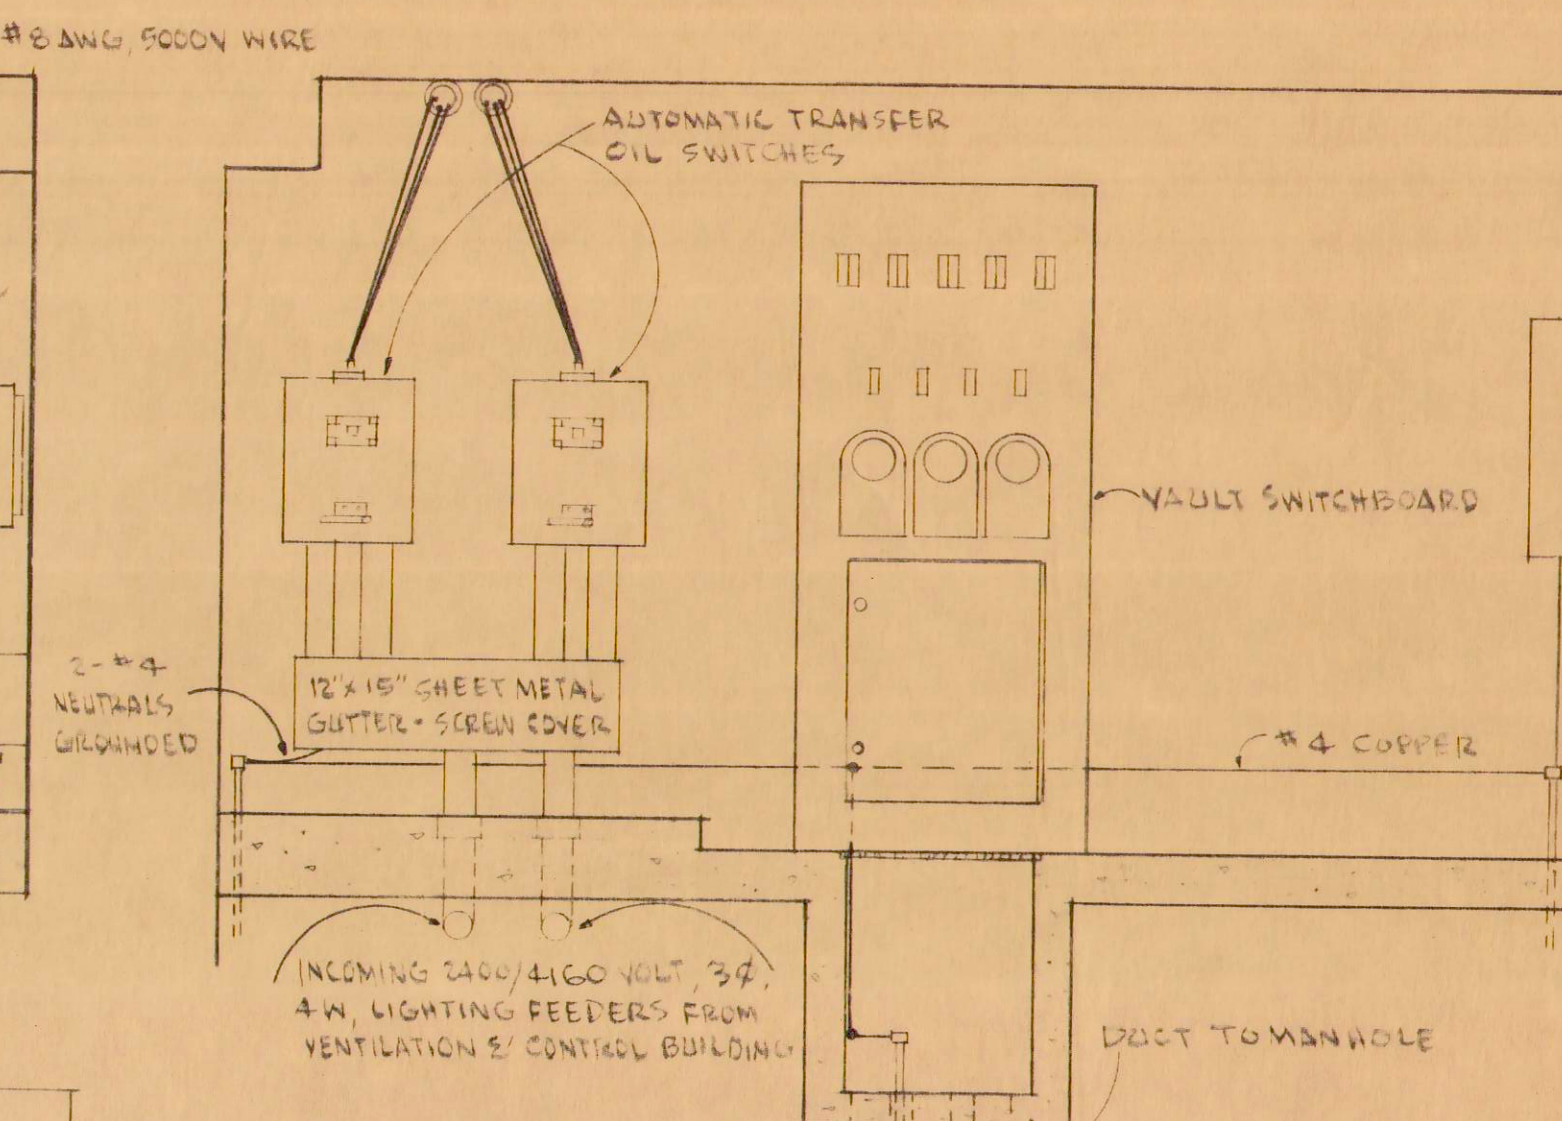

SECTION C-C

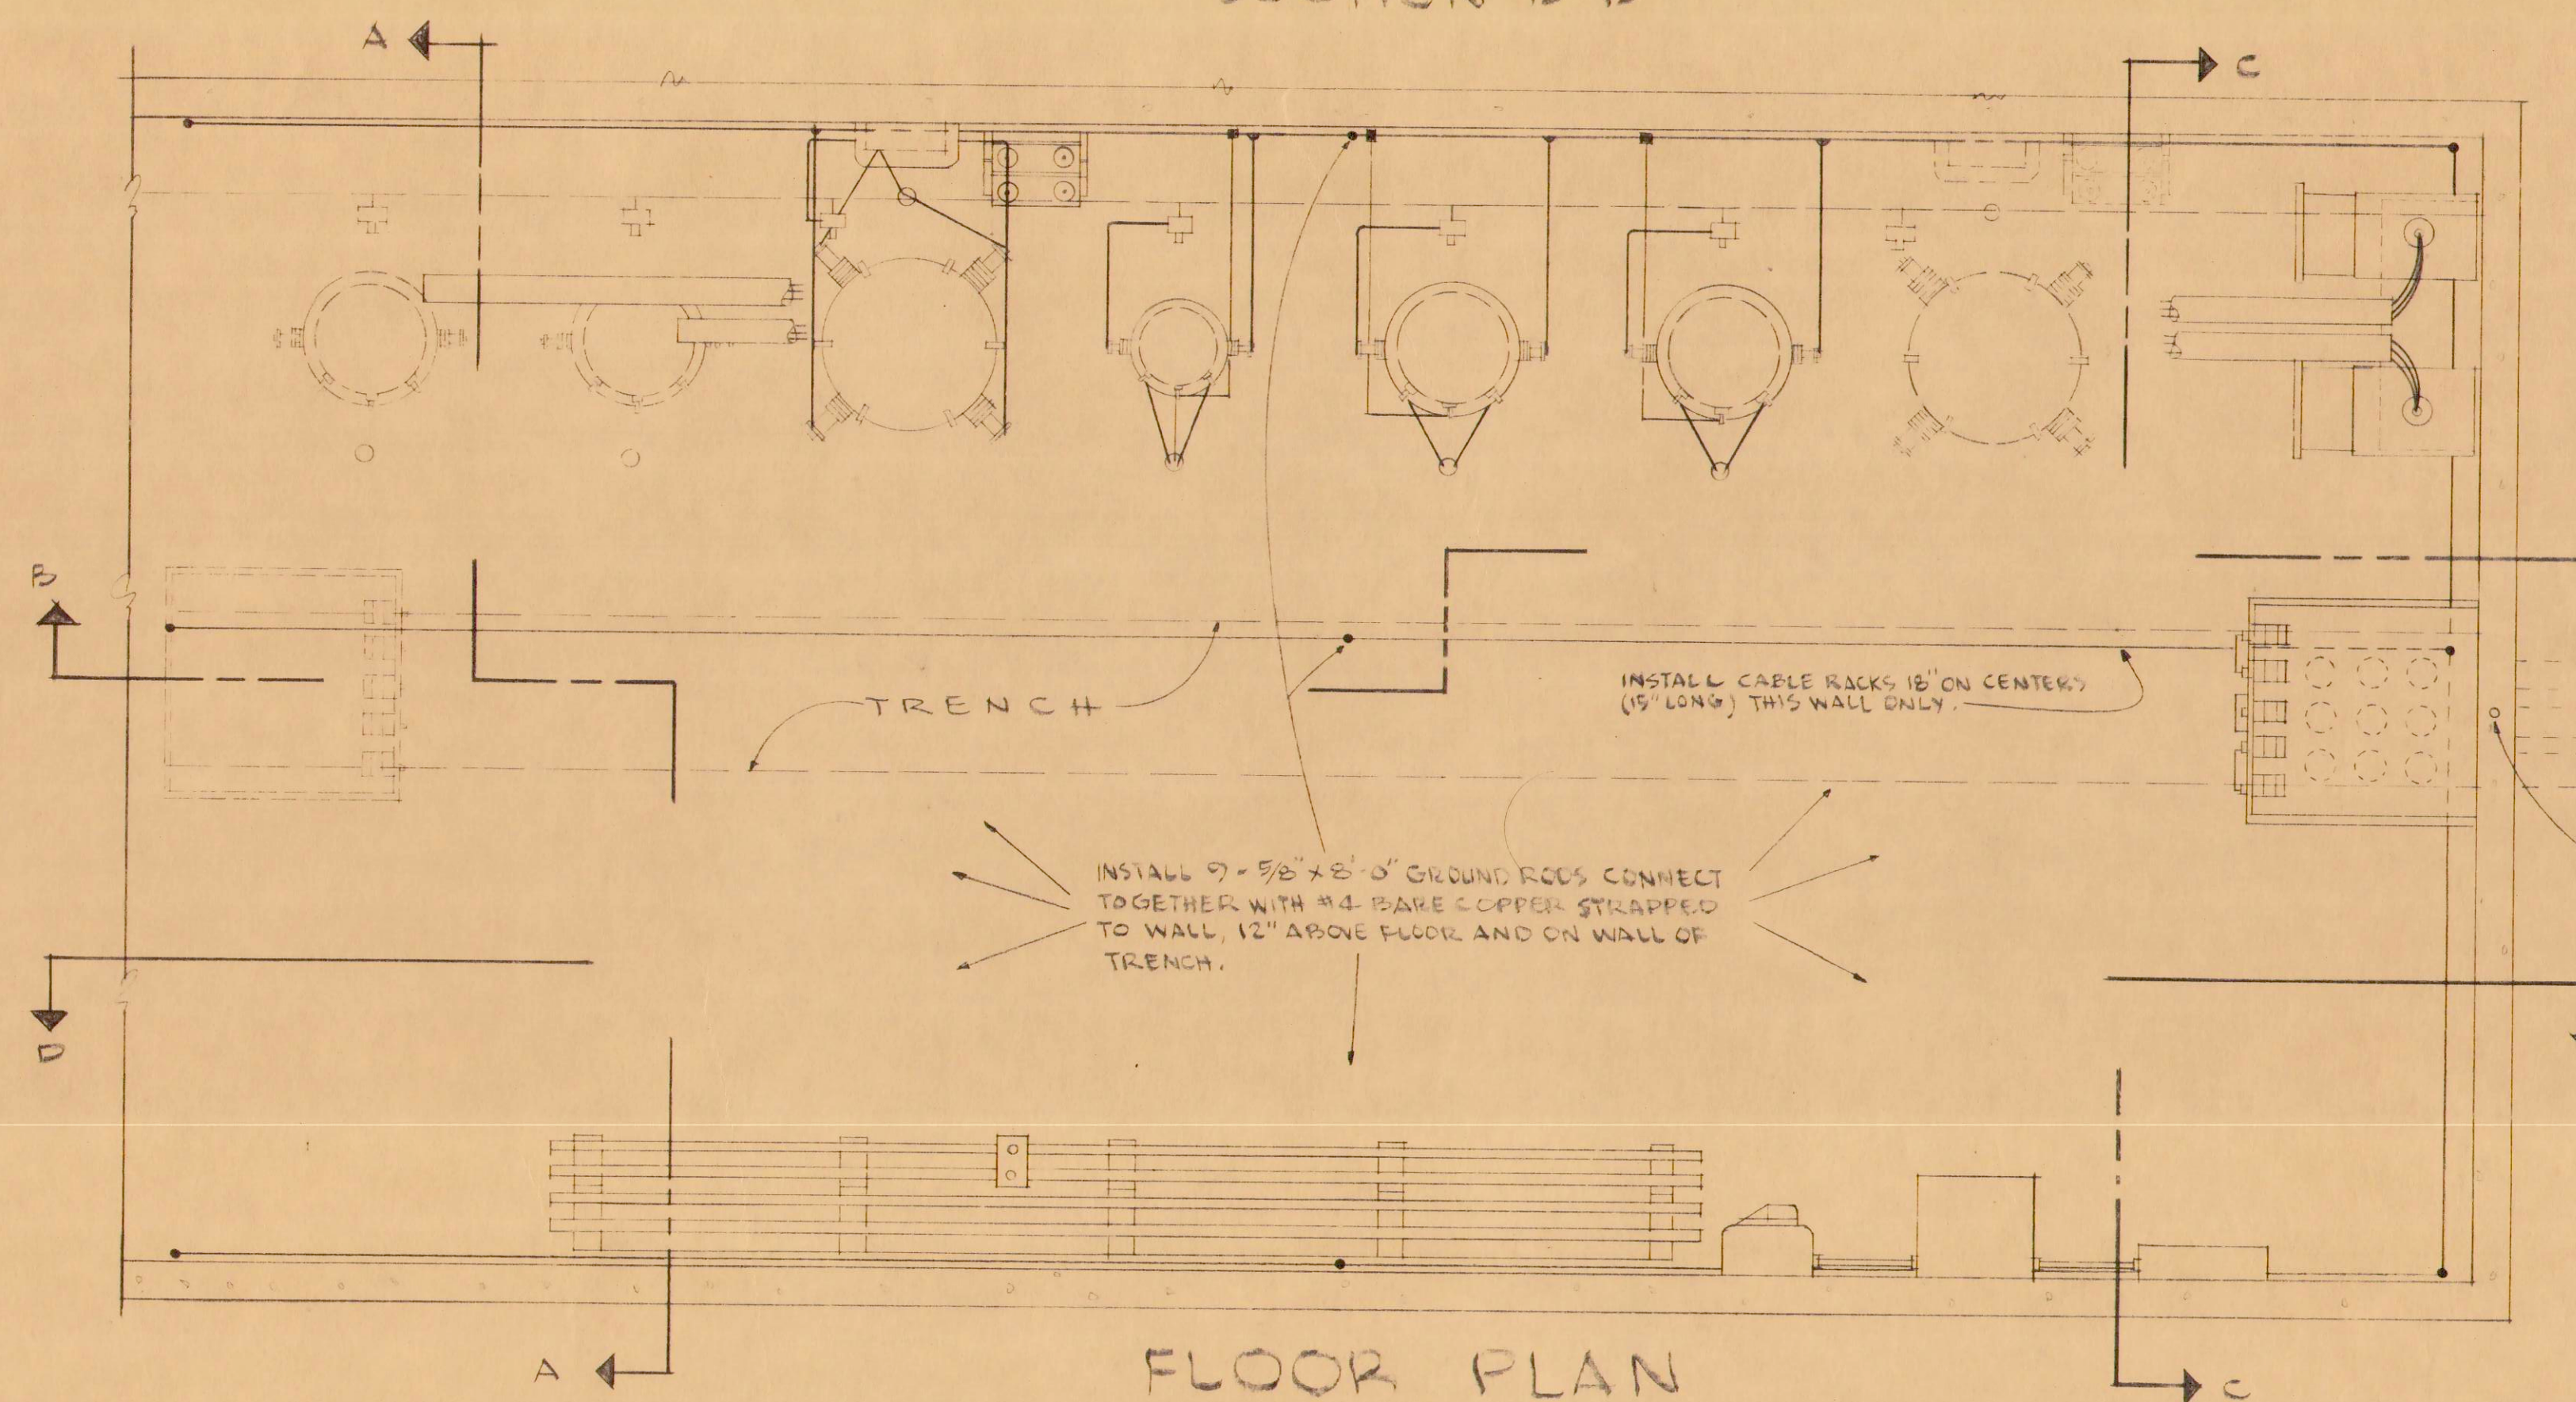

FLOOR PLAN

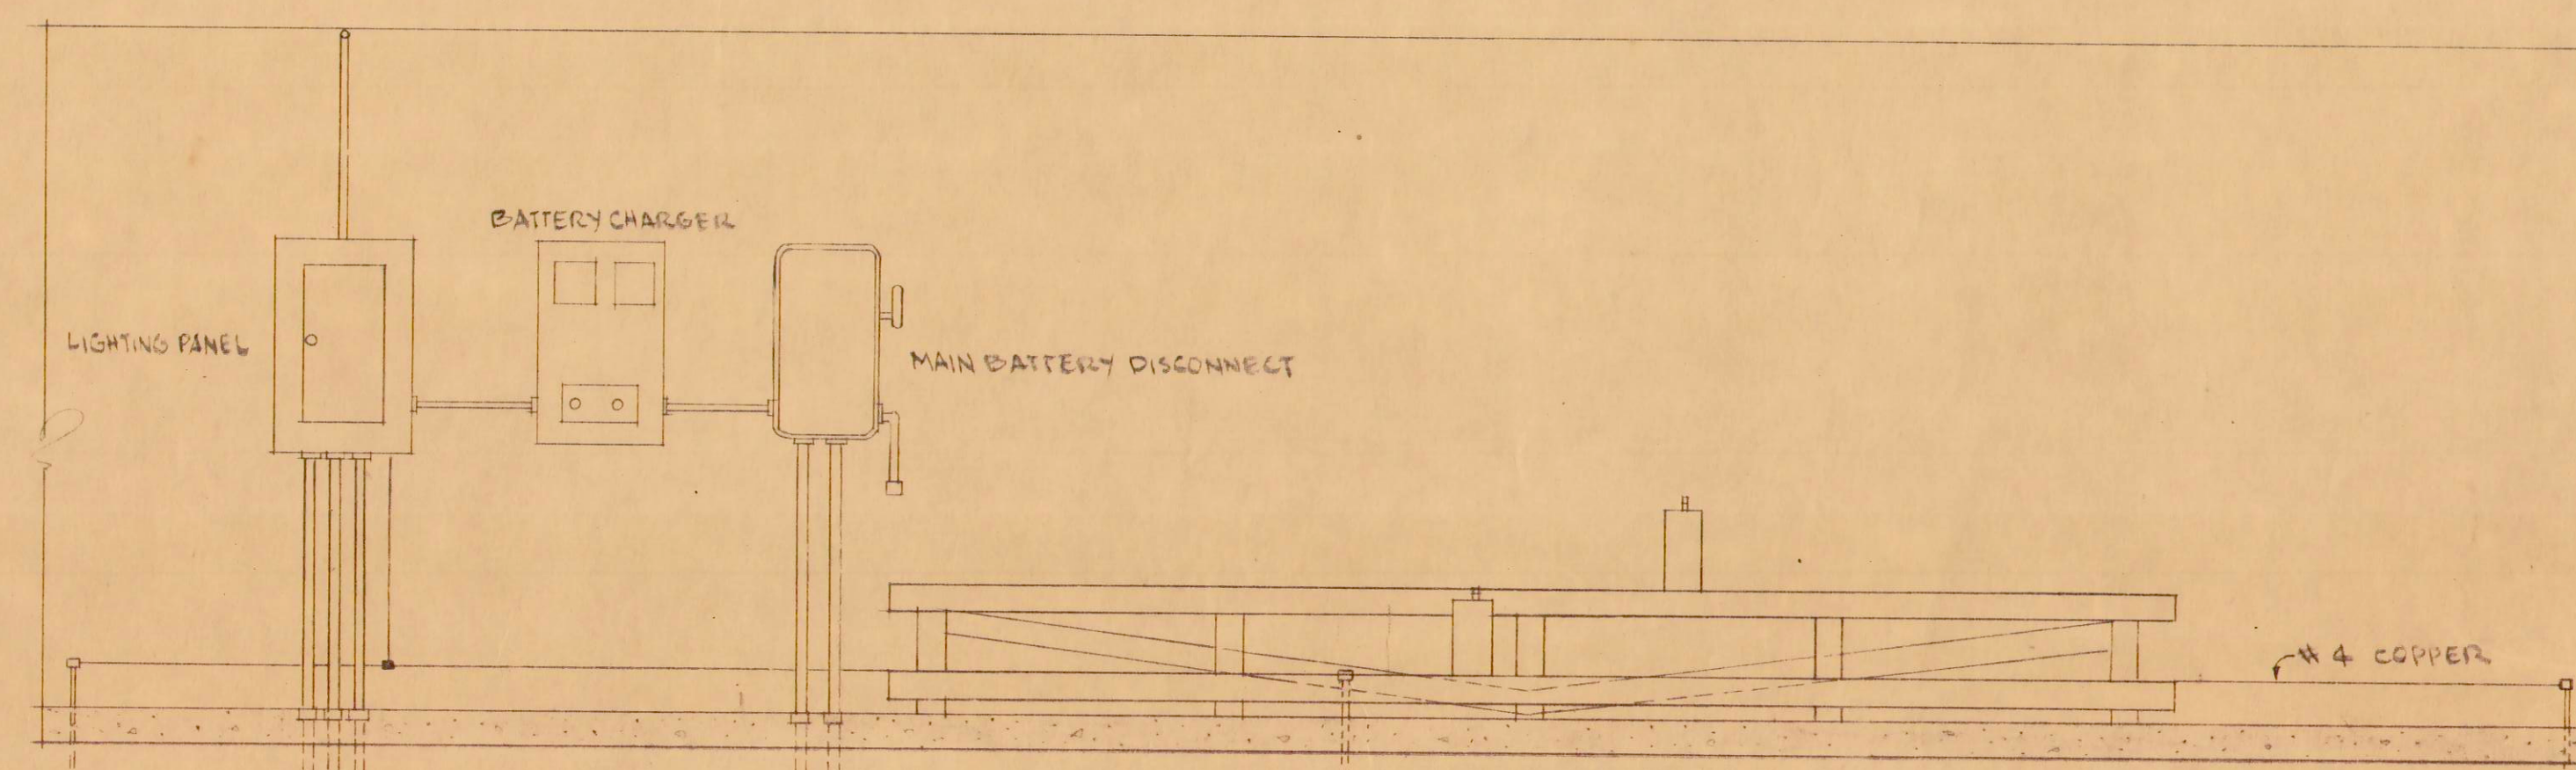

SECTION D-D

GROUND EACH TRANSFORMER TANK, VAULT SWITCHBOARD, OIL SWITCHES, ETC., WITH NOT SMALLER THAN #6 AWG COPPER WIRE.

TO 3-WAY DUCT SEE DRAWING P-55

GROUND ALL METALLIC CONDUITS ENTERING TRENCH WITH #6 AWG COPPER WIRE. (EXCEPT THOSE WHICH ARE PART OF 3-WAY DUCT)

1\"/>

LAW & WILSON  
ARCHITECTS & ENGINEERS  
DEPARTMENT OF PUBLIC WORKS  
CITY AND COUNTY OF HONOLULU  
BUREAU OF PLANS  
**KALIHI TUNNEL**  
ELECTRICAL - KANEHOE PORTAL  
VAULT EQUIPMENT LAYOUT

ENGINEER: L.W. DATE: JULY 15, 1953  
DRAFTSMAN: S.H.B. CHECKED BY: S.H.B.  
SCALE: NO. SCALE TRACER: S.H.B.  
APPROVED: S.H.B. Bureau Engineer  
S.H.B. Chief Engineer

APPROVED: S.H.B. Chief Engineer  
W.S. CR. SEC. F.B. C.B.  
W.M.B.Y. F.W.B.Y. S.B.Y.

SECTION C JOB NO. 26-53 DWG. E-15