




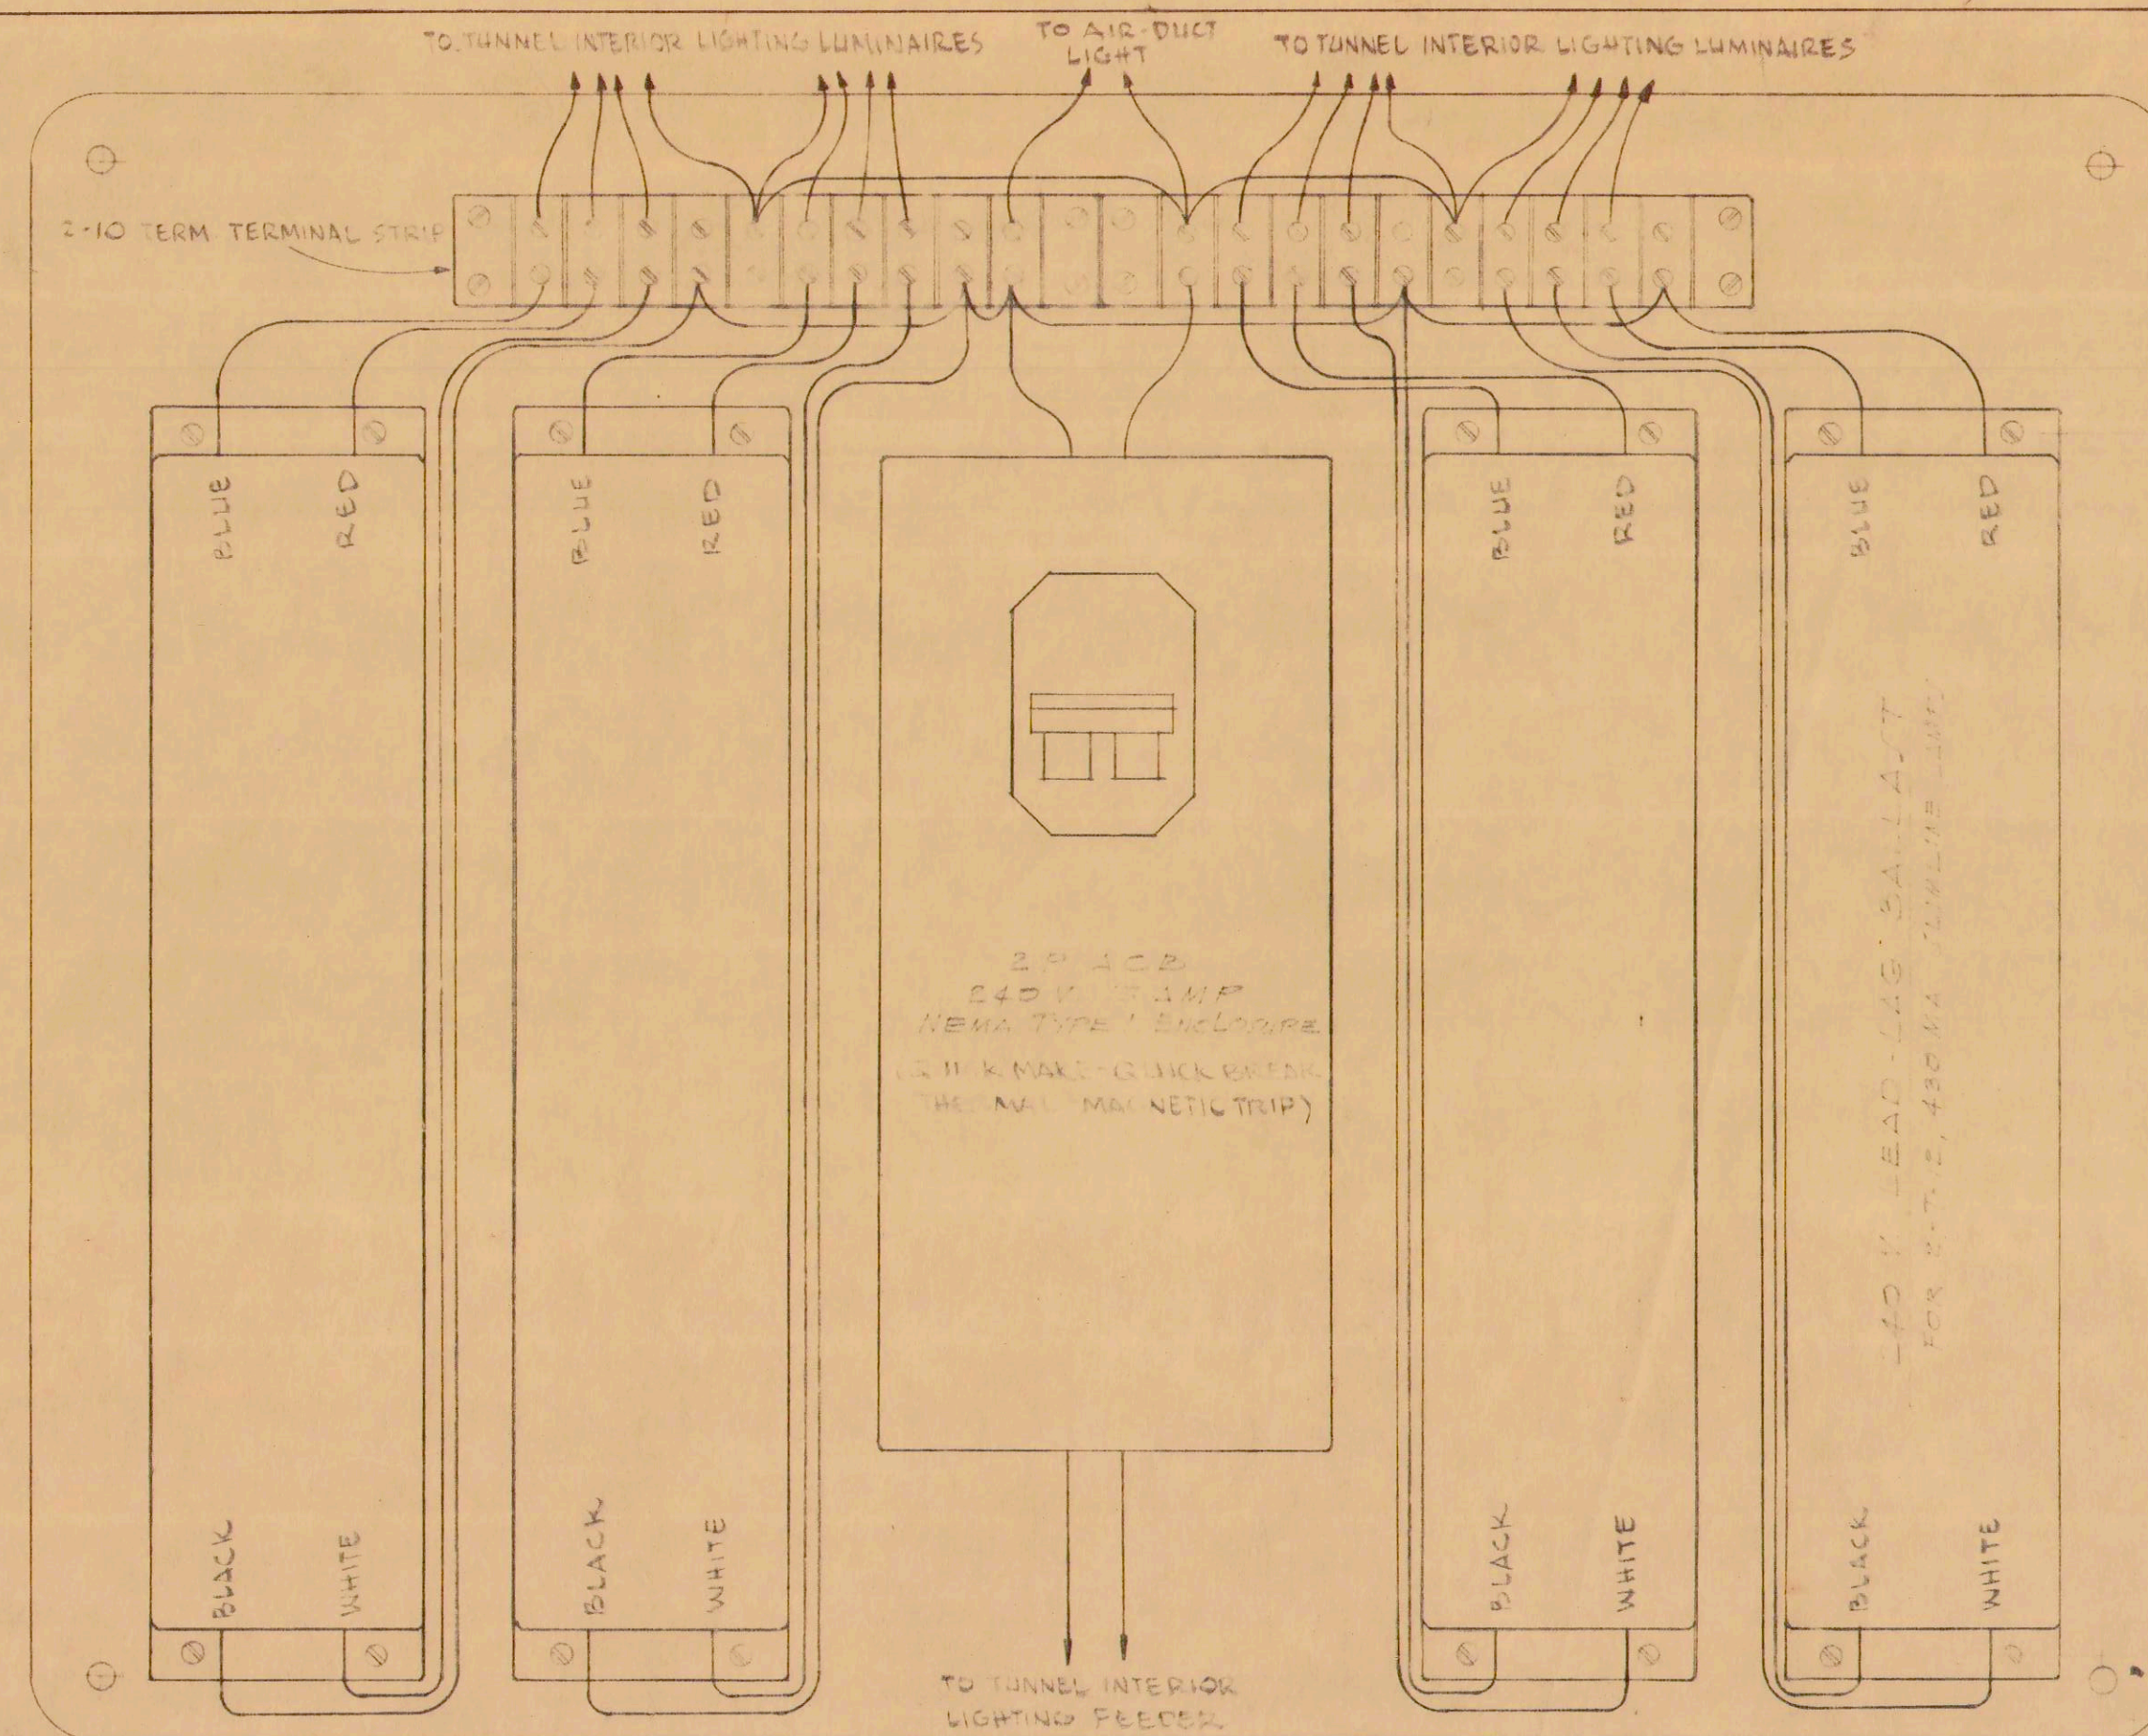


FOUR UNIT BALLAST ASSEMBLY (EACH 64 FOOT MODULE)

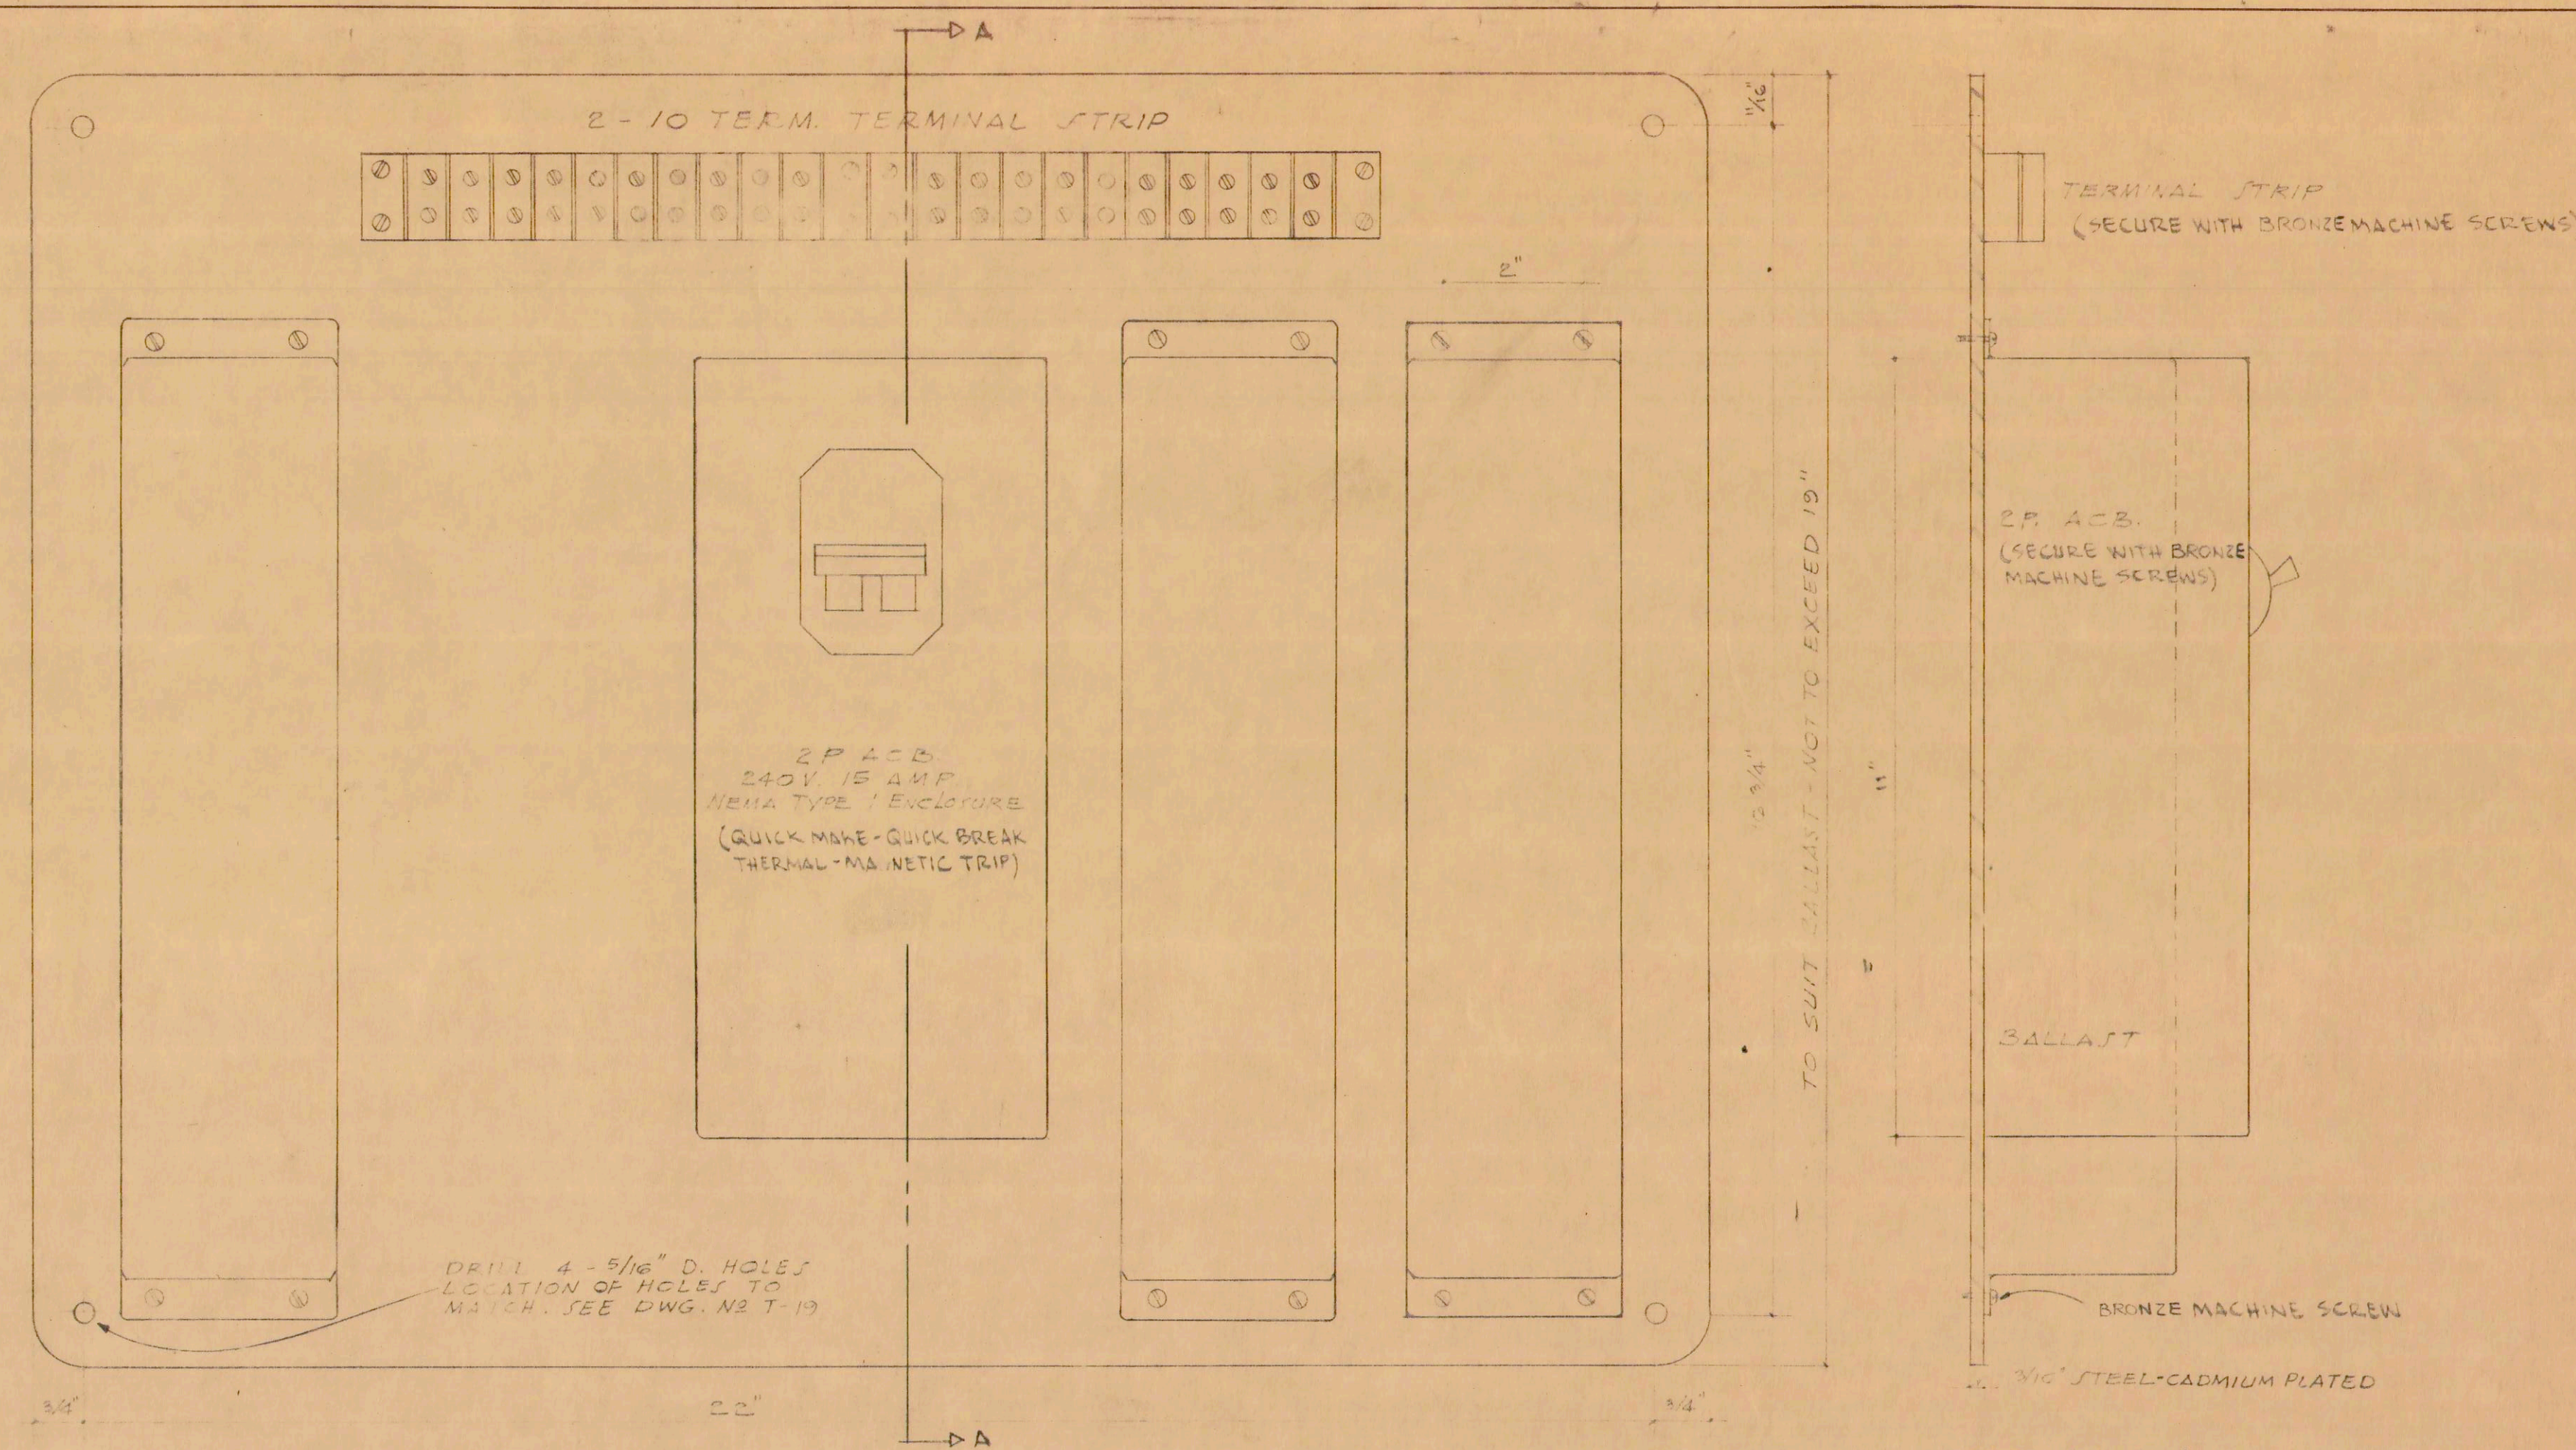

THREE UNIT BALLAST ASSEMBLY (Kaneohe Portal)

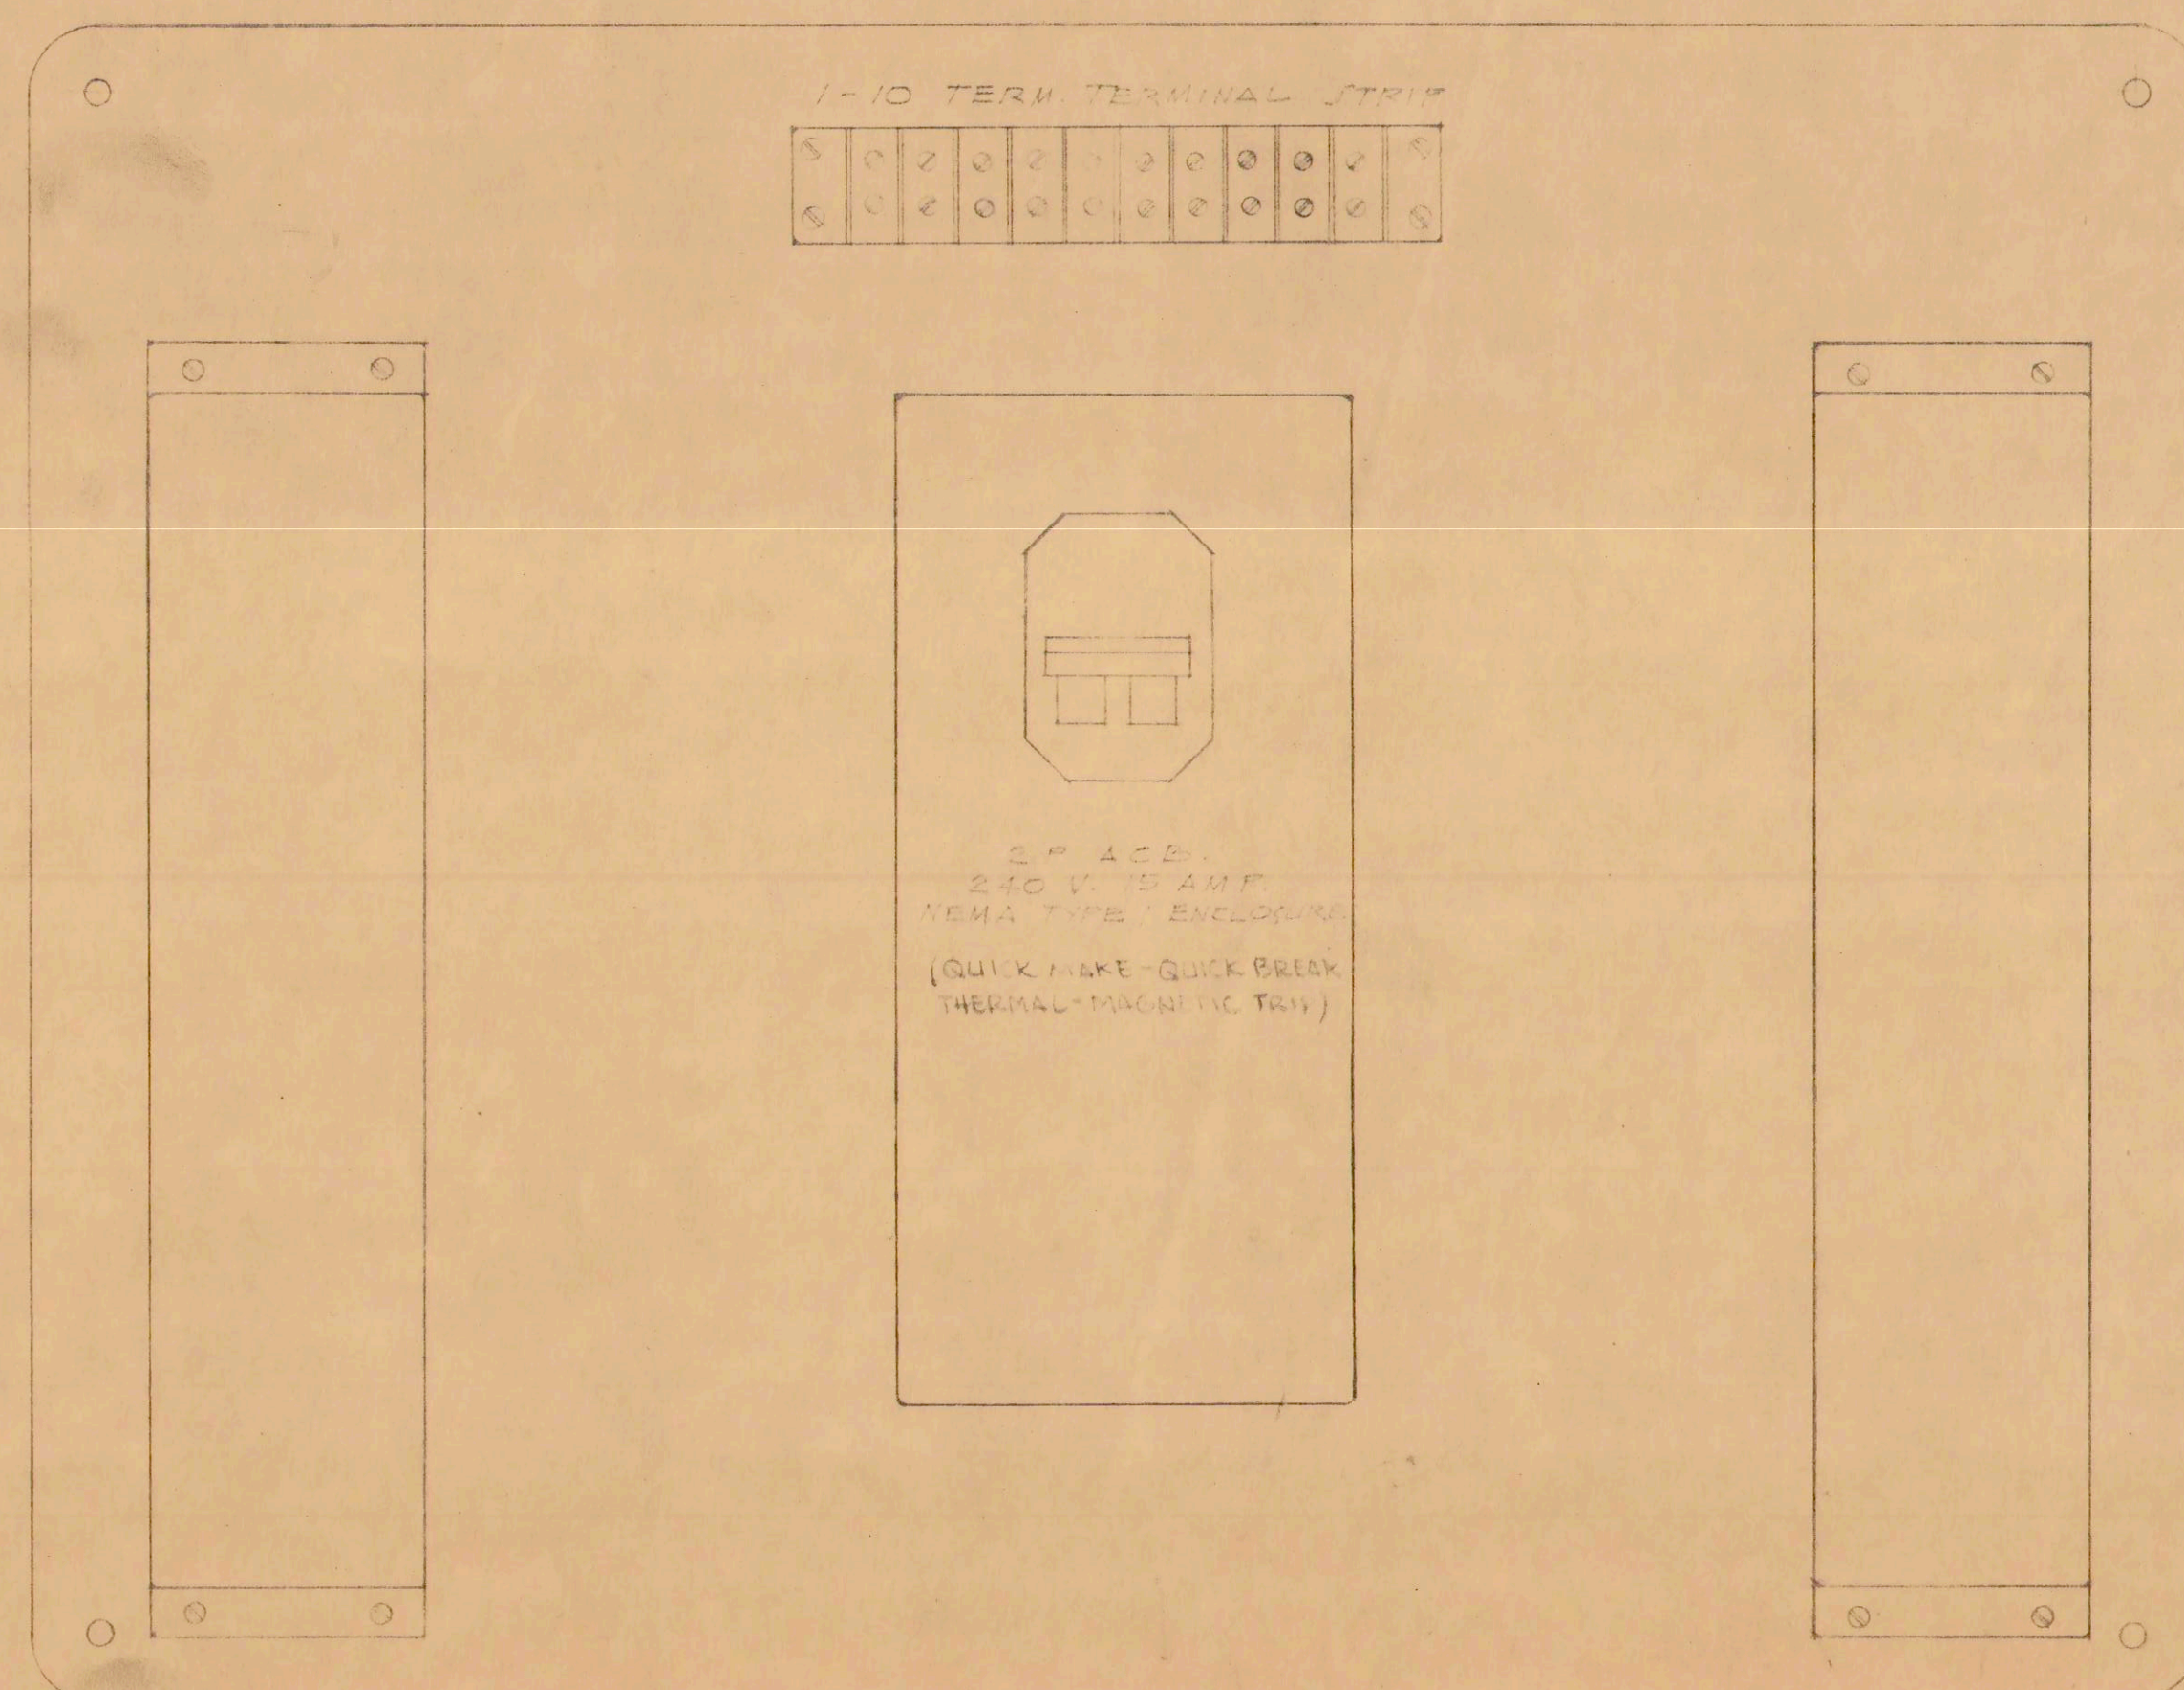

TWO UNIT BALLAST ASSEMBLY (Kalihi Portal)

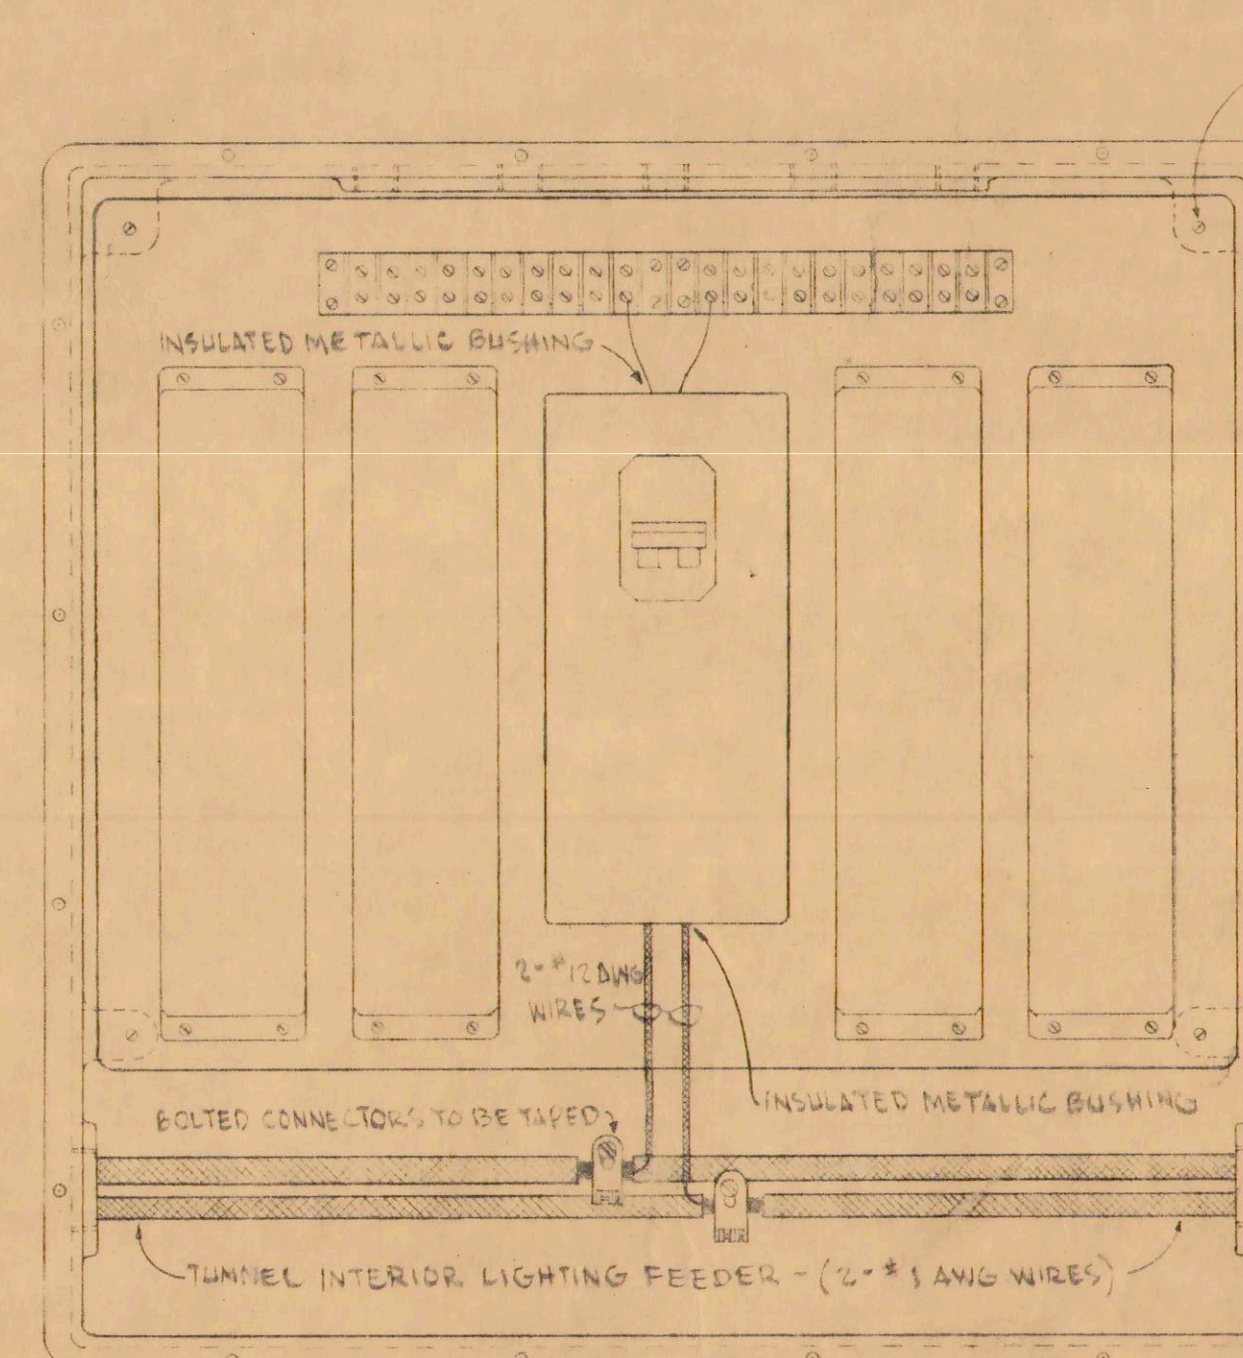

BALLAST ASSEMBLY INSTALLED IN TUNNEL INTERIOR LIGHTING BOX

FOR TUNNEL INTERIOR LIGHTING BOX
DETAIL SEE DWG. NO. T-13

INSTALL NO CONDUITS BETWEEN TUNNEL INTERIOR
LIGHTING BOXES IN MODULE SO 22 AND MODULE
21 & 23 - PLUG UNUSED HUBS. SEE DWG. NO. E-2

LAW & WILSON ARCHITECTS & ENGINEERS			
DEPARTMENT OF PUBLIC WORKS CITY AND COUNTY OF HONOLULU			
BUREAU OF PLANS			
KALIHI TUNNEL			
ELECTRICAL-TUNNEL INTERIOR LIGHTING BOX EQUIPMENT ASSEMBLY			
ENGINEER: L. S. W.	DATE: JULY 15, 1953		
DRAFTSMAN: S.H.P.	CHECKED BY: W.C. [Signature]		
FILE NO: 26-53	TRACER:		
APPROVED: [Signature] CHIEF ENGINEER	APPROVED: [Signature] BUREAU ENGINEER		
W.S. OR SEC. W.M.B.Y.	PROFILE F.S. F.W.B.Y.	C.B. S.B. S.B.Y.	

SECTION C

JOB NO. 26-53

DWG. E-4