




- 1. Contractor shall remove and dispose asbestos—containing roof patching material from the Kalihi Portal roof (20 sq. ft.) and Kaneohe Portal roof (30 sq. ft.). Material is located at various roof penetrations and soffits.
- 2. Abatement shall be conducted in accordance with OSHA 29 CFR 1926.1101, HIOSH 12-145.1, and Specification Section 955, Asbestos Abatement.
- 3. Abatement work shall not begin until submittal requirements outlined in the Specifications have been accepted.
- Asbestos survey reports are available for review at the H-3 Tunnel Control Building (485-6202).



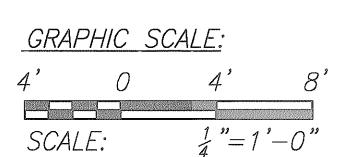

STATE OF HAWAI'I DEPARTMENT OF TRANSPORTATION ASBESTOS ABATEMENT PLAN

WILSON TUNNEL IMPROVEMENTS SCADA IMPROVEMENTS

PROJECT NO. HWY-0-21-98M Date: JULY 2000 Scale: As Noted

SHEET No. AB-1 OF AB-1 SHEETS 14

