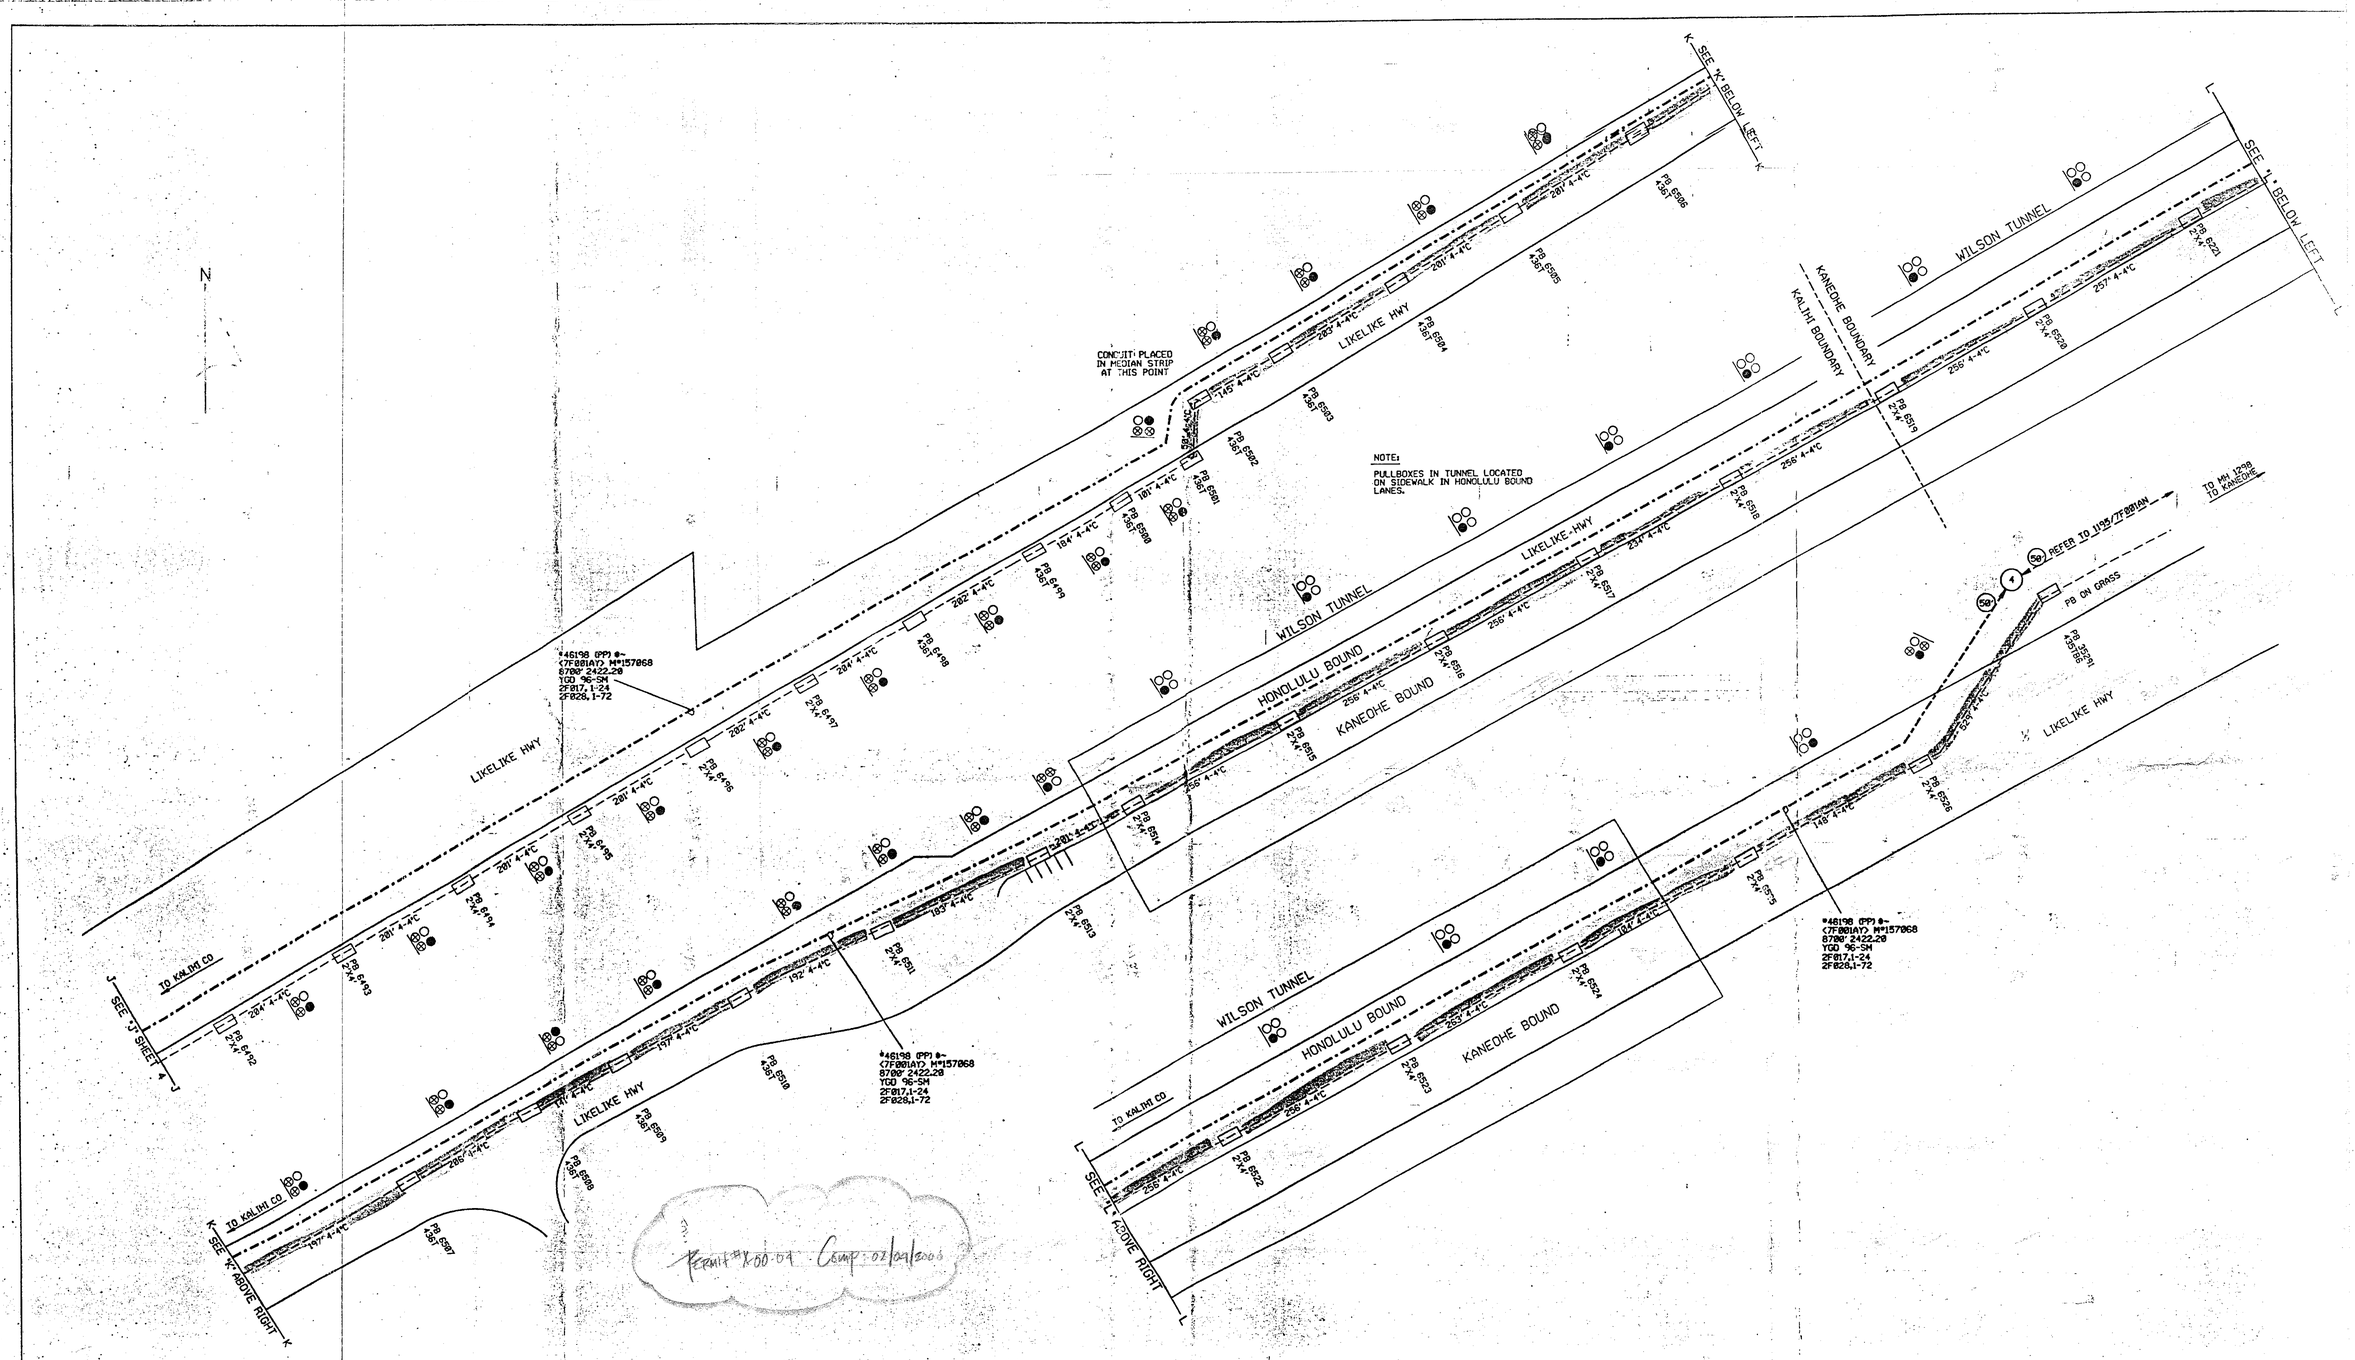

NOTE AREA—

SPECIAL CIRCUITS

ASGNMT REC'S DATE _____

DESIGN REVIEW REQ'D ☐ YES ☐ NO

IF YES, ATTACH COMPLETED SPECIAL SERVICES CHANGE NOTICE

☐ TI
☐ DATA
☐ TRUNK
☐ SELEX
☐ OTHER
☐ NONE

TRANSMISSION CRITERIA

BRIDGE TAP(S)_____FOOTAGE _____
END SECTION FOOTAGE_____
LOOP ELR_____OHMS LOOP EML_____dB
LOOP ALR_____OHMS LOOP AML_____dB
OFFICE LOOP LIMIT_____OHMS

WORK SAFELY
HIGH VOLTAGE
POWER CO. HECO
12 KV 3 PHASE
CONNECTED YES
GROUNDED YES
COMMENTS

DISTRIBUTION	
FILE	
ASSIGNMENT	
CONSTRUCTION	
AP	
EXCH PLNG	
TRANS ENGR	
ENGINEER	
R YOSHIDA	
K GOO	
TOTAL	15

JOB PRE-FIELDED BY: L CHING DATE PRE-FIELDED: 4-5-99

PROPRIETARY INFORMATION FOR USE BY AUTHORIZED GTE EMPLOYEES ONLY

CODES: 2421.20, 2422.20, 2441.10, X441.10

PIPELINE NO. NA

CPA AFFECTED ___YES ___NO

SAL(S) AFFECTED:

ENG L CHING TEL 840-1436
DRAWN BY L CHING DATE 05/20/99
APP'D W. Cabral SHT 5 OF 5

GTE Hawaiian Tel

H11

C.O. KALIHI STATE: HI

SHT(S) SEE SHEET 1

TITLE: KLHI TO LIKELIKE: PLACE FIBER SCALE: 1"=100'

W.C.: 1190 WO NO.: 7F001AY CTRL:

FILE: WP10 DIVISION: OAHU EXCH.: 1192

MODIFIED 1/23/99