

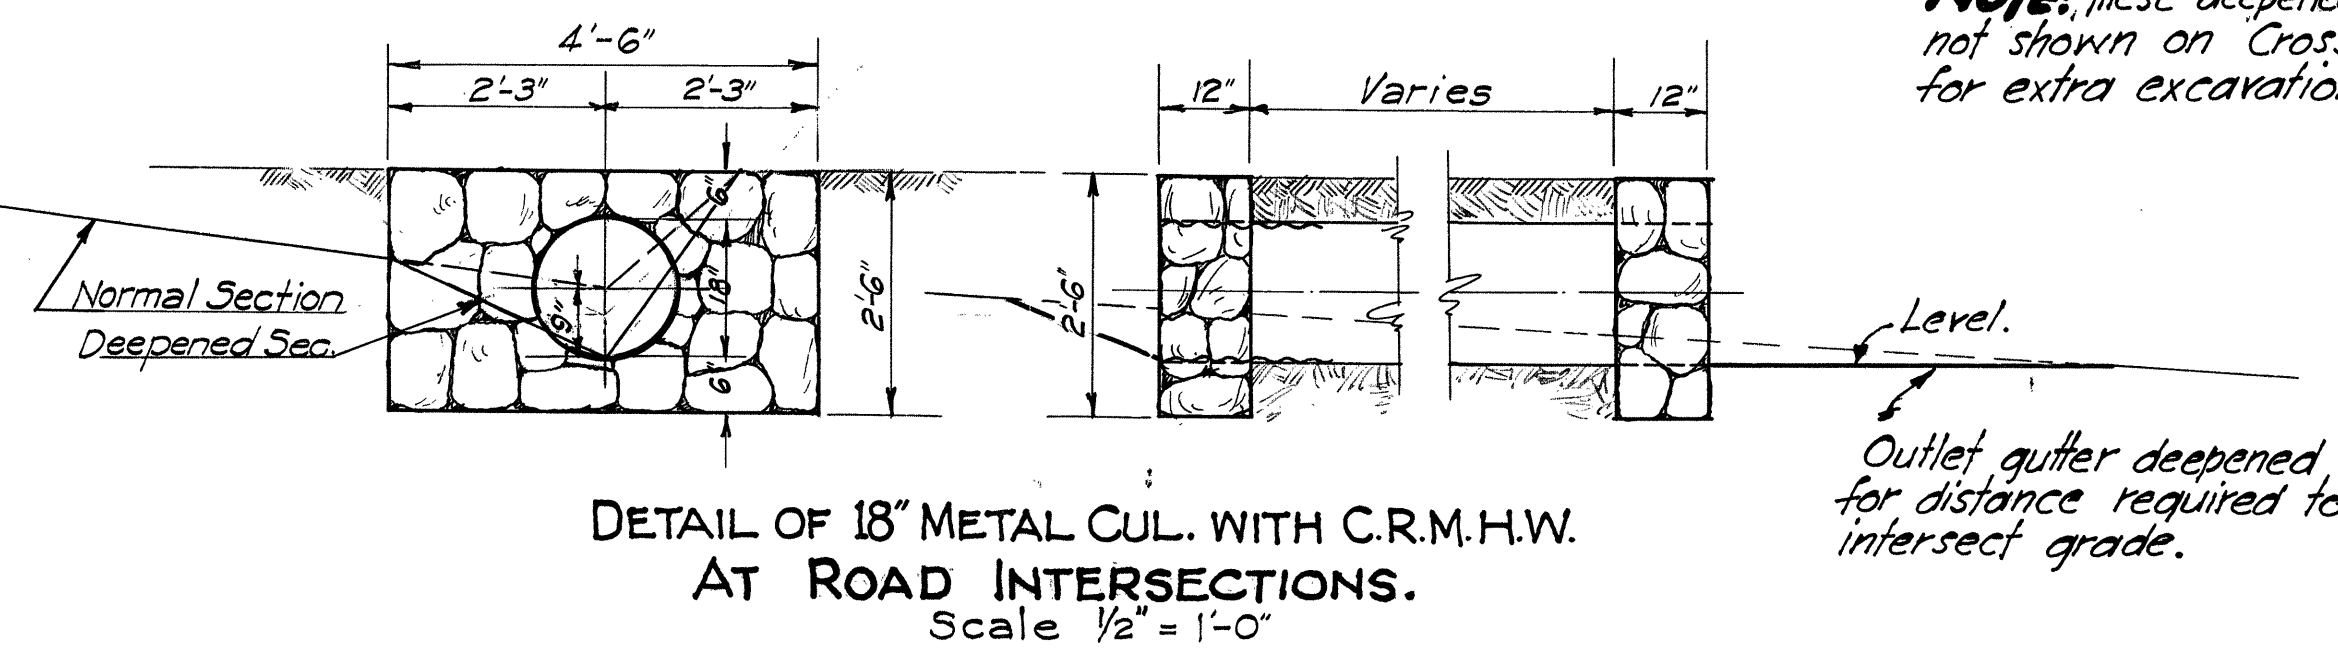
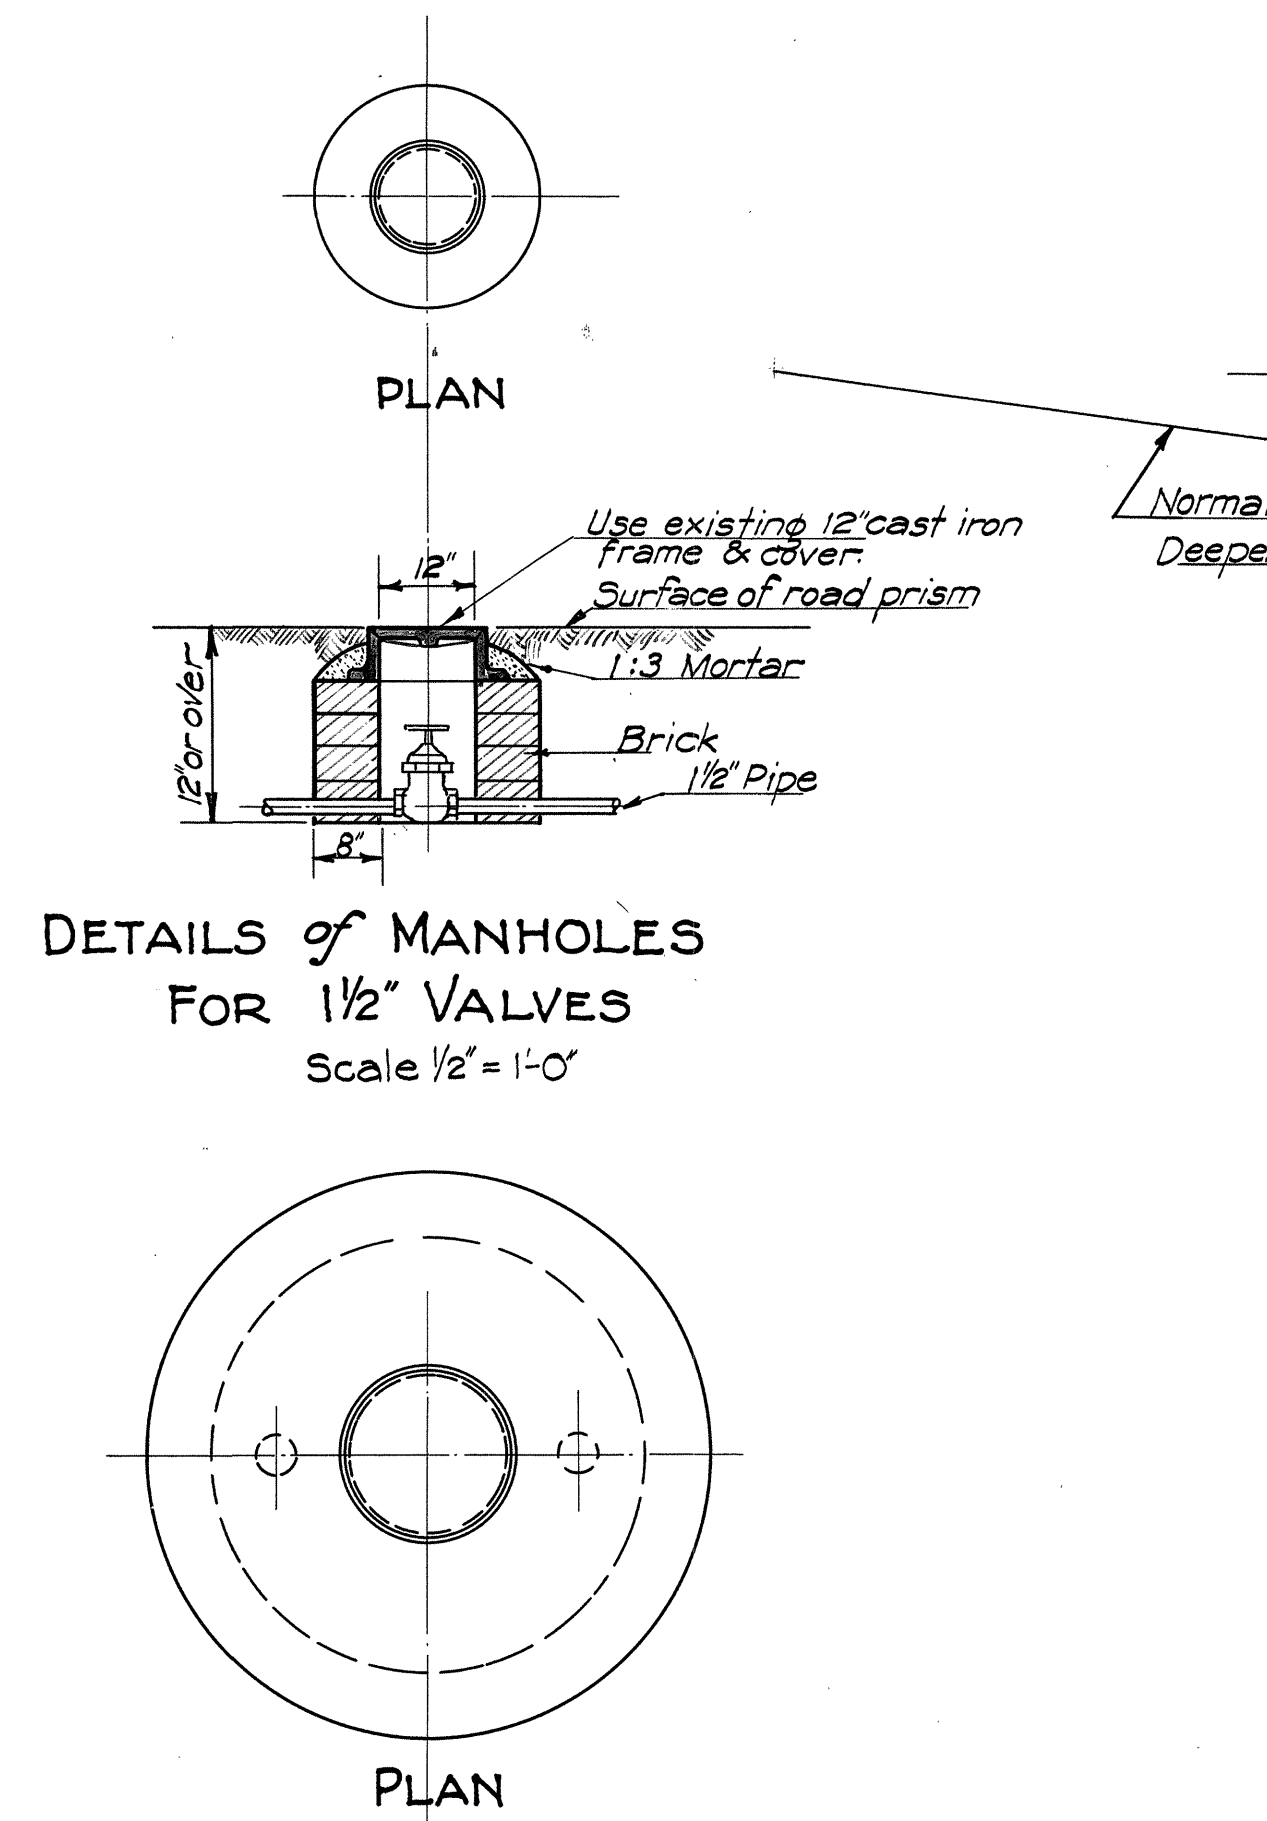
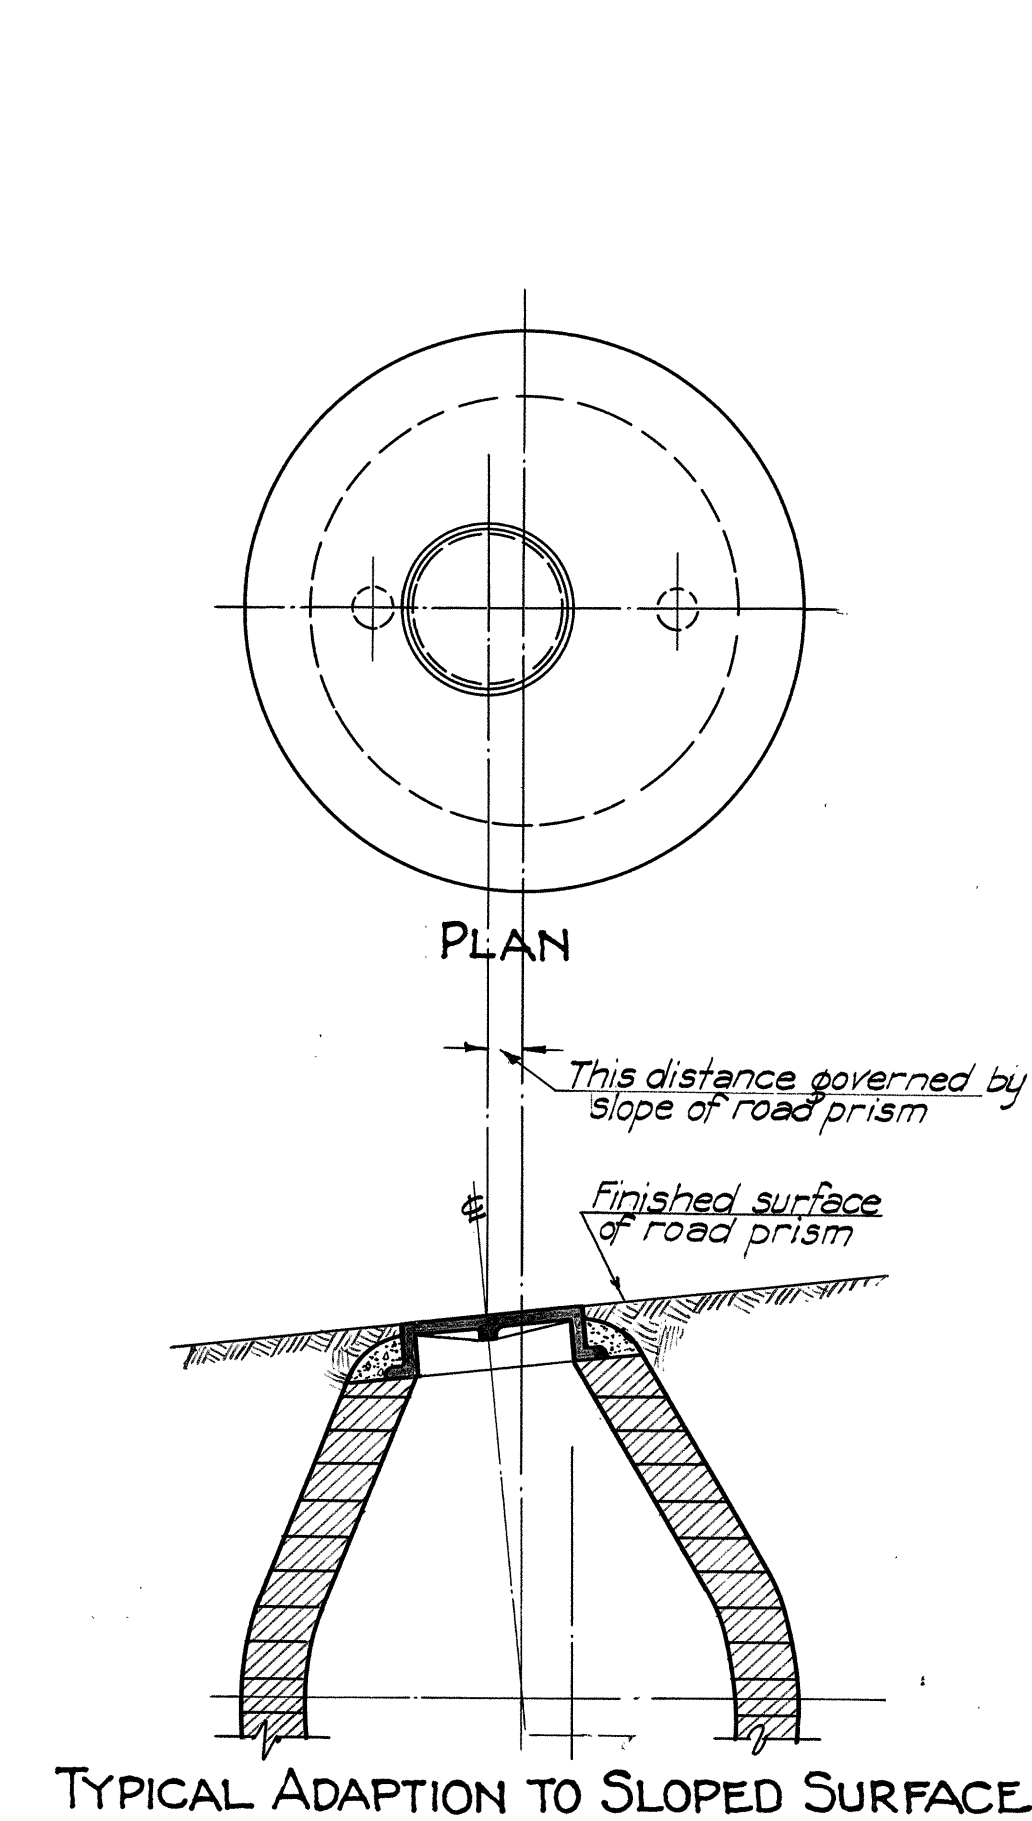
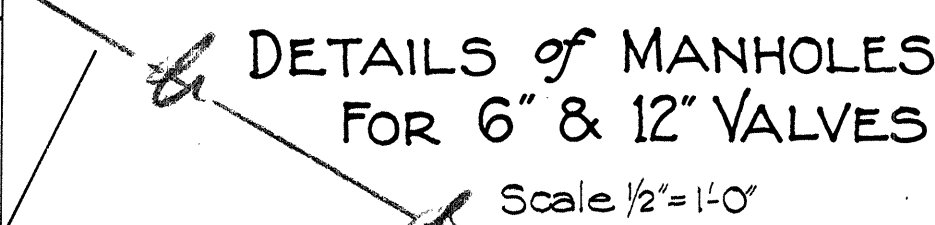


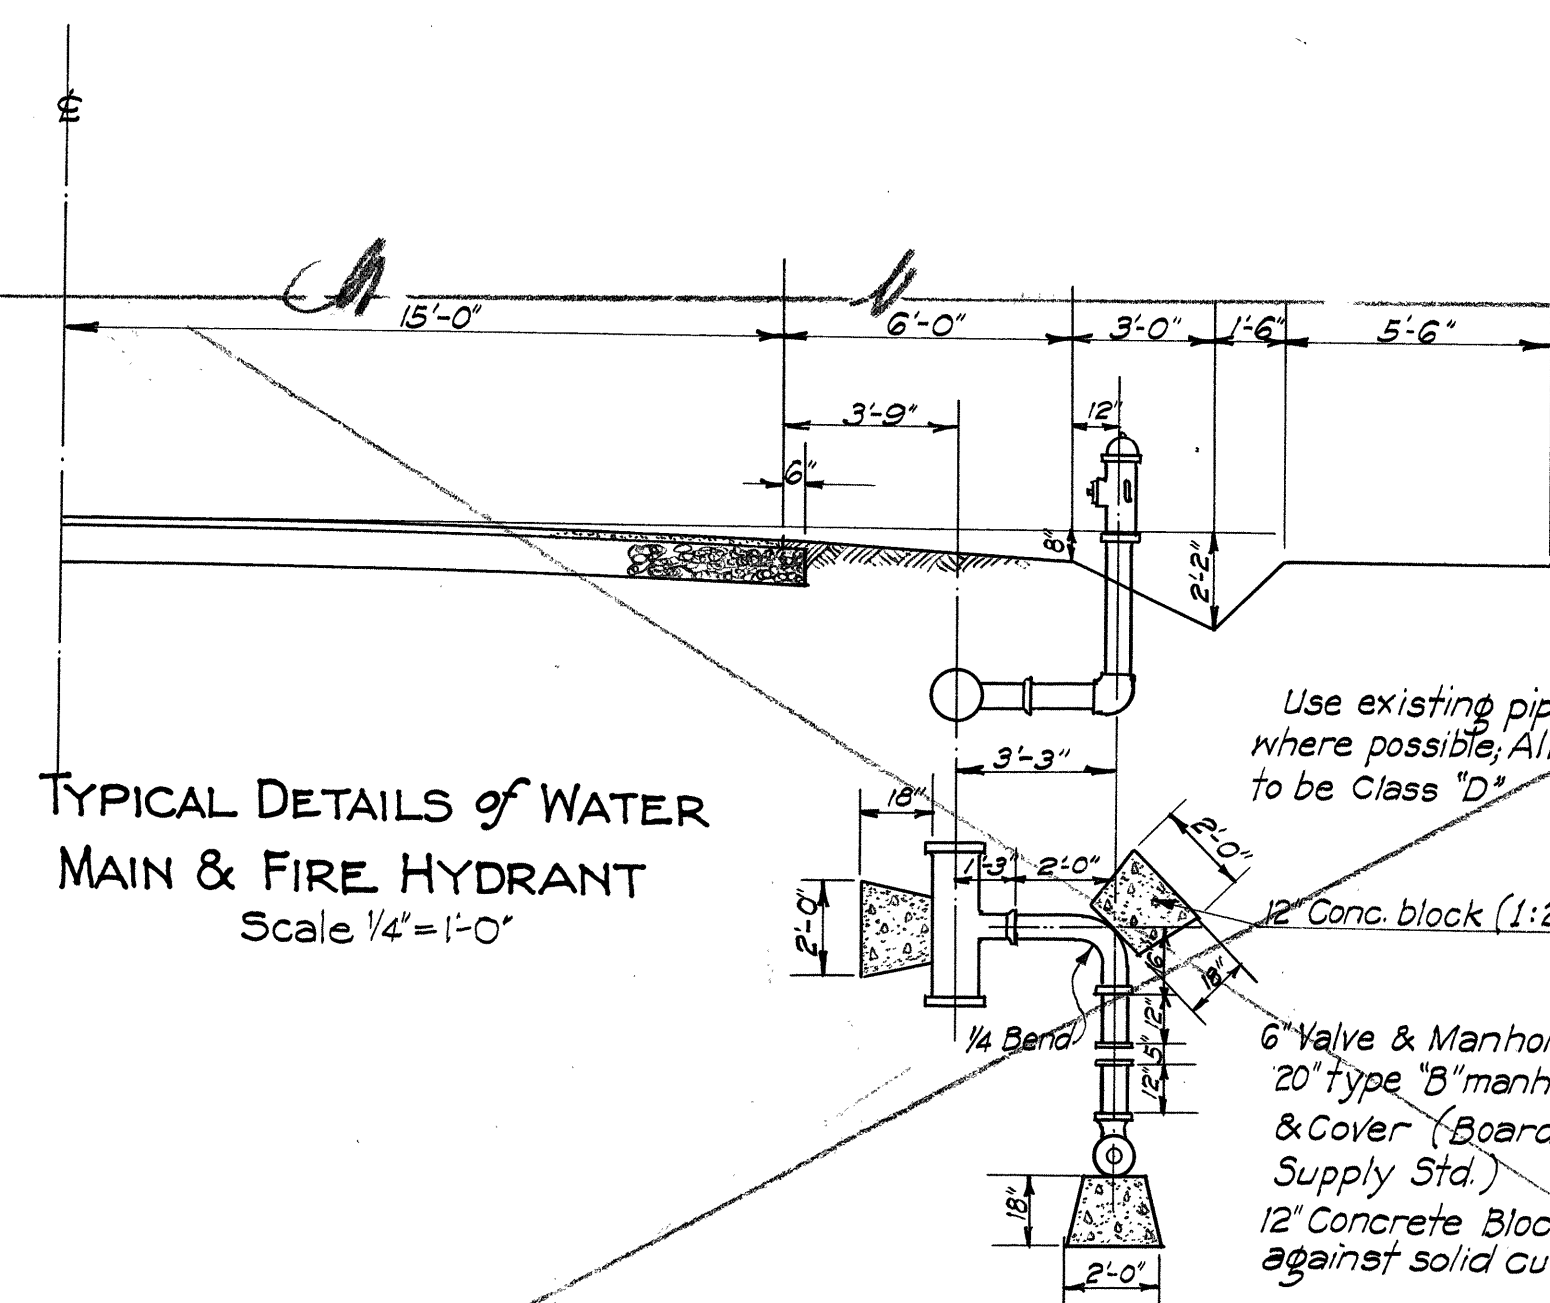

Note: These deepened outlet gutters are not shown on Cross Sections. Allowance for extra excavation made at each culvert.

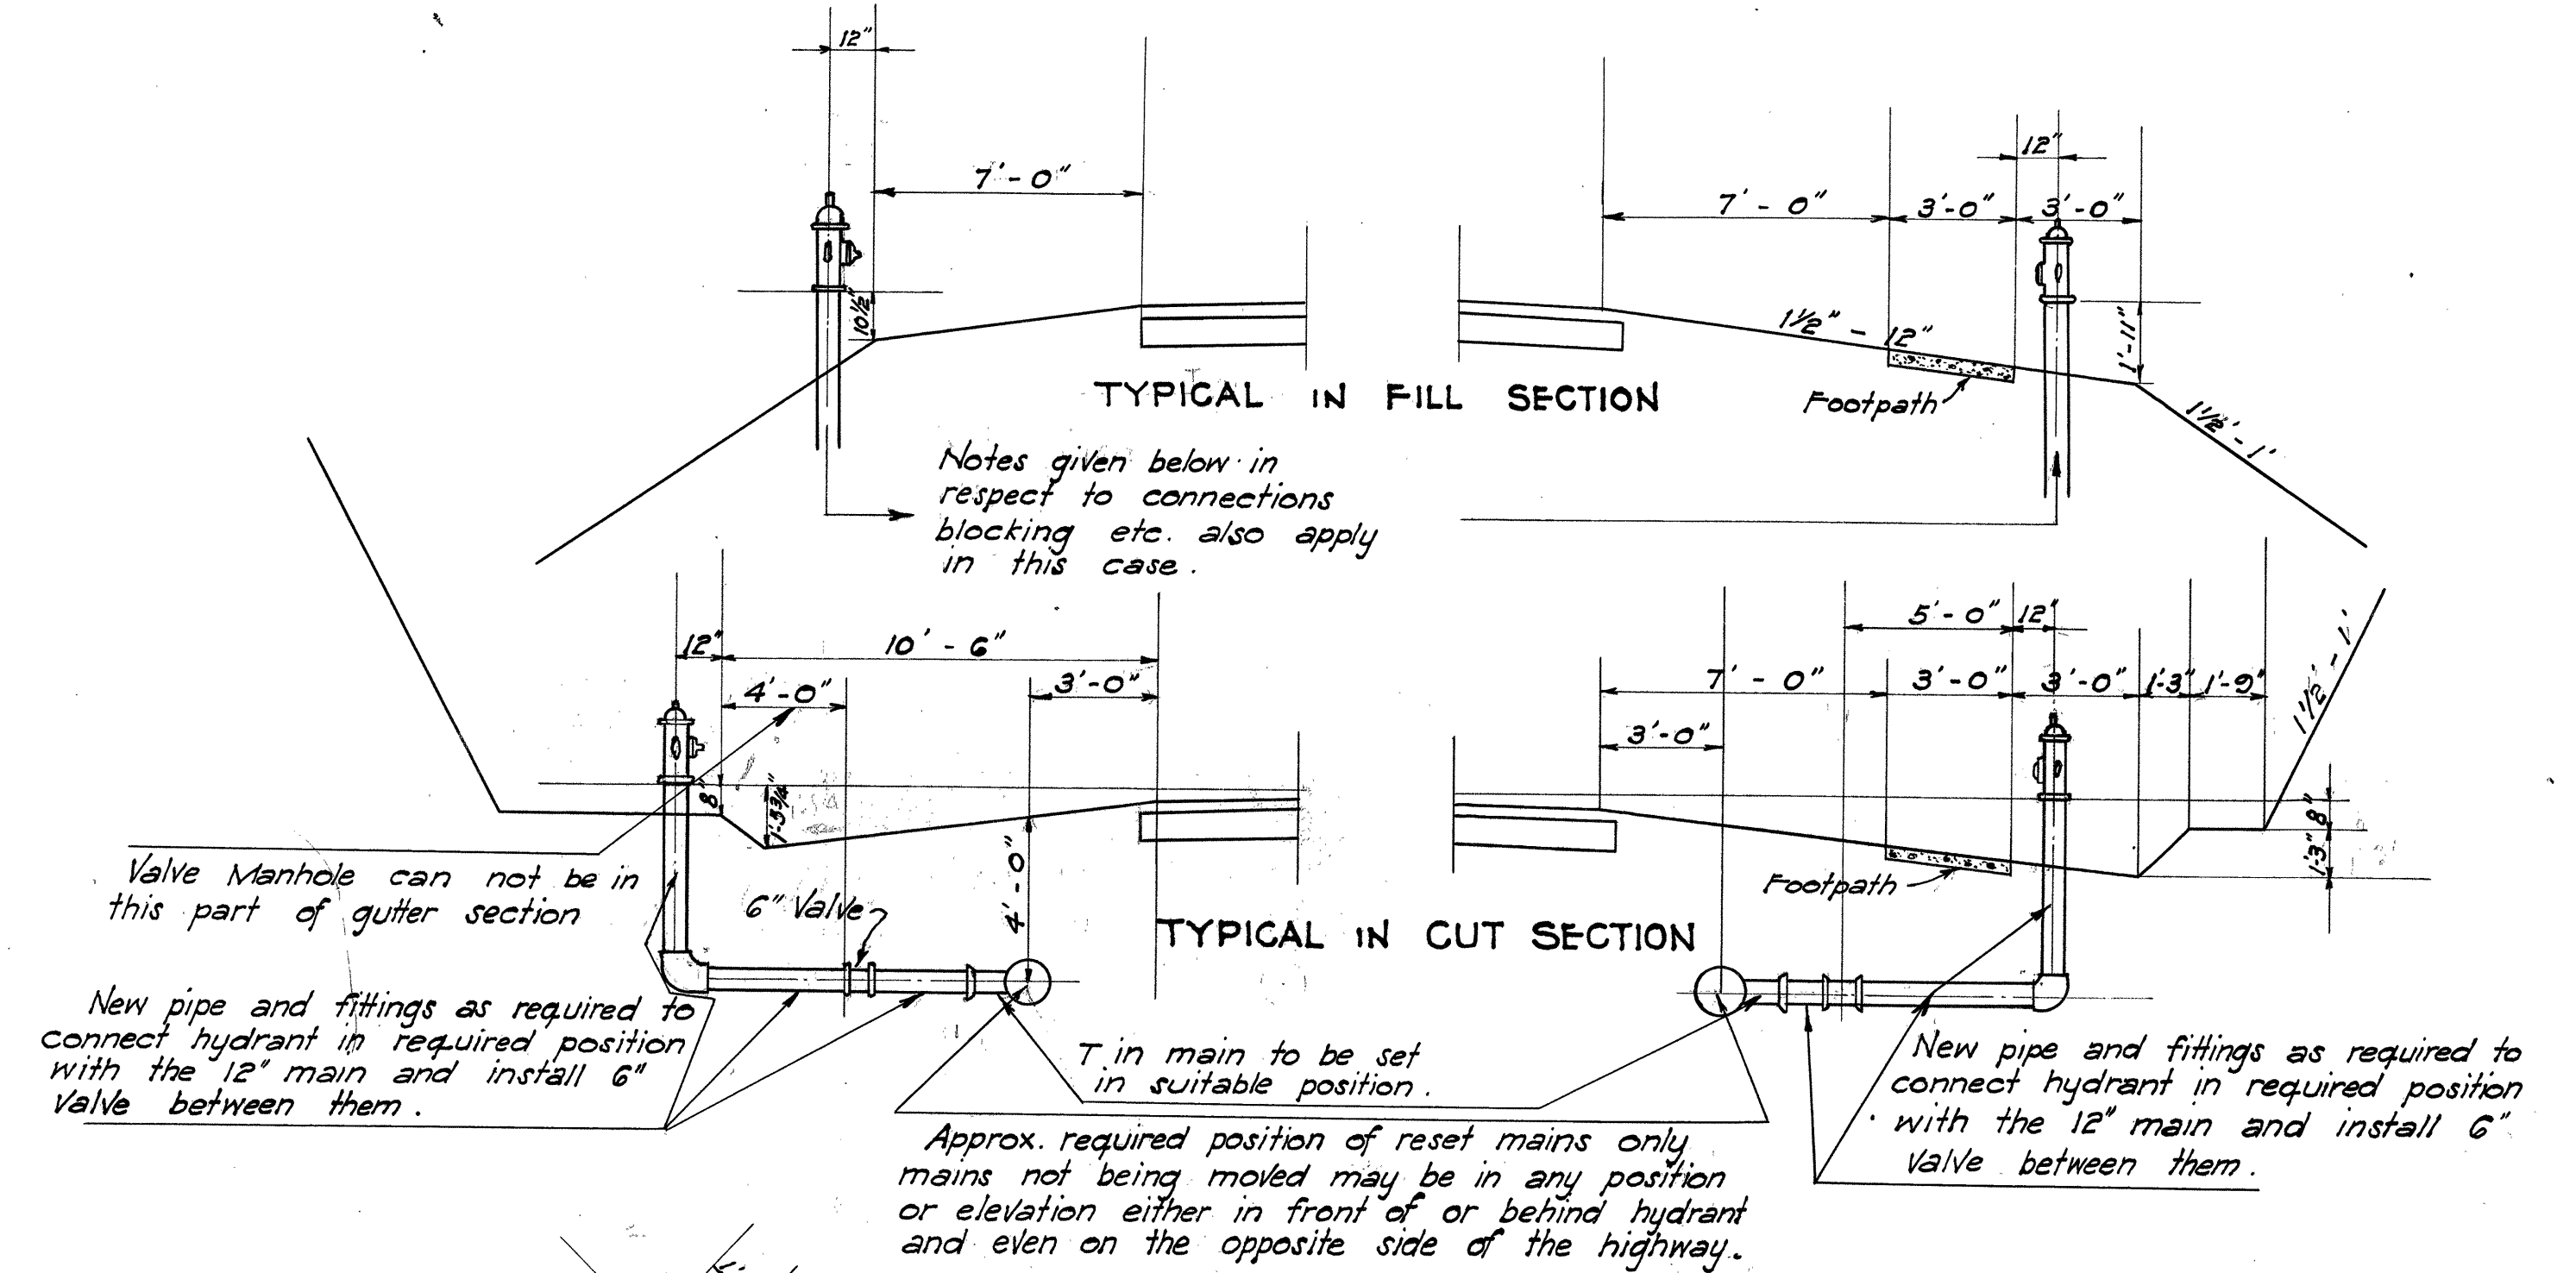

NOTE:
Above details are typical but must be varied to suit conditions (see plans). Requirements which must be met are: (1) Hydrant centered 12" outside of shoulder; (2) Minimum cover 4'-0" to main invert; (3) Rim of manhole for the 6" valve flush with finished surface of road section.

VOID

TYPICAL DETAILS OF FIRE HYDRANT AND CONNECTIONS TO WATER MAINS

Scale: 1/4" = 1'-0"