

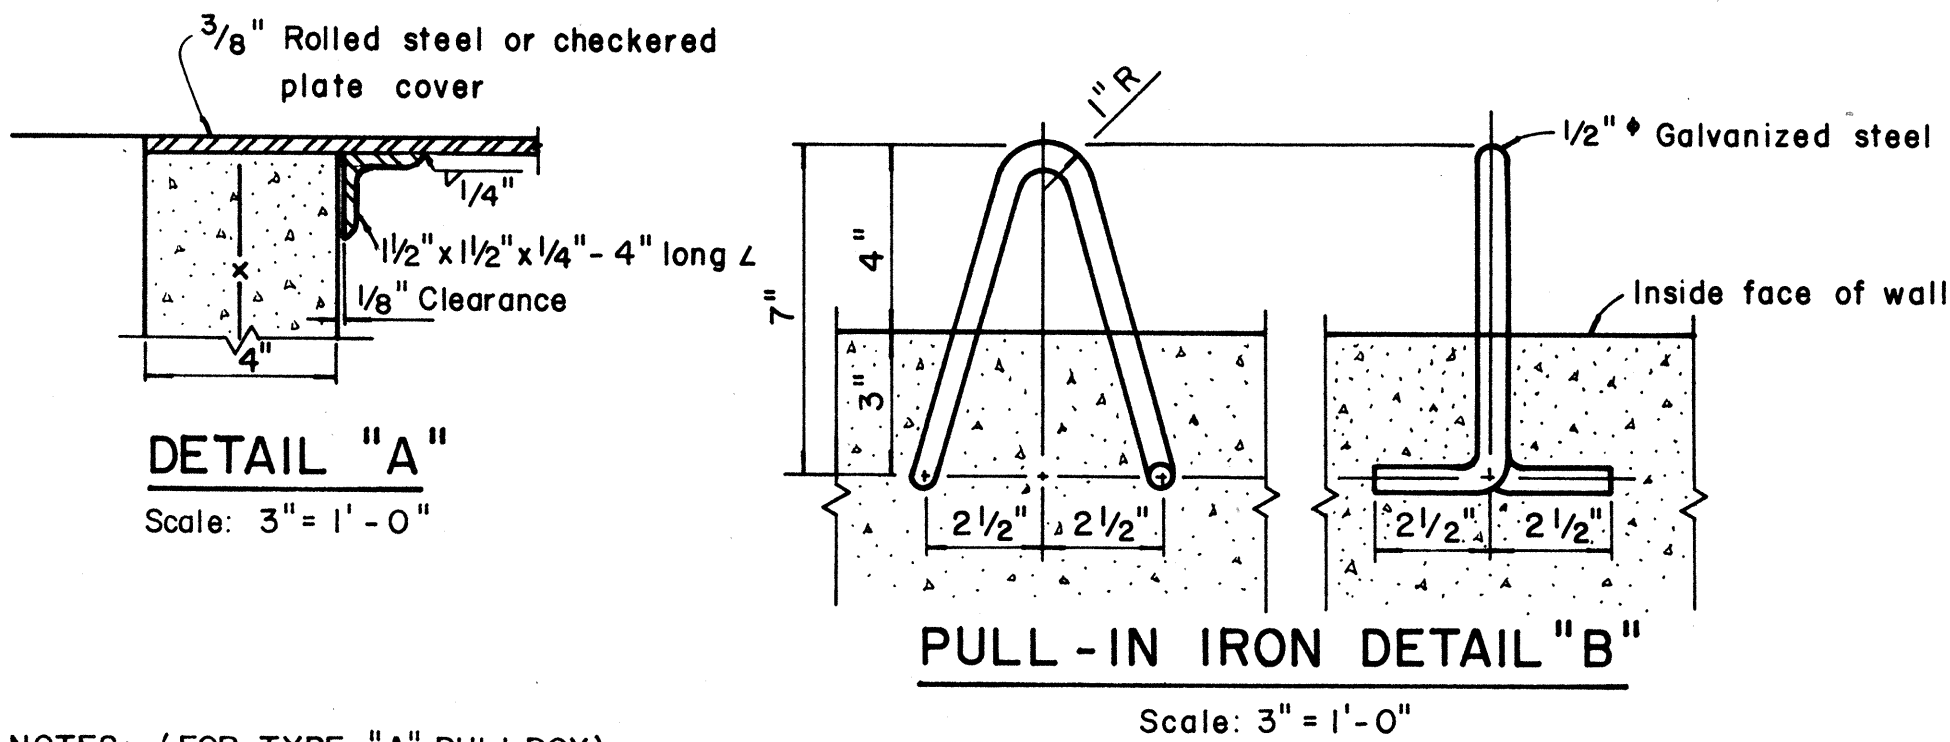
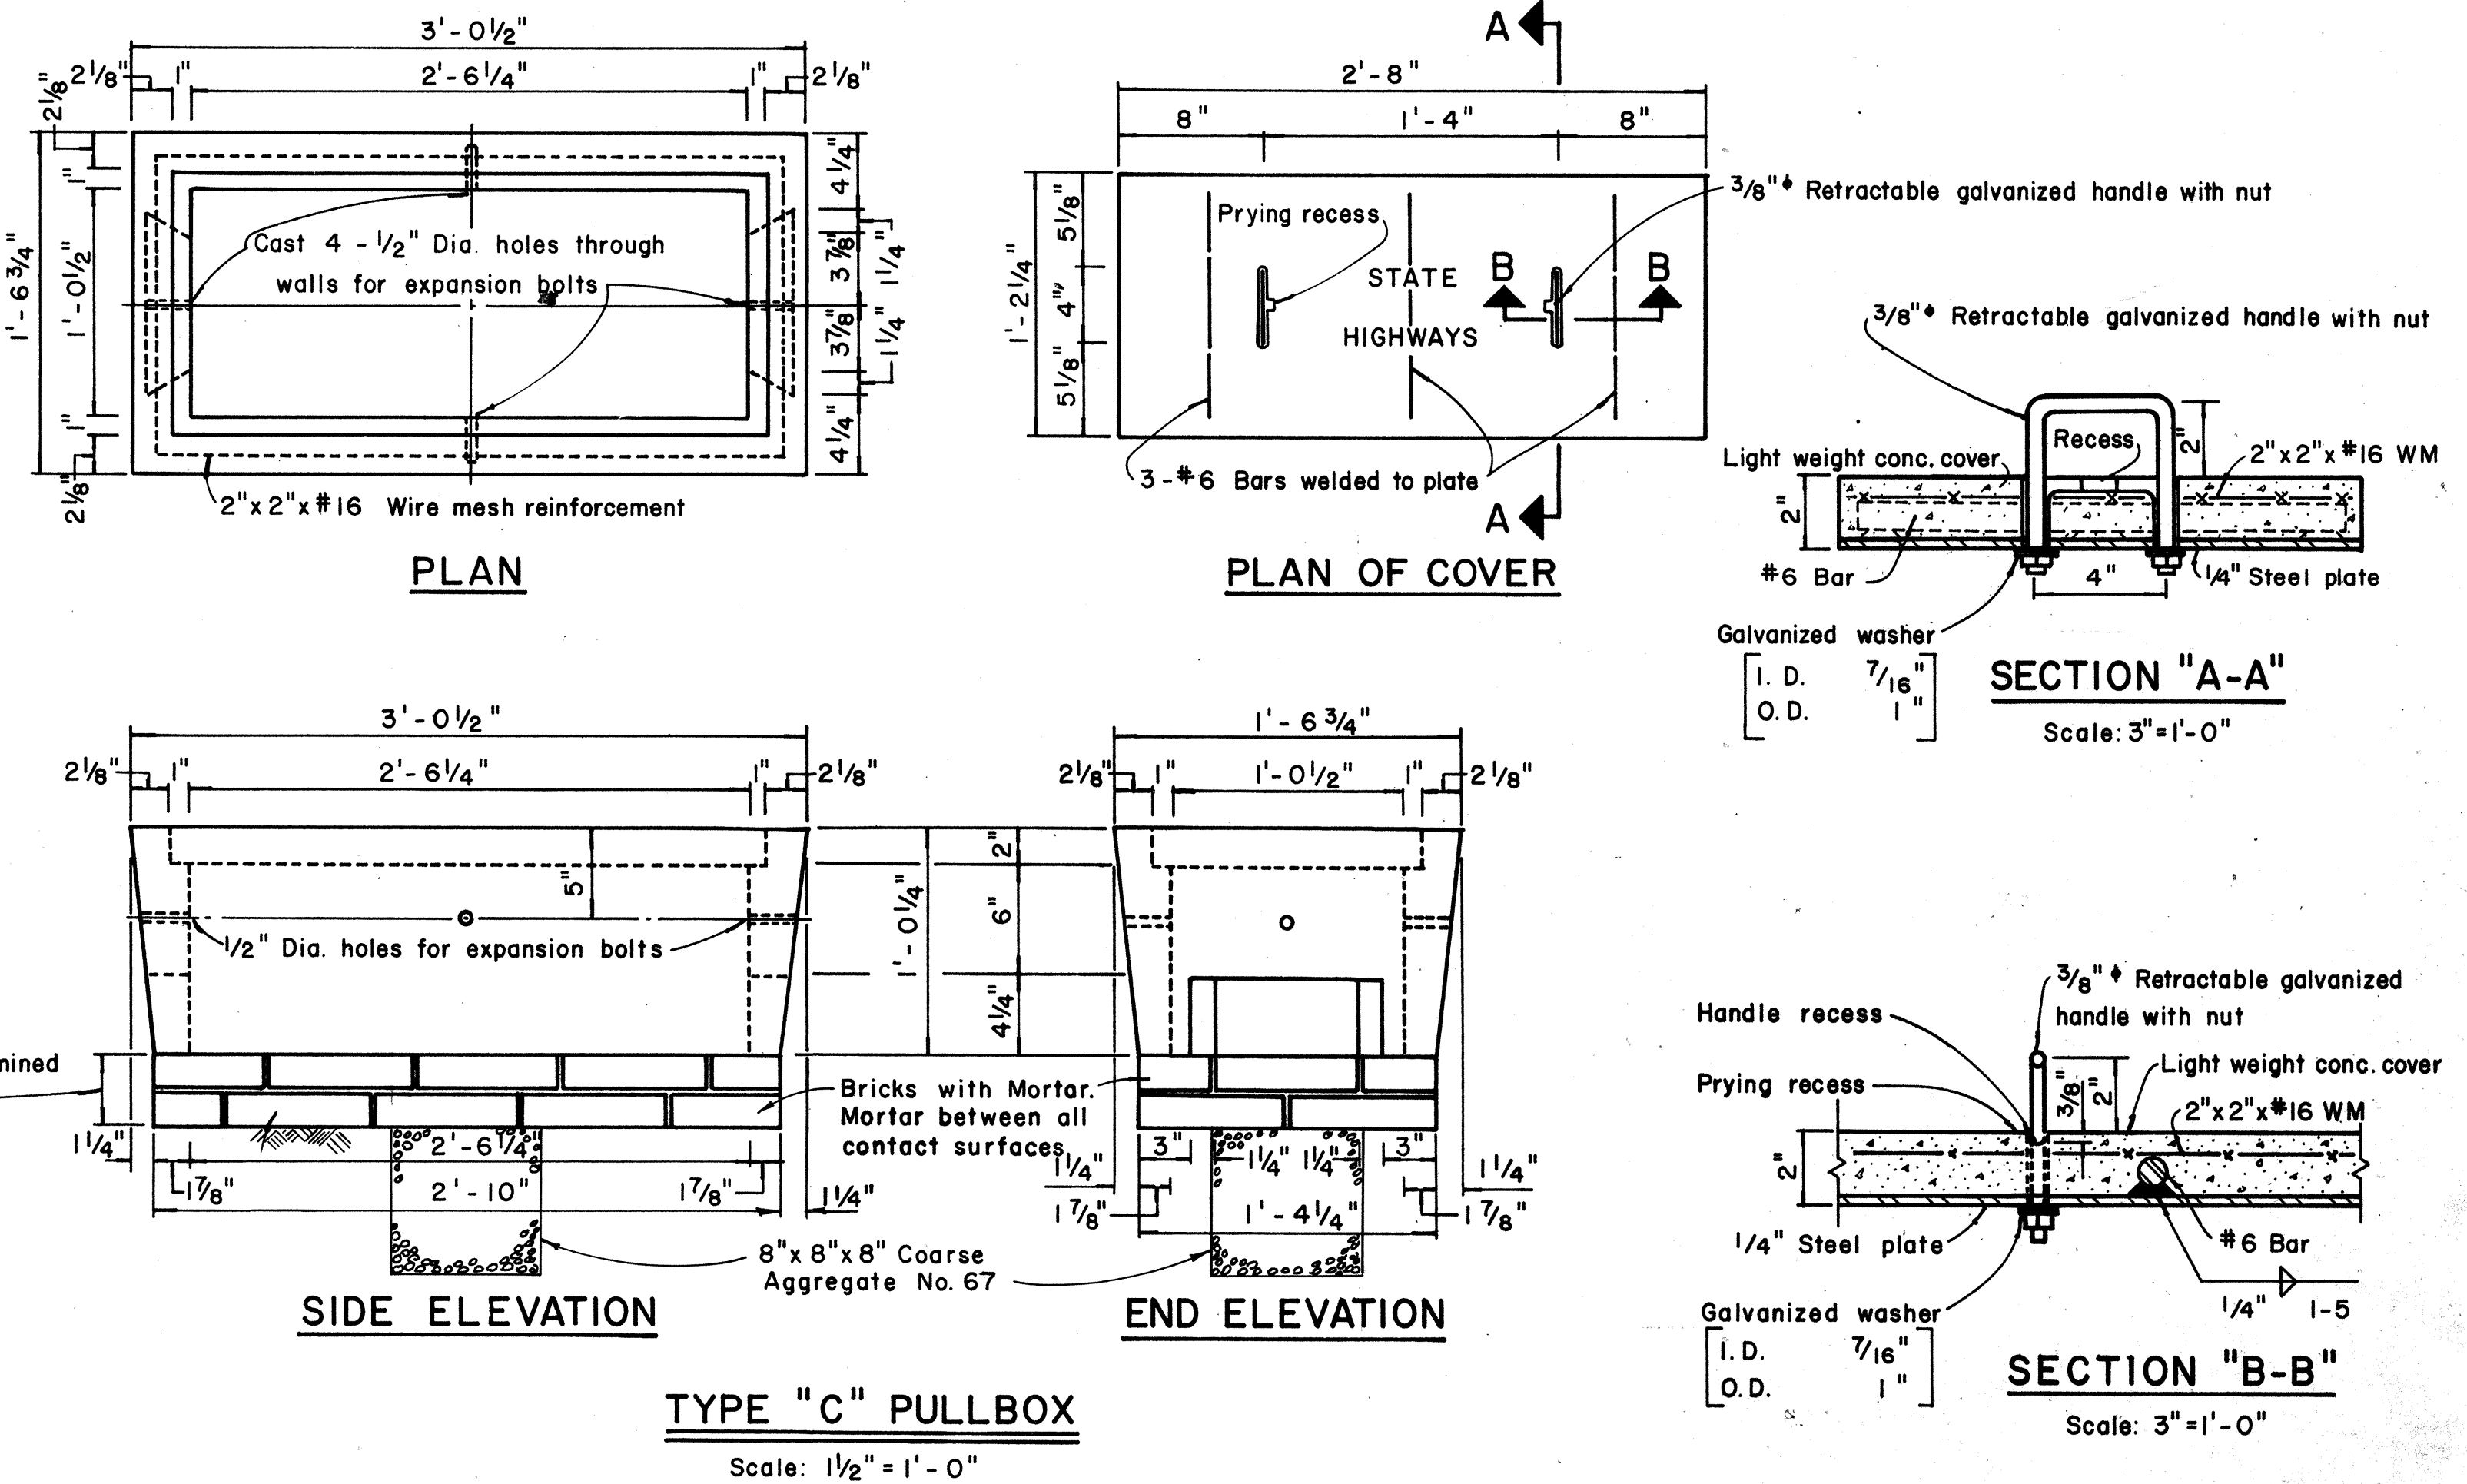


FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	72A-01-75	1977	4	4

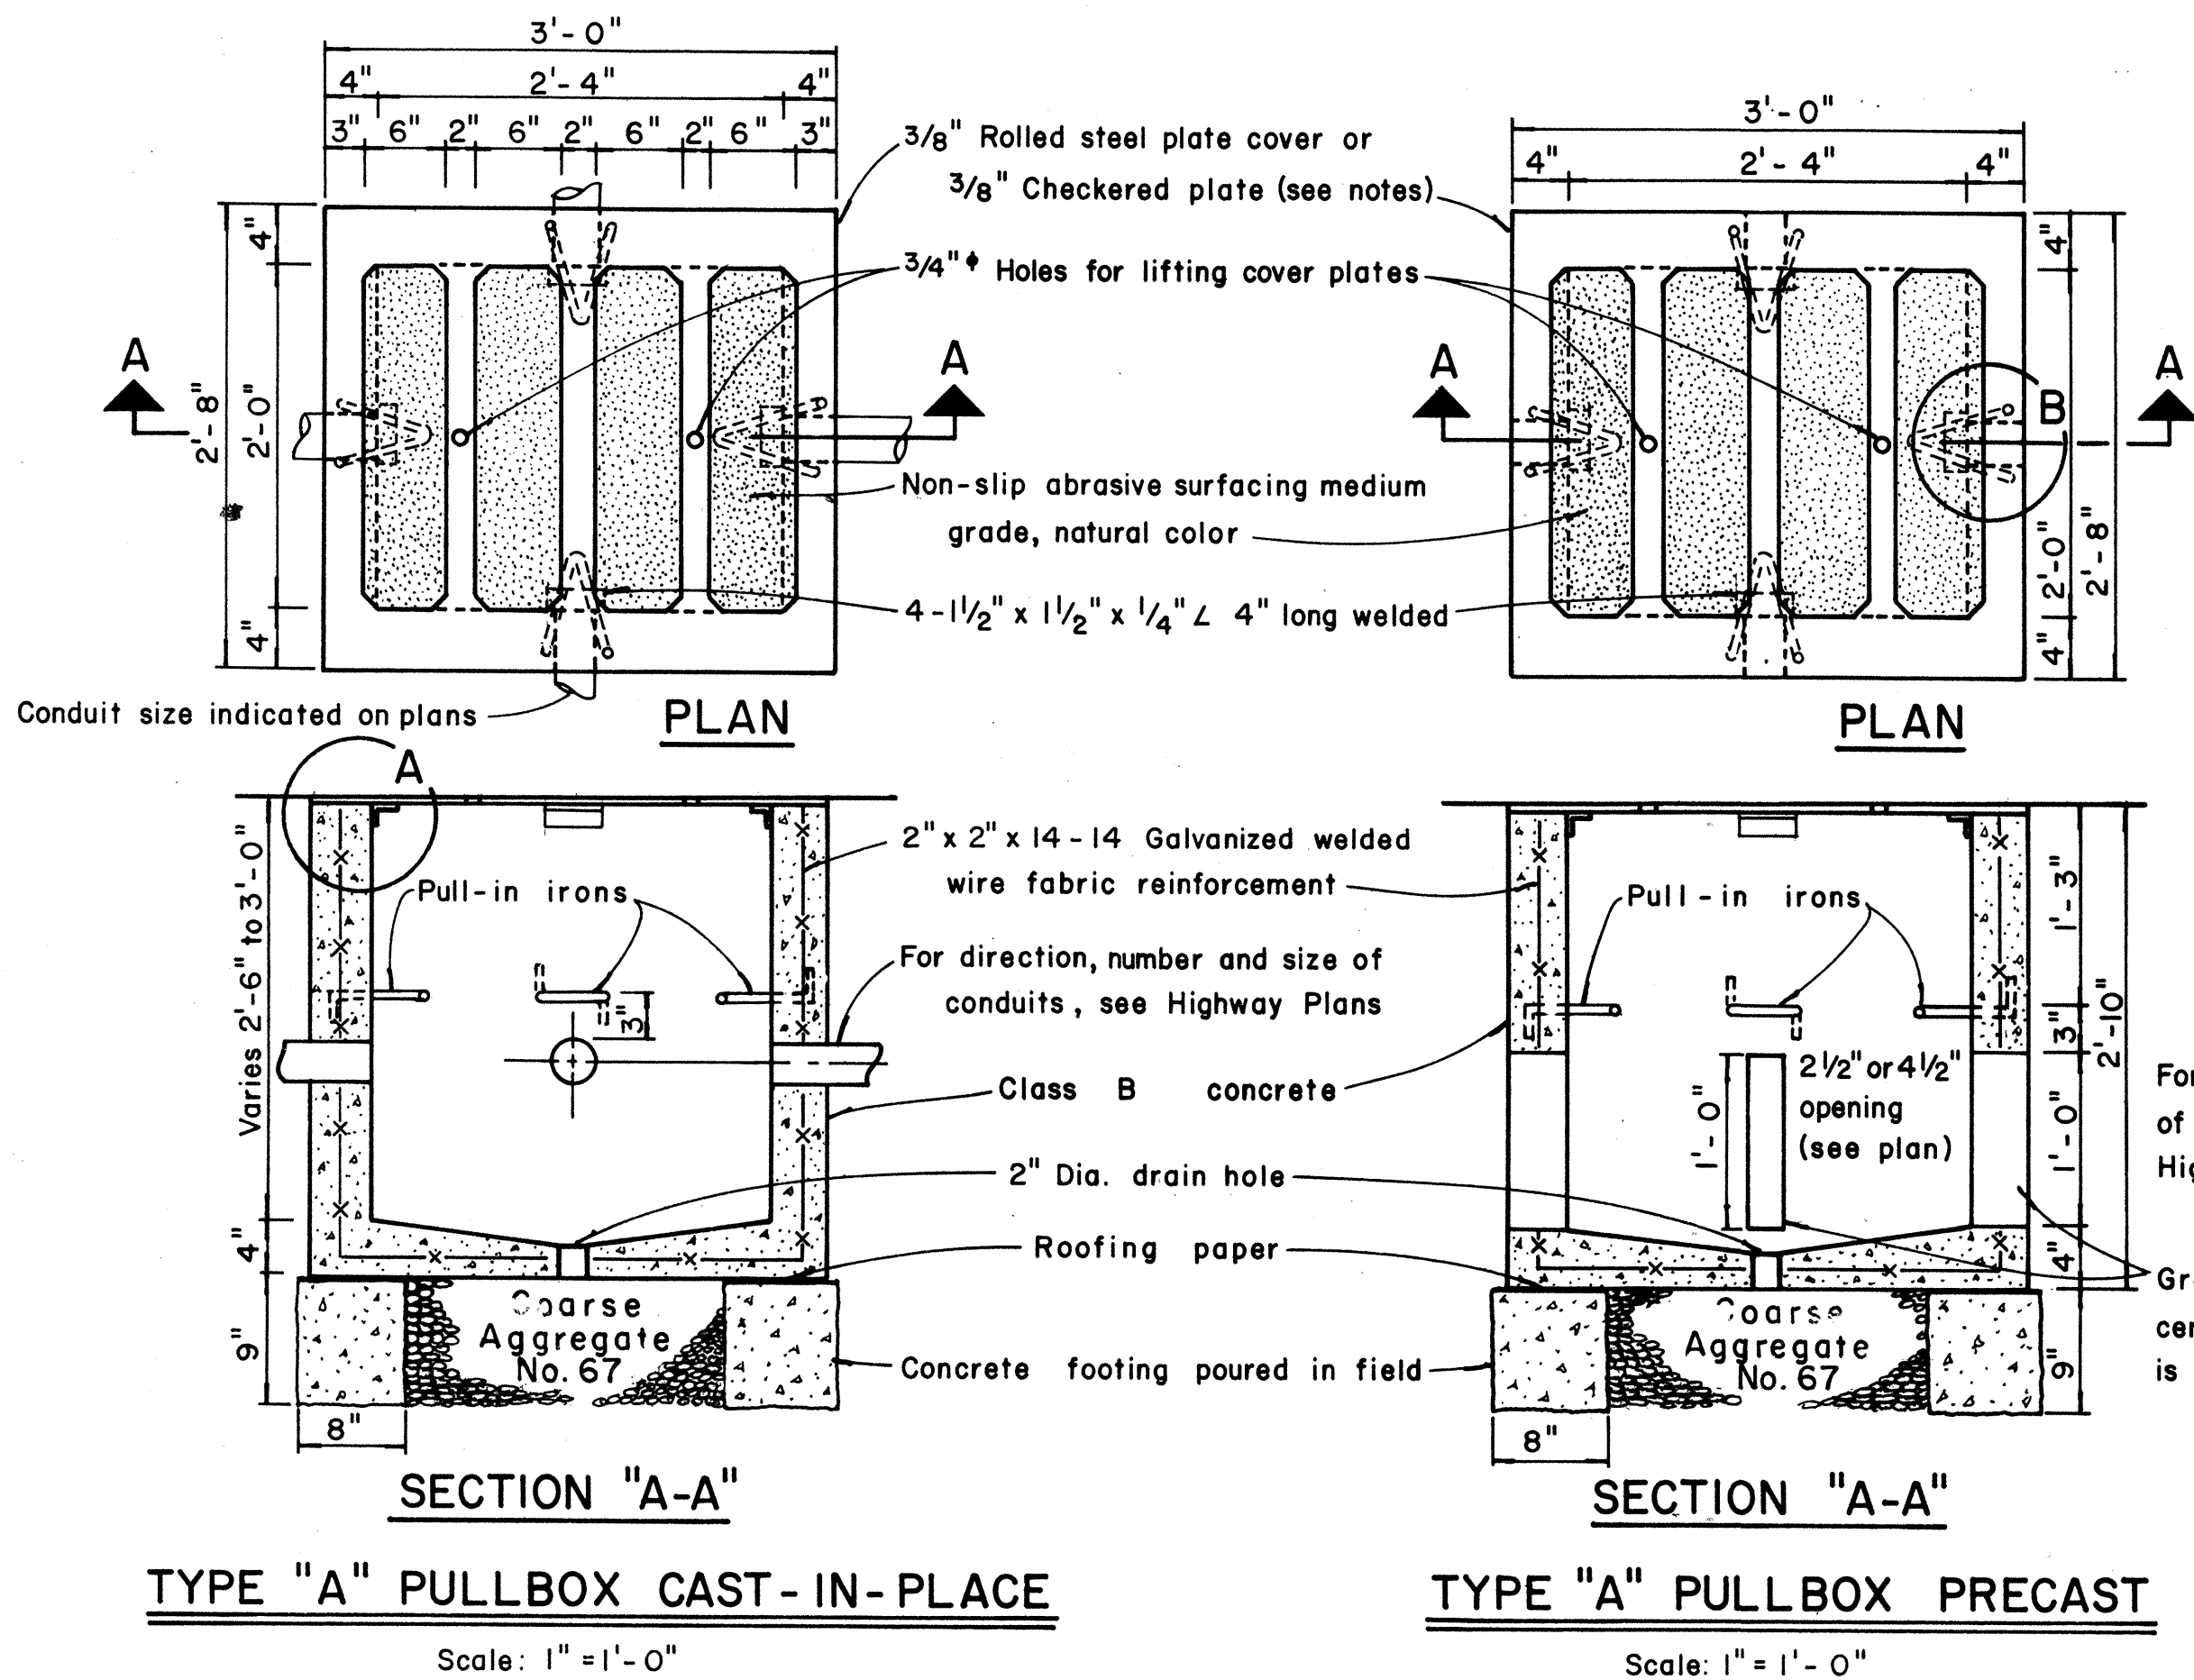

NOTES: (FOR TYPE "A" PULLBOX)

- 3/8" Rolled steel plate cover with non-slip abrasive surfacing medium grade, natural color shall be used on all pullboxes located on sidewalk areas where pedestrians are walking.
- 3/8" Checkered plate cover shall be used on all pullboxes located in median areas and other locations where there are no pedestrians walking.
- Pull irons shall be placed opposite each conduit slot.
- Covers on all pullboxes located in sidewalk areas shall be set flush with the concrete sidewalk.
- Each pullbox shall have a pair of pull irons opposite each other for lifting purposes.

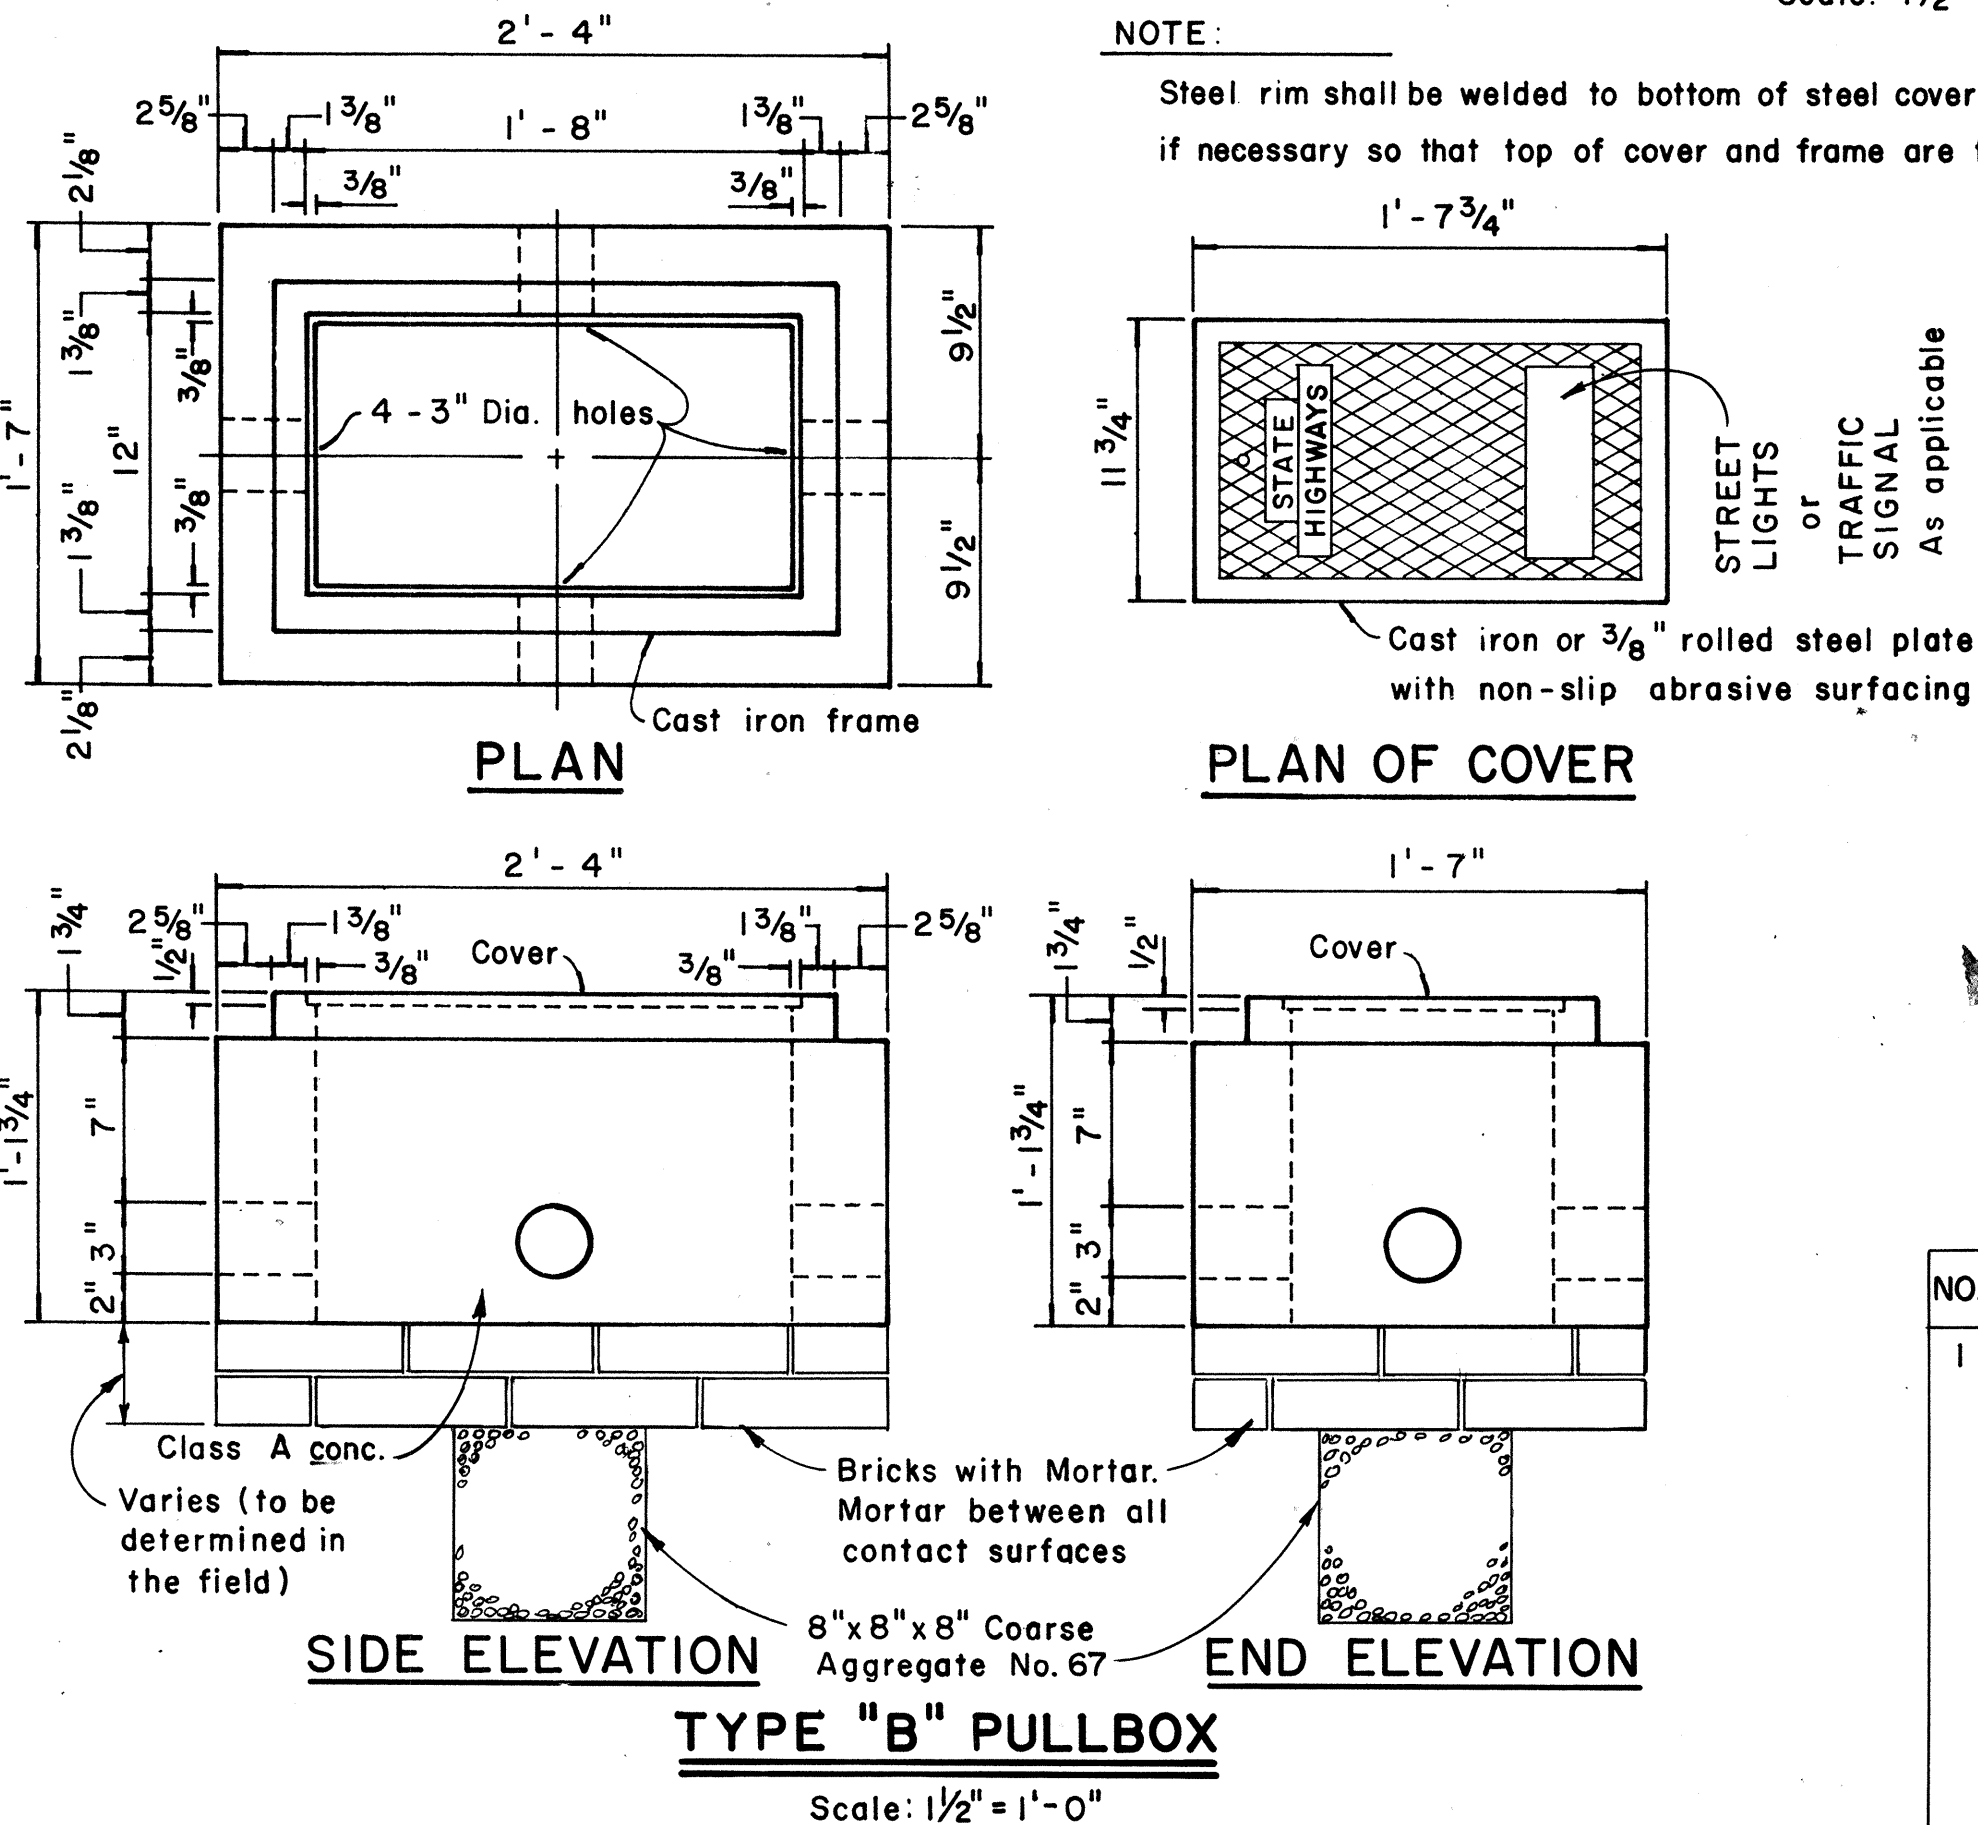

APPROVAL RECOMMENDED:
Eishi Tanaka 12/29/69
 TRAFFIC ENGINEER DATE

APPROVED:
Wm. R. Jones 12-30-69
 ASSISTANT CHIEF, ENGINEERING DATE

NO.	REVISION	APPROVED BY	DATE
1	Revised Type B & C Pullbox details	H.T.	3-5-76

STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HIGHWAYS DIVISION
STANDARD DETAILS PULLBOXES
KALANIANA'OLE HIGHWAY HIGHWAY LIGHTING AT KEOLU DRIVE PROJECT NO. 72A-01-75
Scale as noted Date
SHEET No. 4 OF 4 SHEETS DT 401

SURVEY PLOTTED BY	DATE
DESIGNED BY	
TRACED BY	
NOTE BOOK	
QUANTITIES BY	
CHECKED BY	
No.	