

HAWAIIAN ELECTRIC COMPANY (HECO) NOTES

FED. ROAD DIST. NO.	STATE	PROJECT NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	72A-02-06	2008	4	66

1. LOCATION OF HECO FACILITIES

The location of HECO's overhead and underground facilities shown on the plans are from existing records with varying degrees of accuracy and are not guaranteed as shown. The Contractor shall verify in the field the locations of the facilities and shall exercise proper care in excavating and working in the area. Wherever connections of new utilities to existing utilities and utility crossings are shown, the Contractor shall expose the existing lines at the proposed connections and crossings to verify the depths prior to excavation for the new lines. The Contractor shall be responsible for any damages to HECO's facilities whether shown or not shown on the plans.

2. COMPLIANCE WITH HAWAII OCCUPATIONAL SAFETY AND HEALTH LAWS

The Contractor shall comply with the State of Hawaii's Occupational Safety and Health Laws and Regulations, including without limitation, those related to working on or near exposed or energized electrical lines and equipment.

3. EXCAVATION PERMIT

The Contractor shall obtain an Excavation Permit from HECO's Technical Division (543-5654) located at 820 Ward Avenue, 4th floor, two weeks prior to starting construction. Please refer to HECO's request number at that time.

4. CAUTION!!! ELECTRICAL HAZARD!!!

Existing HECO overhead and underground lines are energized and will remain energized during construction unless prior special arrangements have been made with HECO. Only HECO personnel are to handle these energized lines and erect temporary guards to protect these lines from damage. The Contractor shall work cautiously at all times to avoid accidents and damage to existing HECO facilities, which can result in electrocution.

5. OVERHEAD LINES

State law (OSHA 1910.269(k)(2B)) requires that a worker and the longest object he or she may contact cannot come closer than a minimum radial clearance of 10 feet when working close to or under any overhead lines rated 50kV and below. For each additional 10kV above 50kV, an additional 4 inches shall be added to the 10-foot clearance requirement. The preceding information on line clearance requirements is provided as a convenience and it is the Contractor's responsibility to be informed of and comply with any revisions or amendments to the law.

Should the Contractor anticipate that his work will result in the need to encroach within the minimum required clearance at any time, the Contractor shall notify HECO at least four (4) weeks prior to the planned encroachment so that, if feasible, the necessary protections (e.g. relocate or de-energize HECO lines) can be put in place. HECO may also be able to blanket its distribution (12kV and below) lines to Provide a visual aid in preventing accidental contact. HECO's cost of safeguarding or identifying its lines will be charged to the Contractor.

Contact HECO's Customer Installations Department at 543-7846 for assistance in identifying and safeguarding overhead power lines.

Refer to Section X of HECO's Electric Service Installation Manual for additional guidelines when working around HECO's facilities. A copy may be obtained from HECO's Customer Installations Department.

6. POLE BRACING

A minimum clearance of 10 feet must be maintained when excavating around utility poles and/or their anchor system to prevent weakening or pole support failure. Should work require excavating within 10 feet of a pole and/or its anchor system, the Contractor shall protect, support, secure, and take all other precautions to prevent damage to or leaning of these poles. The Contractor is responsible for all associated costs to brace, repair, or straighten poles. All means of structural support for the pole proposed by the Contractor shall first be reviewed by HECO before implementation. For pole bracing instructions, the Contractor shall call the HECO Construction and Maintenance Dept., Customer & System Superintendent at 543-4223 a minimum of two (2) weeks in advance.

7. UNDERGROUND LINES

The Contractor shall exercise extreme caution whenever construction crosses or is in close proximity of underground lines. HECO's existing electrical cables are energized and will remain energized during construction. Only HECO personnel are to break into existing HECO facilities, handle these cables, and erect temporary guards to protect these cables from damage. The cost of HECO's assistance in providing proper support and protection of its underground lines will be charged to the Contractor. Special precautions are required when excavating near HECO's 138kV underground lines (see HECO Instructions to Consultants/Contractors on "Excavation Near HECO's Underground 138kV Lines" for detailed requirements).

For verification of underground lines, the Contractor shall call HECO's Underground Division at 543-7049 a minimum of 72 hours in advance.

For assistance in providing proper support and protection of these lines, the Contractor shall call HECO's Construction & Maintenance Dept., Customer & System Superintendent, at 543-4223, a minimum of two (2) weeks in advance.

8. UNDERGROUND FUEL PIPELINES

The Contractor shall exercise extreme caution whenever construction crosses or is in close proximity of HECO's underground fuel oil pipelines. Special precautions are required when excavating near HECO's underground fuel oil pipelines (see HECO Instructions to Consultants/Contractors on "Excavation Near HECO's Underground Fuel Pipelines" for detailed requirements).

9. EXCAVATIONS

When trench excavation is adjacent to or beneath HECO's existing structures or facilities, the Contractor is responsible for:

- sheeting and bracing the excavation and stabilizing the existing ground to render it safe and secure and to prevent possible slides, cave-ins, and settlements.
- properly supporting existing structures or facilities with beams, struts, or under-pinnings to fully protect it from damage.
- backfilling with proper backfill material including special thermal backfill where existing (refer to Engineering Department for thermal backfill specifications).

10. RELOCATION OF HECO FACILITIES

Any work required to relocate or modify HECO facilities shall be done by HECO, or by the Contractor under HECO's supervision. The Contractor shall be responsible for all coordination, and shall provide necessary support for HECO's work, which may include, but not be limited to, excavation and backfill, permits and traffic control, barricading, and restoration of pavement, sidewalks, and other facilities.

All costs associated with any relocation or modification (either temporary or permanent) for the convenience of the Contractor, or to enable the Contractor to perform his work in a safe and expeditious manner in fulfilling his contract obligations shall be borne by the Contractor.

11. CONFLICTS


Any redesign or relocation of HECO's facilities not shown on the plans may be cause for lengthy delays. The Contractor acknowledges that HECO is not responsible for any delay or damage that may arise as a result of any conflicts discovered or identified with respect to the location or construction of HECO's electrical facilities in the field, regardless of whether the Contractor has met the requested minimum advance notices. In order to minimize any delay or impact arising from such conflicts, HECO should be notified immediately upon discovery or identification of such conflict.

12. DAMAGE TO HECO FACILITIES

The Contractor shall be responsible for the protection of all HECO surface and subsurface utilities and shall be responsible for any damages to HECO's facilities as a result of his operations. The Contractor shall immediately report such damages to HECO's Trouble Dispatcher at 548-7961. Repair work shall be done by HECO or by the Contractor under HECO's supervision. Costs for damages to HECO's facilities shall be borne by the Contractor.

In case of damage or suspected damage to HECO's fuel pipeline, the Contractor shall immediately notify HECO's Honolulu Power Plant Shift Supervisor at 533-2102 (a 24-hour number) so HECO personnel can secure the damaged section and report any oil spills to the proper authorities. All costs associated with the damage, repair, and oil spill cleanup shall be borne by the Contractor.

ORIGINAL PLAN	SURVEY PLOTTED BY	DATE
NOTE BOOK	DESIGNED BY	
	QUANTITIES BY	
	CHECKED BY	
No.		

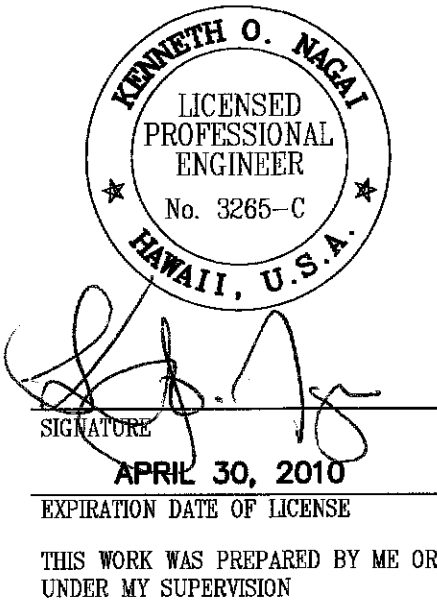

STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HIGHWAYS DIVISION
GENERAL NOTES AND LEGEND
KALANIANA'OLE HIGHWAY MEDIAN IMPROVEMENTS VICINITY OF OLOMANA GOLF COURSE PROJECT NO. 72A-02-06
DATE: June 2008
SHEET No. C-4 OF 43 SHEETS

HAWAIIAN ELECTRIC COMPANY (HECO) NOTES CONT.

FED. ROAD DIST. NO.	STATE	PROJECT NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	72A-02-06	2008	4	66

13. HECO STAND-BY PERSONNEL

The Contractor may request HECO to provide an inspector to stand-by during construction near HECO's facilities. The cost of such inspection will be charged to the Contractor.

The Contractor shall call the HECO Construction and Maintenance Dept., Customer & System Superintendent at 543-4223 a minimum of 5 working days in advance to arrange for HECO stand-by personnel.

14. CLEARANCES

The following clearances shall be maintained between HECO's ductline and all adjacent structures (charted and uncharted) in the trench:

Structure Type	Minimum Clearance(inches)
Water Lines, Parallel	36 (a)
Water Lines, Crossing	12 (b)
Sewer Lines, Parallel	36 (c)
Sewer Lines, Crossing	24 (d)
Drain Lines, Parallel	12
Drain Lines, Crossing	6 (e)
Electrical and Gas Lines, Parallel	12
Electrical and Gas Lines, Crossing	12
Telephone Lines, Parallel	6 (e)
Telephone Lines, Crossing	6 (e)
Chevron Oil Lines, Parallel	36
Chevron Oil Lines, Crossing	48 below oil line (f)

- (a) The minimum horizontal clearances to water lines parallel to electrical ductlines must be increased to 60 inches if the water line is greater than 16 inches in diameter
- (b) The minimum vertical clearances to water lines crossing electrical ductlines can be reduced to 6 inches if the electrical ductline structure is concrete encased and is below the water line and the water line is less than 16 inches in diameter.
- (c) A minimum horizontal clearance of 36 inches is required between new handholes and existing sewer laterals.
- (d) The minimum vertical clearances to sewer pipes crossing electrical ductlines can be reduced to 12 inches if the sewer pipe is jacketed in concrete.
- (e) The minimum clearances shall be increased to 12 inches if the electrical ductline is direct buried.
- (f) The minimum vertical clearances to oil lines crossing electrical ductlines can be reduced to 24 inches below oil lines if the crossings are encased in 6 inches of concrete.

The Contractor shall notify the Engineer & HECO of any heat sources (power cable duct bank, steamline, etc.) encountered that are not properly identified on the drawing.

The following clearance shall be maintained between HECO's fuel oil pipelines and all adjacent structures: 24-inches, parallel or crossing. The minimum clearance can be reduced to 12 inches (parallel and below only) if the structure is jacketed in concrete.

15. INDEMNITY

The Contractor shall indemnify, defend and hold harmless HECO from and against all losses, damages, claims, and actions, including but not limited to reasonable attorney's fees and costs based upon or arising out of damage to property or injuries to persons, or other tortious acts caused or contributed to by Contractor or anyone acting under its direction or control or on its behalf; provided Contractor's indemnity shall not be applicable to any liability based upon the sole negligence of HECO.

16. SCHEDULE

Contractor shall furnish his construction schedule 45 working days prior to starting work on HECO facilities. Contractor shall give HECO, in writing, 40 working days notice to proceed with HECO's portion of work.

17. AUTHORITY

All construction, restoration work, and inspection shall be subject to whichever governmental agency has authority over the work.

18. SPECIFICATIONS

Construction of HECO's underground facilities shall be constructed in accordance with the latest revisions of HECO Specifications CS7001, CS7003, CS7202, CS9301, and CS9401 and applicable HECO Standards.

19. CONSTRUCTION

Contractor shall furnish all labor, materials, equipment, and services to properly perform and fully complete all work shown on the contract, drawings, and specifications. All materials shall be new and manufactured in the United States of America. All manhole, handhole, and ductline installations shall be inspected and approved by HECO prior to excavation and prior to placing concrete. Contractor shall notify HECO's Inspection Division at 543-4356 at least 48 hours prior to placing concrete.

Contractor to coordinate work to break into HECO's existing electrical facilities with HECO's Underground Division at 543-7871 at least 10 working days in advance.

20. STAKEOUT

The Contractor shall arrange for toneouts of all underground facilities and shall stakeout all proposed HECO facilities within the project area so as to not conflict with any utility (existing or proposed) and any proposed construction or improvement work for verification by HECO before proceeding with HECO work.

21. DUCTLINES

All ductline installations shall be PVC Schedule 40 encased in concrete, unless otherwise noted. All completed ductlines shall be mandrel tested by the Contractor in the presence of HECO's inspector using HECO's Standard Practice. The Contractor shall install a 1/8" polyolefin pull line in all completed ductlines after mandrel testing is complete.


22. JOINT POLE REMOVAL

The last joint pole occupant off the poles shall remove the poles.

23. AS-BUILT PLANS

The Contractor shall provide HECO with two sets of as-built reproducible tracings showing the offsets, stationing, and vertical elevation of the duct line(s) constructed.

SURVEY PLOTTED BY	DATE
DRAWN BY	
DESIGNED BY	
NOTED BY	
CHECKED BY	
ORIGINAL PLAN	
NOTE BOOK	
No.	

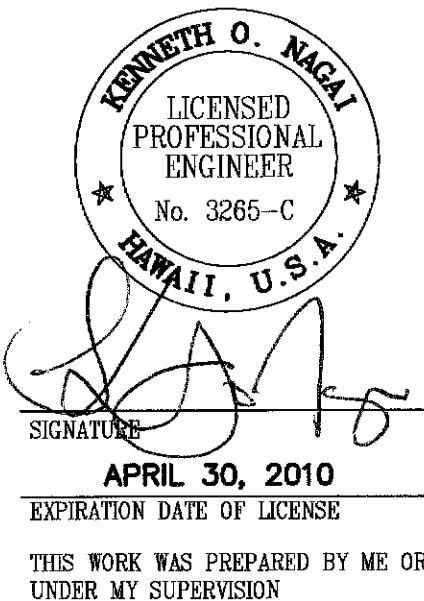

STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HIGHWAYS DIVISION
GENERAL NOTES AND LEGEND
KALANIANA'OLE HIGHWAY MEDIAN IMPROVEMENTS VICINITY OF OLOMANA GOLF COURSE PROJECT NO. 72A-02-06
DATE: June 2008
SHEET No. C-5 OF 43 SHEETS