


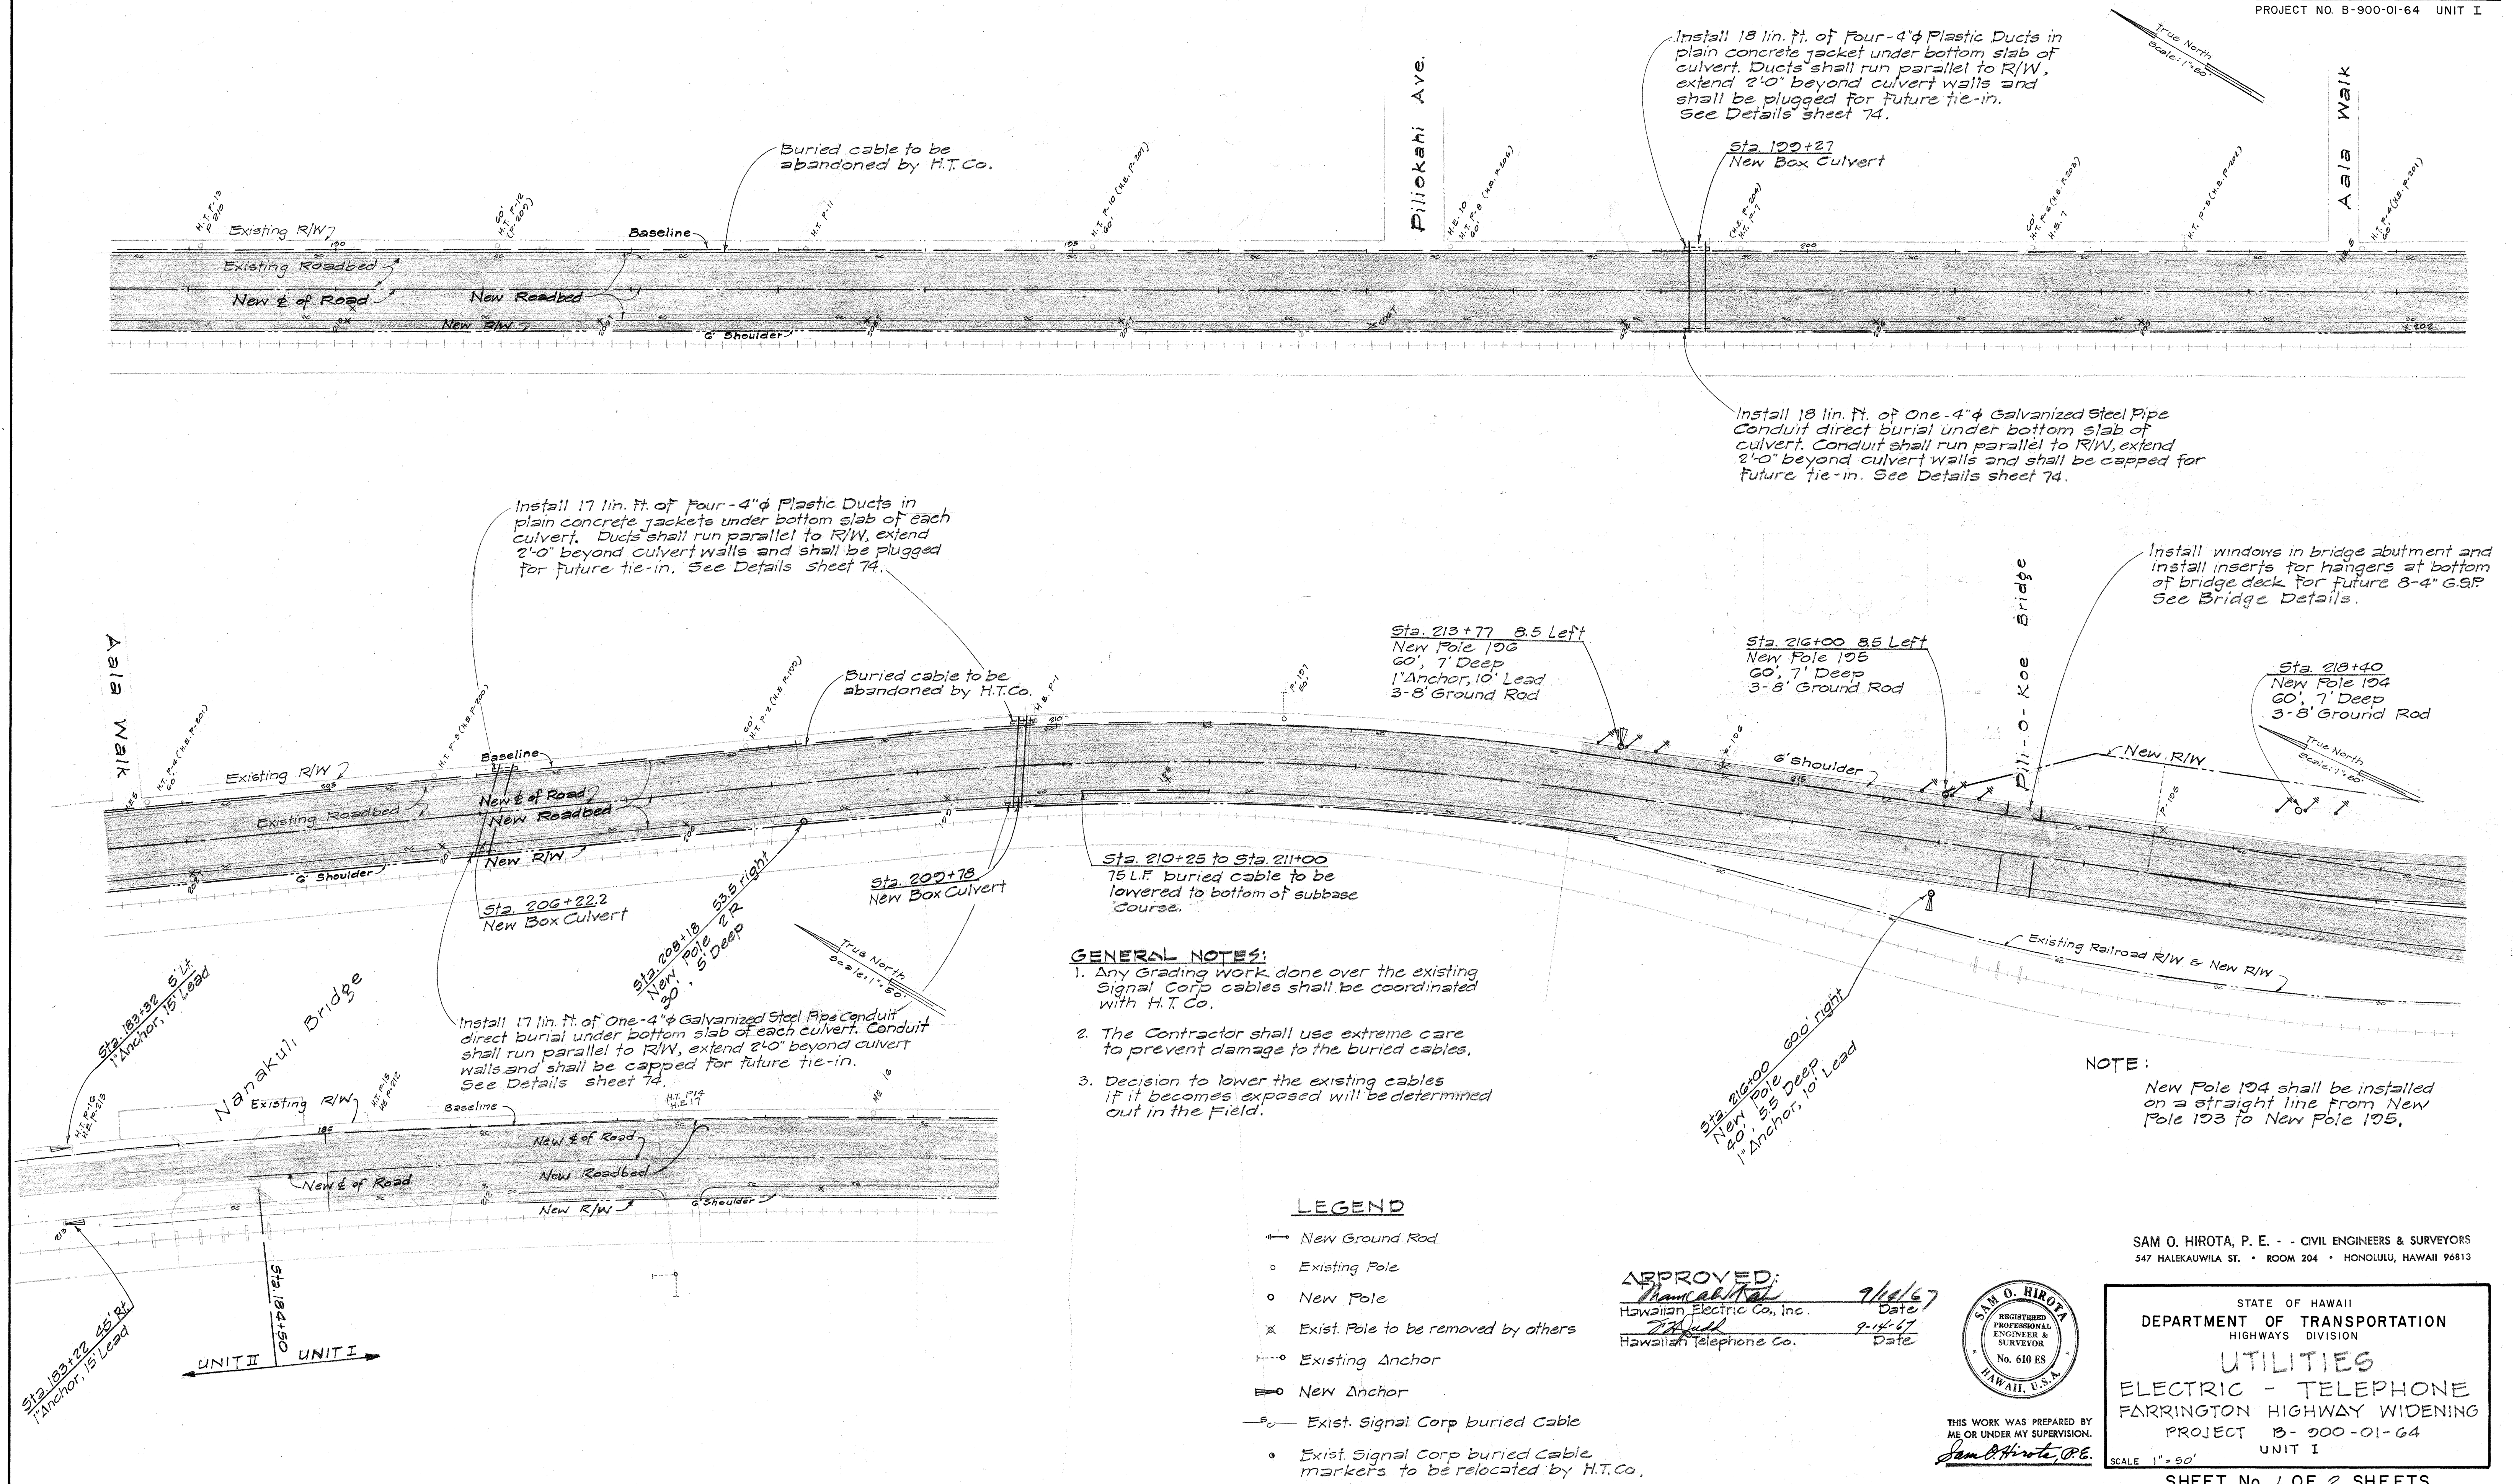


GENERAL NOTES:

1. Any Grading work done over the existing Signal Corp cables shall be coordinated with H.T. Co.
2. The Contractor shall use extreme care to prevent damage to the buried cables.
3. Decision to lower the existing cables if it becomes exposed will be determined out in the field.

LEGEND

- New Ground Rod
- Existing Pole
- New Pole
- × Exist. Pole to be removed by others
- Existing Anchor
- New Anchor
- Exist. Signal Corp buried Cable
- Exist. Signal Corp buried Cable markers to be relocated by H.T.Co.

APPROVED:
 Hawaiian Electric Co., Inc. 7/14/67
 Hawaiian Telephone Co. 7-14-67

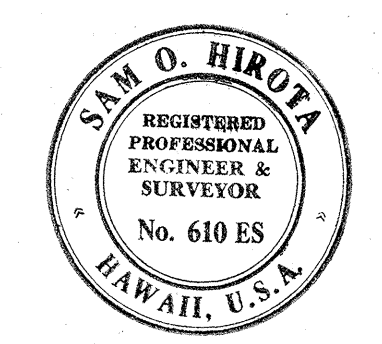


THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION.
 Sam O. Hirota, P.E.

SAM O. HIROTA, P. E. - CIVIL ENGINEERS & SURVEYORS
 547 HALEKAUWILA ST. • ROOM 204 • HONOLULU, HAWAII 96813


STATE OF HAWAII
 DEPARTMENT OF TRANSPORTATION
 HIGHWAYS DIVISION
UTILITIES
 ELECTRIC - TELEPHONE
 FARRINGTON HIGHWAY WIDENING
 PROJECT B-900-01-64
 UNIT I

SCALE 1" = 50'
 SHEET No. 1 OF 2 SHEETS

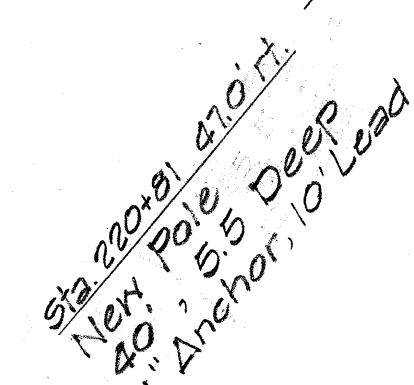PROJECT NO. B-900-01-64 UNIT

True North

Scale: 1" = 50'

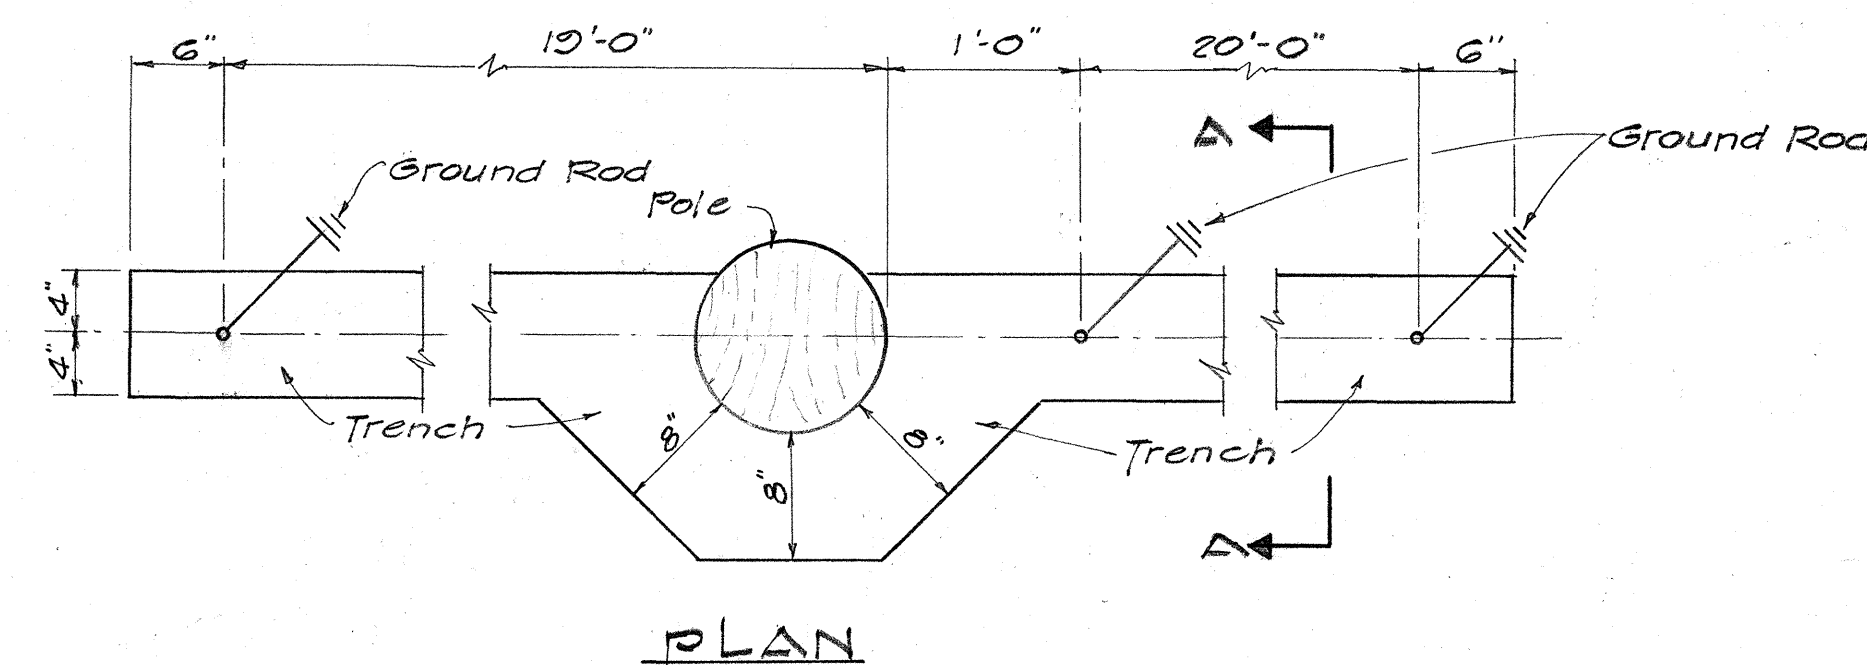

Ground rods and connections should be installed after H.T. Co.

4" 4"

Finish Grade

1'-0"

1'-6"

8'-0"

Ground Rod installed vertical

Figure 1

APPROVED: Mamoru Kato 9/14/67
Hawaiian Electric Co., Inc. Date
J. J. Quill 9-14-67
Hawaiian Telephone Co. Date

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION
UTILITIES
ELECTRIC - TELEPHONE
FARRINGTON HIGHWAY WIDENING
PROJECT B- 000-01-64
UNIT I
SCALE 1"=50'