


FOR 25' & 30' POLES WITH 8'-0" ANCHOR RODS				
"A"	"B"	"C"		"D" = ("A" + "B")
LEAD-ANCHOR ROD TO C OF POLE	ANCHOR ROD TO C OF HOLE	VERTICAL DEPTH 18" D.M.	24" D.M.	TOTAL DISTANCE POLE TO HOLE
5'-0"	1'-8"	7'-1"	7'-4"	6'-8"
10'-0"	3'-0"	6'-7"	7'-0"	13'-0"
15'-0"	4'-0"	6'-1"	6'-6"	19'-0"
20'-0"	4'-8"	5'-6"	5'-10"	24'-8"
25'-0"	5'-2"	4'-11"	5'-4"	30'-2"
FOR 35' THRU 70' POLES WITH 8'-0" ANCHOR RODS				
5'-0"	1'-0"	7'-3"	7'-4"	6'-0"
10'-0"	1'-11"	7'-1"	7'-3"	11'-11"
15'-0"	2'-8"	6'-9"	7'-1"	17'-8"
20'-0"	3'-3"	6'-6"	6'-10"	23'-3"
25'-0"	3'-10"	6'-2"	6'-7"	28'-10"
FOR 40' THRU 70' POLES WITH 1 1/4" x 10'-0" ANCHOR RODS				
5'-0"	1'-7"		9'-4"	6'-7"
10'-0"	3'-0"		9'-0"	13'-0"
15'-0"	4'-2"		8'-6"	19'-2"
20'-0"	5'-3"		7'-11"	25'-3"
25'-0"	6'-2"		7'-3"	31'-2"

D.M. = Deadman

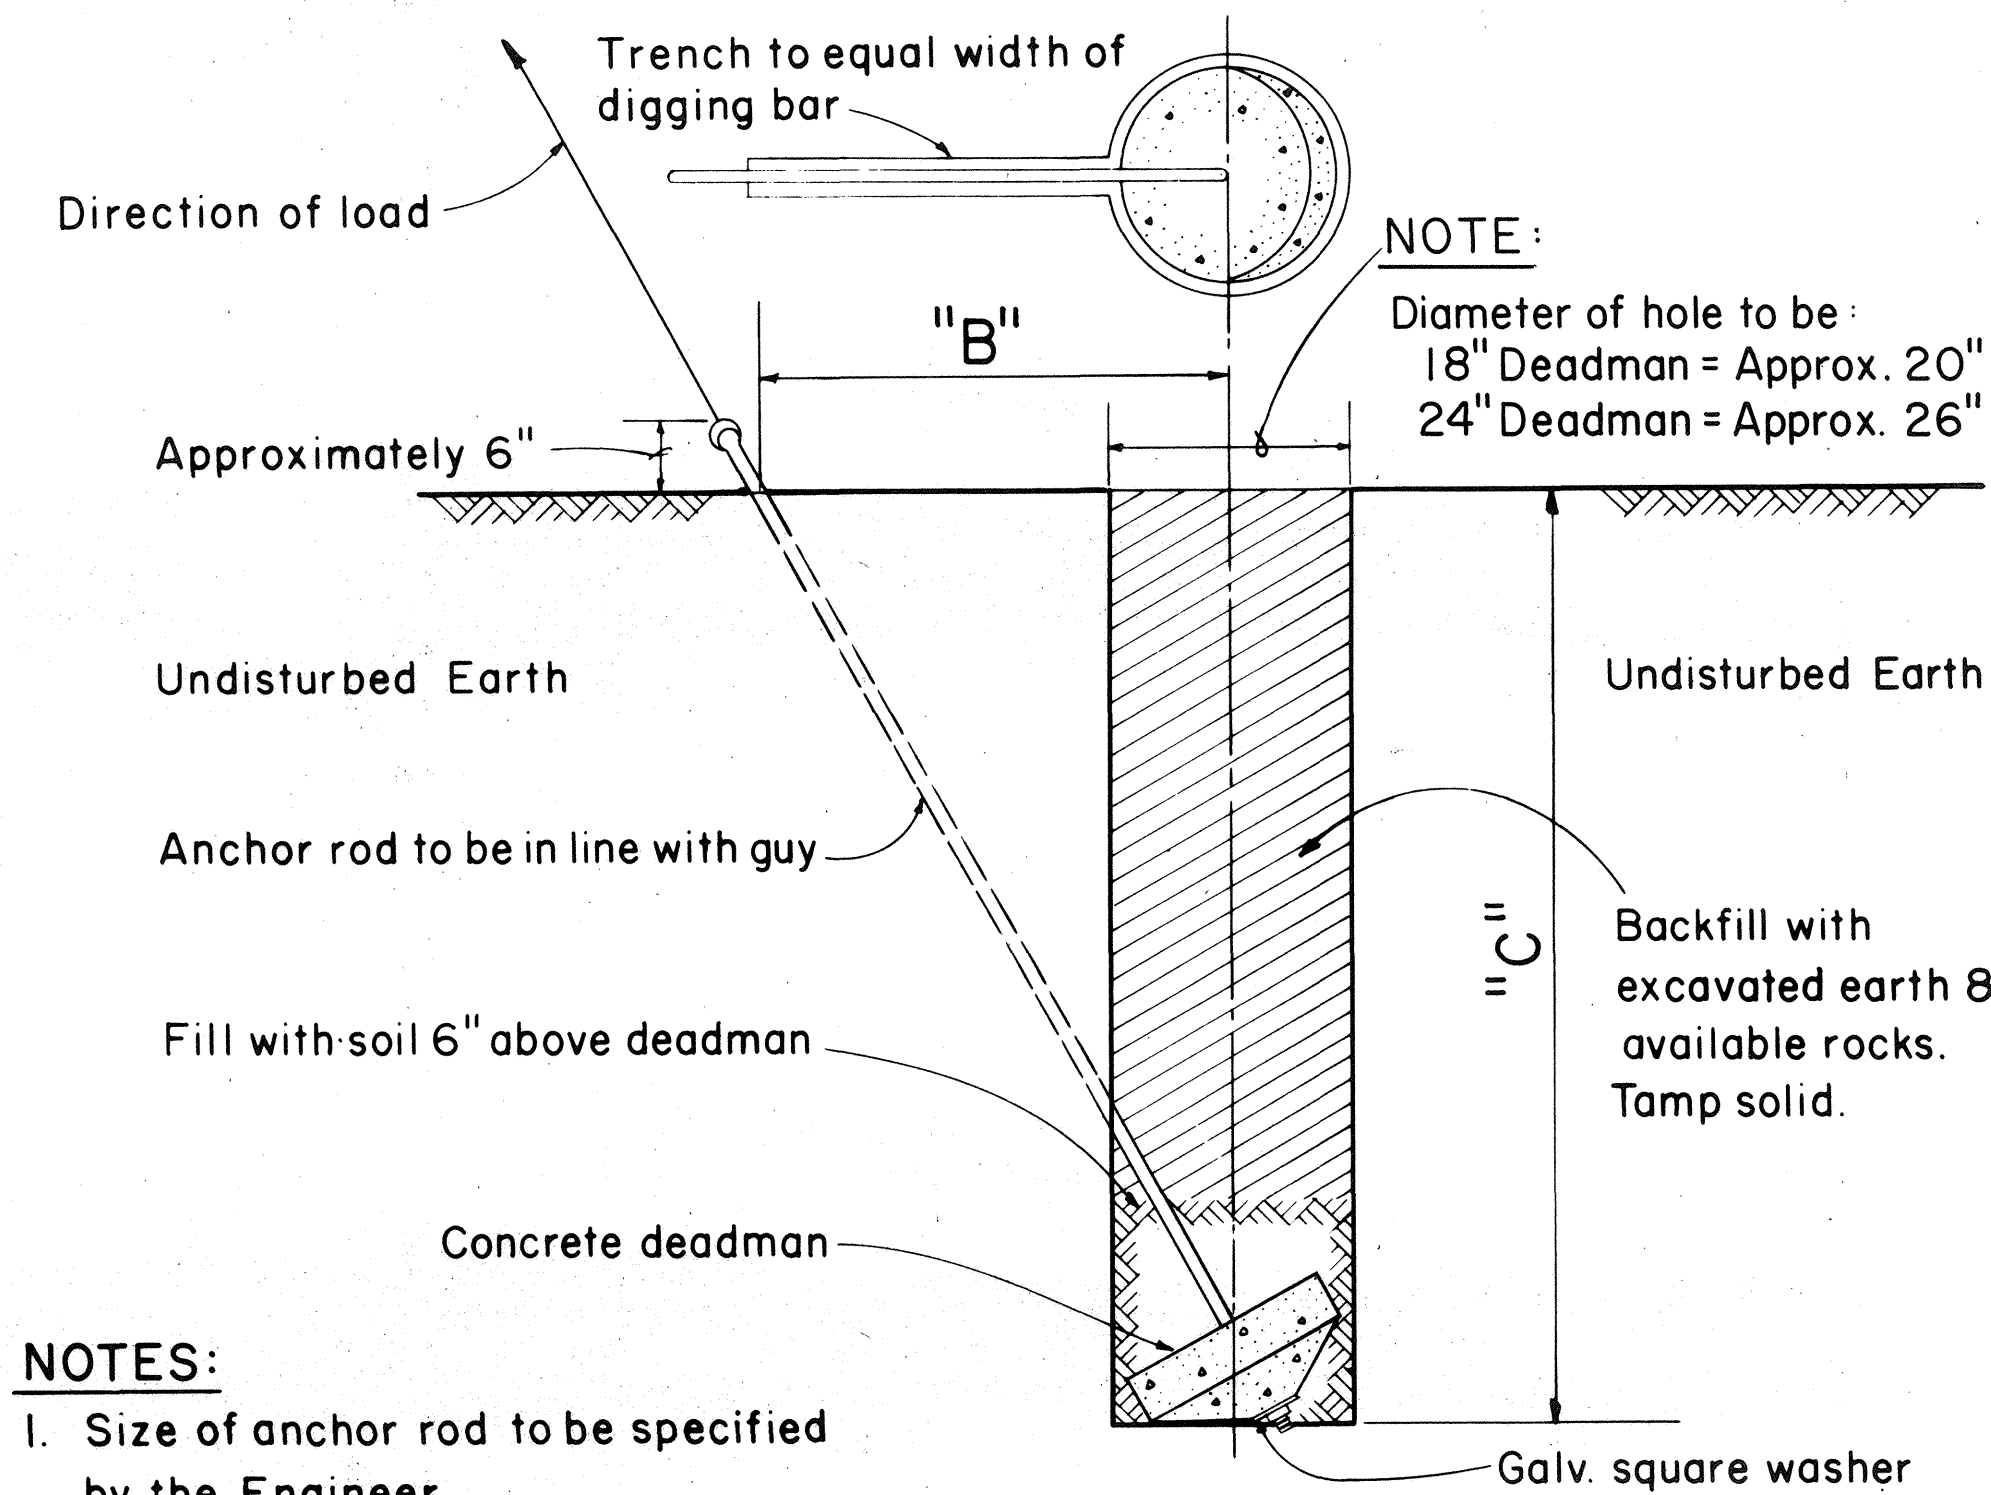


NOTES:


1. Size of anchor rod to be specified by the Engineer
2. Use Anchoring Data.

GUY ANCHOR DEADMAN

Scale: 3/4" = 1' - 0"

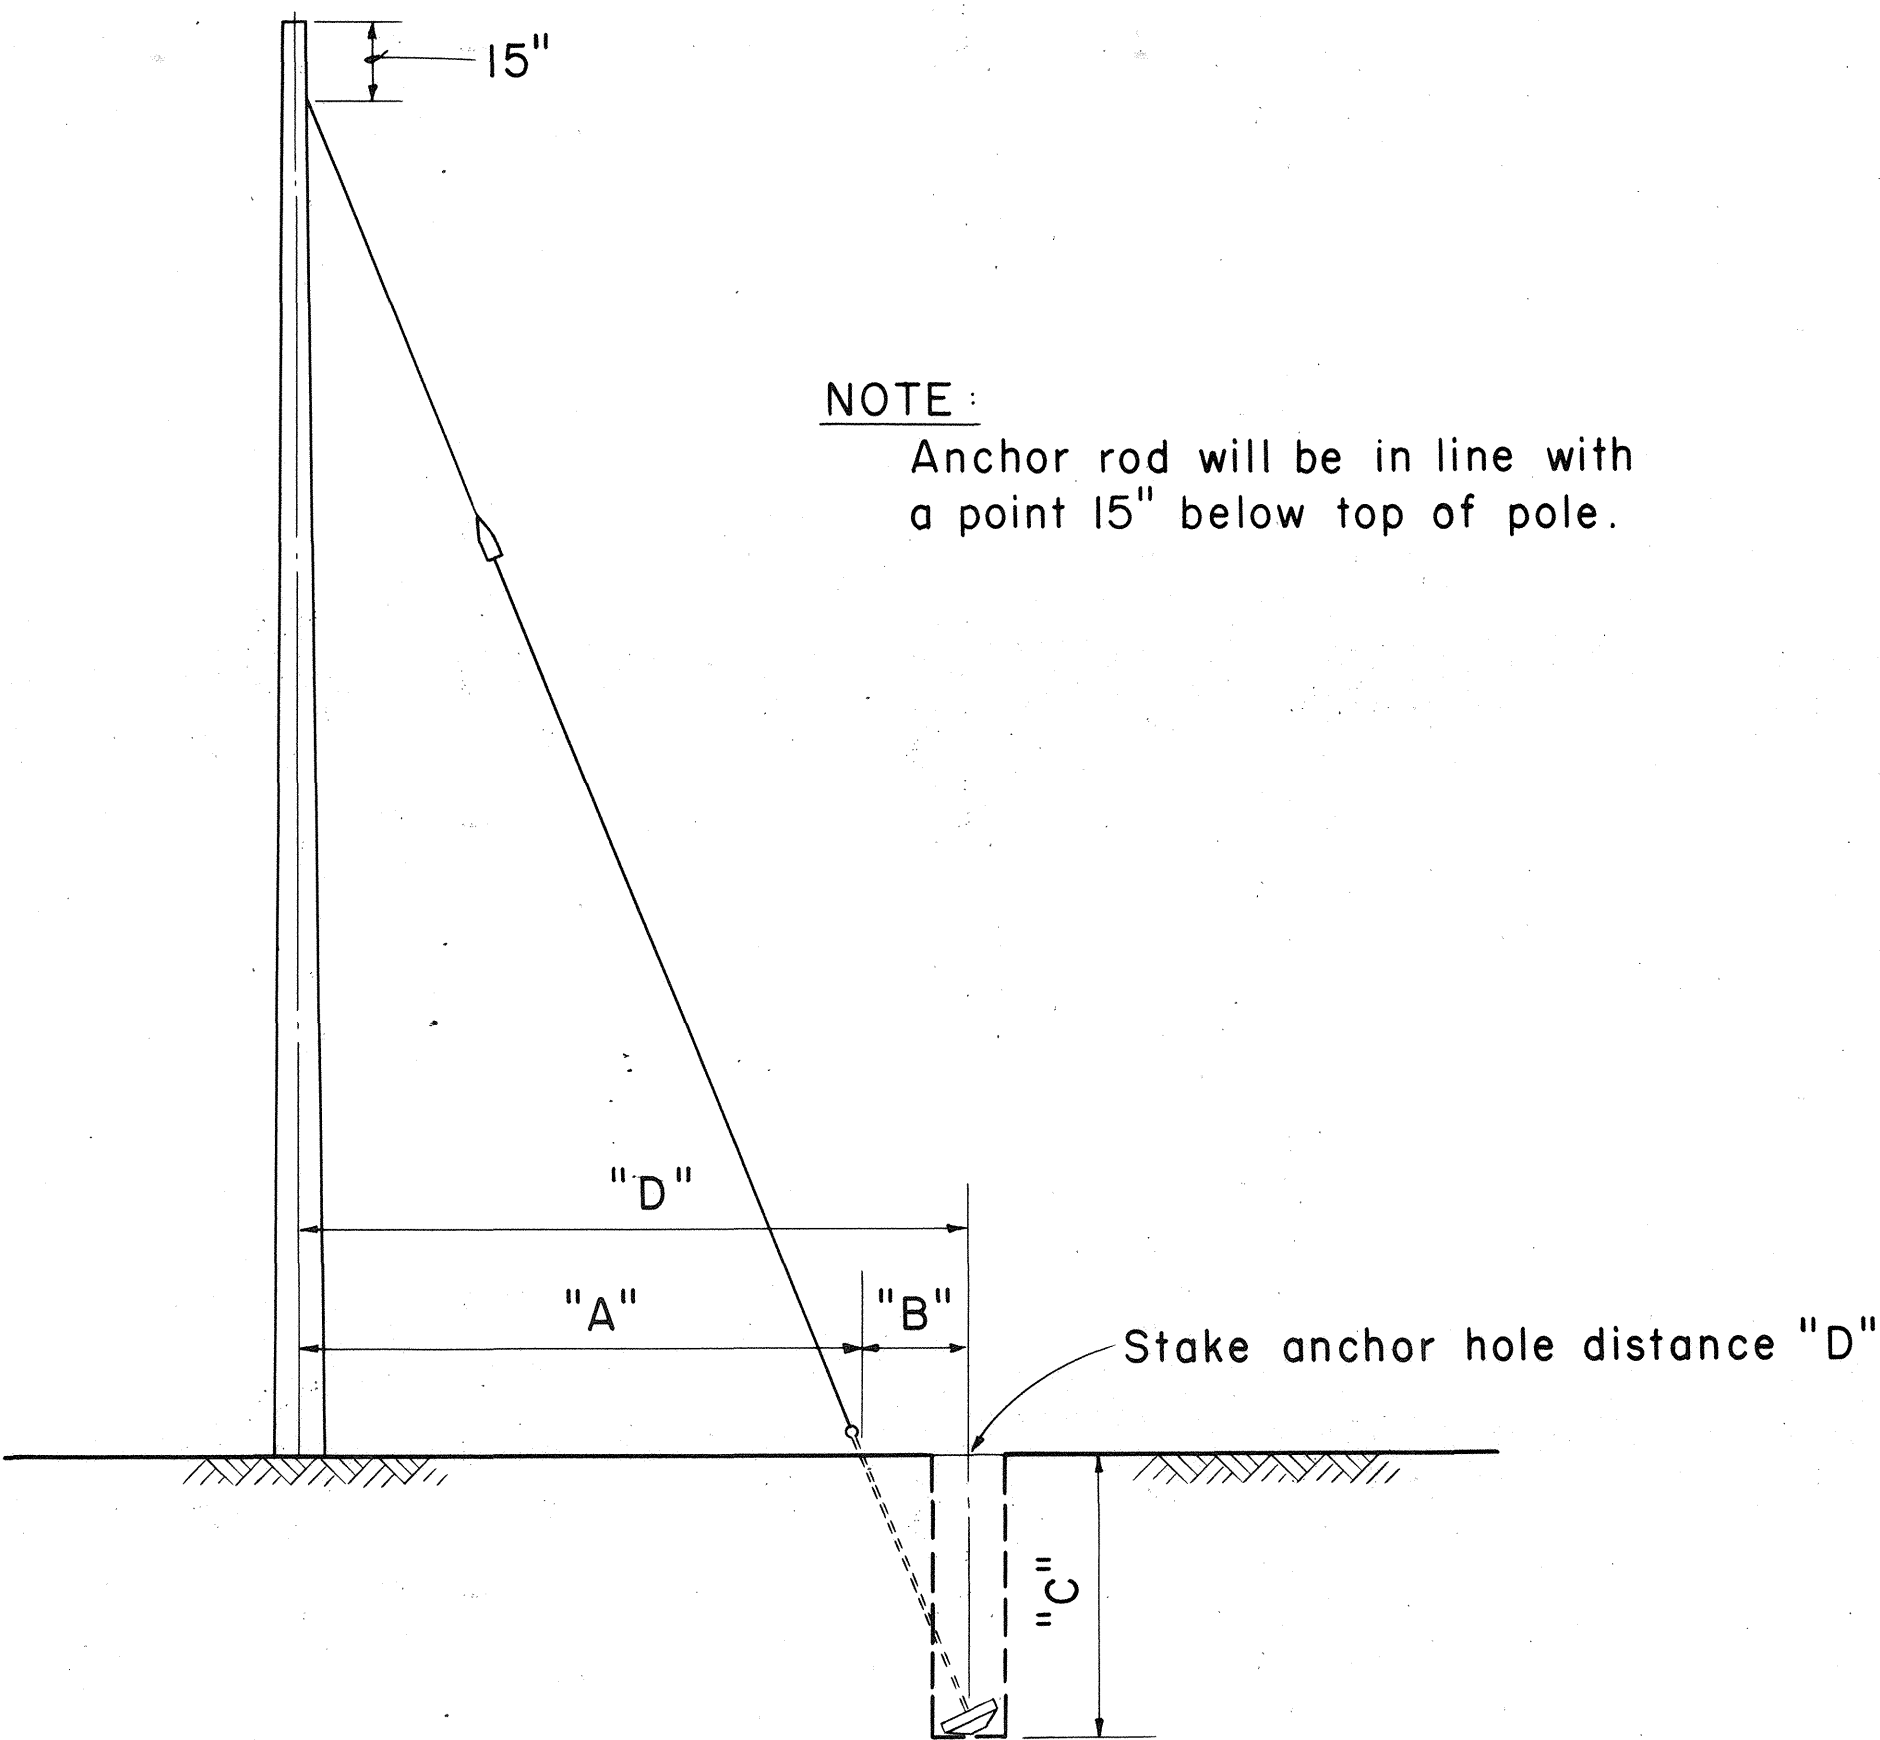

Not to Scale

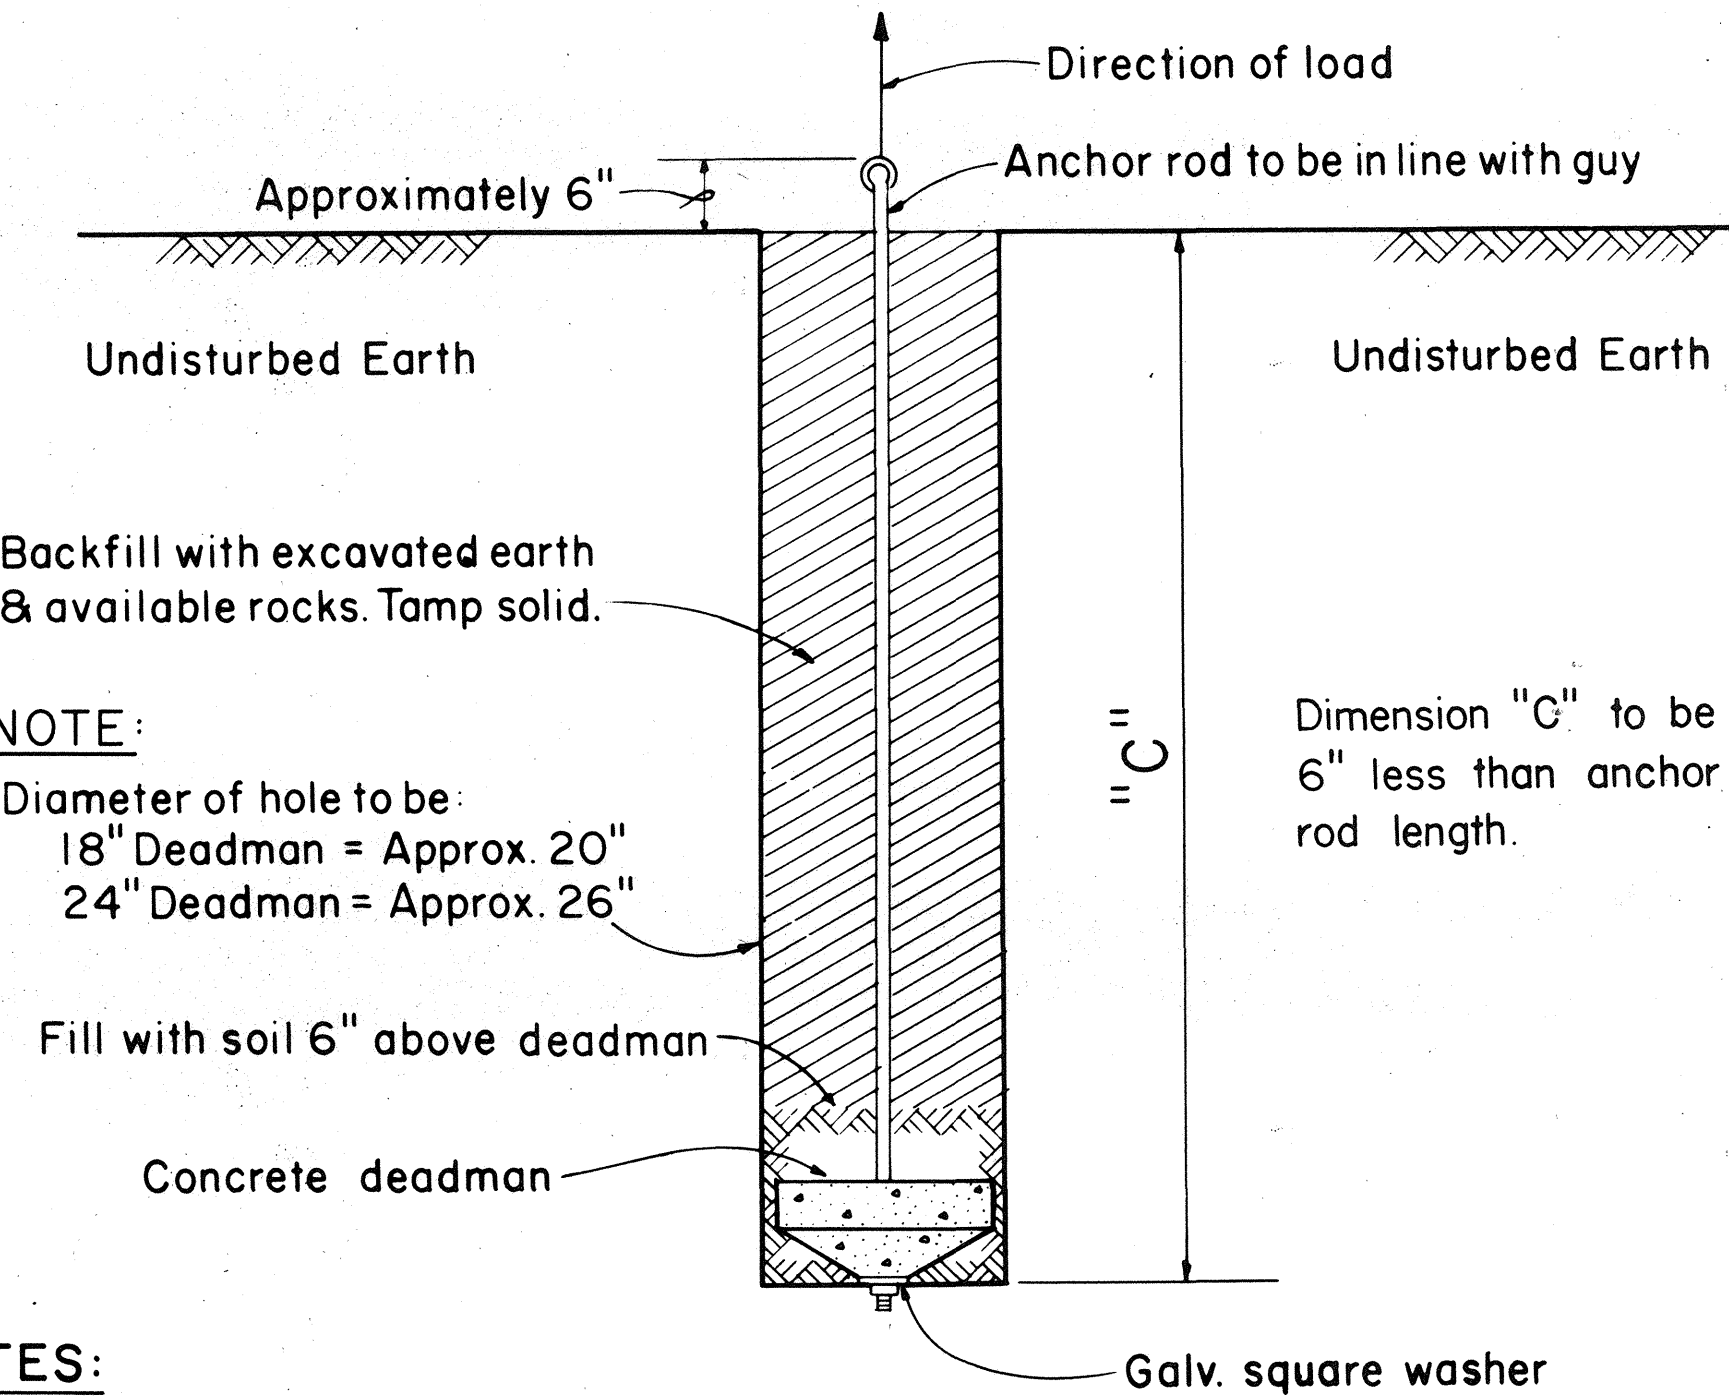


NOTES:

1. Size of anchor rod to be specified by the Engineer.
2. Use Anchoring Data.

SIDE - WALK ANCHOR

Scale: 3/4" = 1' - 0"

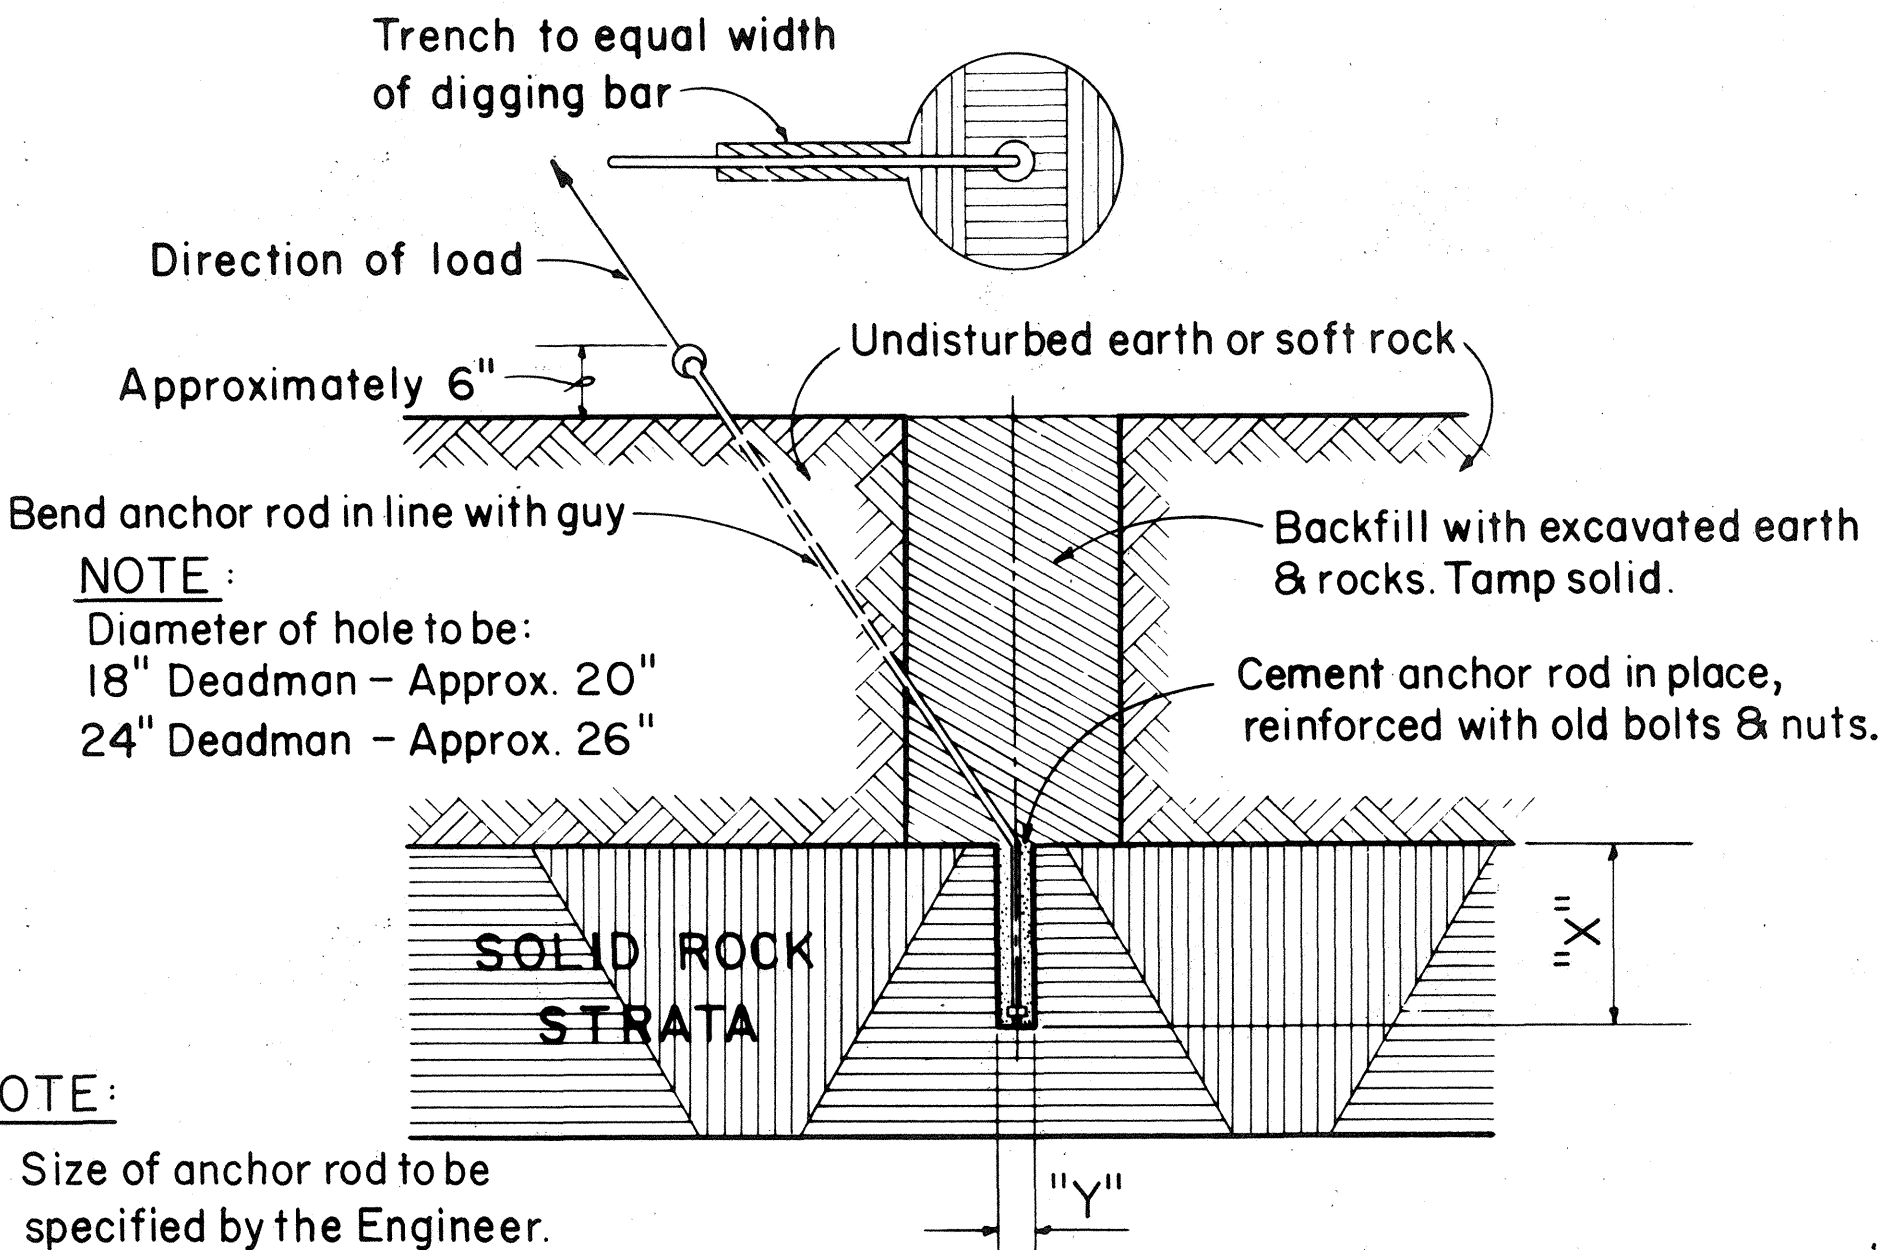

NOTE:

1. Size of anchor rod to be specified by the Engineer.
2. "X" Should not be less than 24". If "X" is less than 24" complete hole & install anchor.
3. "Y" 5/8" Anchor rod drill 2" hole
3/4" Anchor rod drill 2" hole
1" Anchor rod drill 2 1/2" hole
1 1/4" Anchor rod drill 3" hole
4. Use Anchoring Data.

ROCK ANCHOR

Not to Scale

TABLE 2 ANCHOR ROD - ANCHOR SLUG - SQUARE WASHER COMBINATION

H.E. CODE NO.	ANCHOR ROD	WORKING TENSION 1/2 ULT (LBS.)	H.E. CONC. ANC. CODE NO.	H.E. CODE NO.	WASHER SIZE	QTY.
617	5/8" x 8'-0" Steel	8,000	518	18	2320 4" x 4" x 3/16"	2
615	5/8" x 8'-0" Cu Cov Stl	9,250	518	18	** 3" x 3" x 1/8"	2
618	3/4" x 8'-0" Steel	11,500	518	18	2330 6" x 6" x 3/8"	1
619	1" x 8'-0" Steel	18,000	524	24	2331 6" x 6" x 1/2"	1
616	1" x 8'-0" Cu Cov Stl	22,500	524	24	** 4" x 4" x 3/16"	2
613	1 1/4" x 10'-0" Steel	29,000	524	24	2330 6" x 6" x 3/8"	2

** Use bronze square washers included in anchor rod assembly on copper covered steel (Cu Cov Stl) anchor rods.

ANCHORING DATA

APPROVED:

Mamoru Kato
HAWAIIAN ELECTRIC Co., Inc.

7/18/67
DATE

T. J. Quill
HAWAIIAN TELEPHONE Co.

9-14-67
DATE

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION

STANDARD DETAILS
H.E. Co. AND H.T. Co.
ANCHOR DETAILS AND
ANCHORING DATA

Scales: As Noted

Date

CREOSOTED DOUGLAS FIR & YELLOW PINE POLE DATA

LENGTH IN FEET	CLASS	APPROX. MINIMUM DIMENSIONS (INCHES)				AVERAGE WEIGHT (LBS.)	POLE SETTING DEPTH (FT.)		BREAKING LOAD 2'-0" BELOW TOP OF POLE (LBS.)	
		AT TOP		6' FROM BUTT			DOUGLAS FIR	IN SOIL		IN ROCK
		DIA.	CIR.	DIA.	CIR.					
25	5	6.04	19	8.26	26	525	4.5	3	1900	
30	3	7.32	23	10.32	32.5	810	5	3.5	3000	
	5	6.04	19	8.90	28	600	5	3.5	1900	
35	2	7.96	25	12.23	37.5	1260	5	3.5	3700	
	5	6.04	19	9.55	30	770	5	3.5	1900	
40	3	7.32	23	11.77	37	1320	5.5	3.5	3000	
45	2	7.96	25	13.20	41.5	1845	6	4	3700	
	3	7.32	23	12.25	38.5	1575	6	4	3000	
50	2	7.96	25	13.70	43	2150	6.5	4	3700	
	3	7.32	23	12.70	40	1850	6.5	4	3000	
55	1	8.59	27	15.11	47.5	2860	7	4.5	4500	
	2	7.96	25	14.15	44.5	2475	7	4.5	3700	
	3	7.32	23	13.20	41.5	2145	7	4.5	3000	
60	1	8.59	27	15.75	49.5	3360	7	4.5	4500	
	2	7.96	25	14.62	46	2820	7	4.5	3700	
65	1	8.59	27	16.20	51	3835	7.5	5	4500	
	2	7.96	25	15.11	47.5	3250	7.5	5	3700	
70	1	8.59	27	16.70	52.5	4340	7.5	5	4500	
	2	7.96	25	15.60	49	3640	7.5	5	3700	
75	1	8.59	27	17.20	54	4800	8	5.5	4500	
	2	7.96	25	16.05	50.5	4050	8	5.5	3700	
80	1	8.59	27	17.50	55	5240	8	6	4500	
	2	7.96	25	16.40	51.5	4400	8	6	3700	
85	1	8.59	27	18.00	56.5	5780	8.5	6.5	4500	
	2	7.96	25	16.88	53	4930	8.5	6.5	3700	
90	1	8.59	27	18.30	57.5	6300	8.5	6.5	4500	
	2	7.96	25	17.20	54	5400	8.5	6.5	3700	

NOTE:

The ultimate fiber stress for creosoted Southern Yellow Pine & Douglas Fir is 7,400 Lbs. per square inch.

Weights are for untreated poles. Add 5% as estimate of added weight of creosote treatment.

REFERENCES:

American Standards Association O5.4-1941, O5.6-1945.
Standard Handbook for Electrical Engineers, Eighth Edition
H. E. Co. Specification for Poles.

WOOD POLE DATA

APPROVED:

Manuel
HAWAIIAN ELECTRIC Co., Inc.

7/14/67
DATE


J. J. Quinn
HAWAIIAN TELEPHONE Co.

9-14-67
DATE

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION
STANDARD DETAILS
H.E. Co. AND H.T. Co.
SERVICE BOX DETAILS
AND WOOD POLE DATA

Scales: As Noted Date


SHEET NO. 2 OF 2 SHEETS

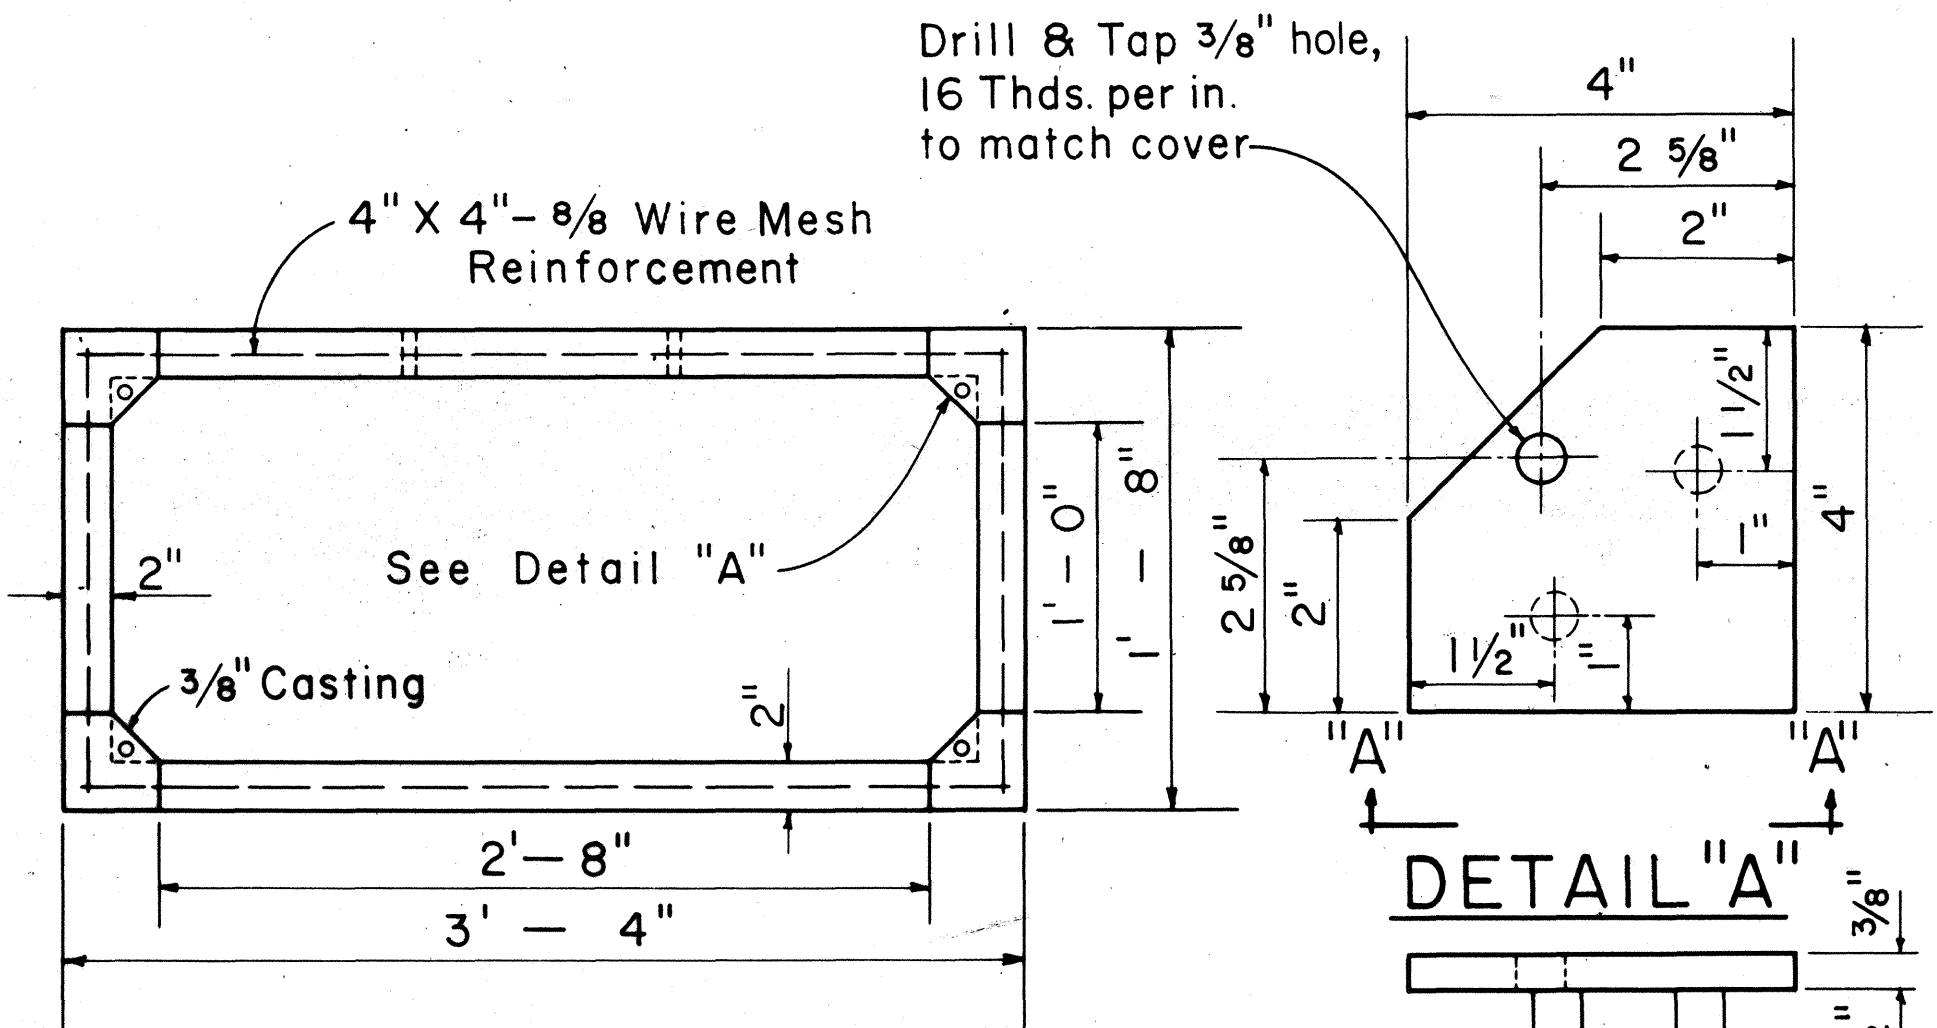


PLAN

DETAIL "A"

SECTION "A-A"

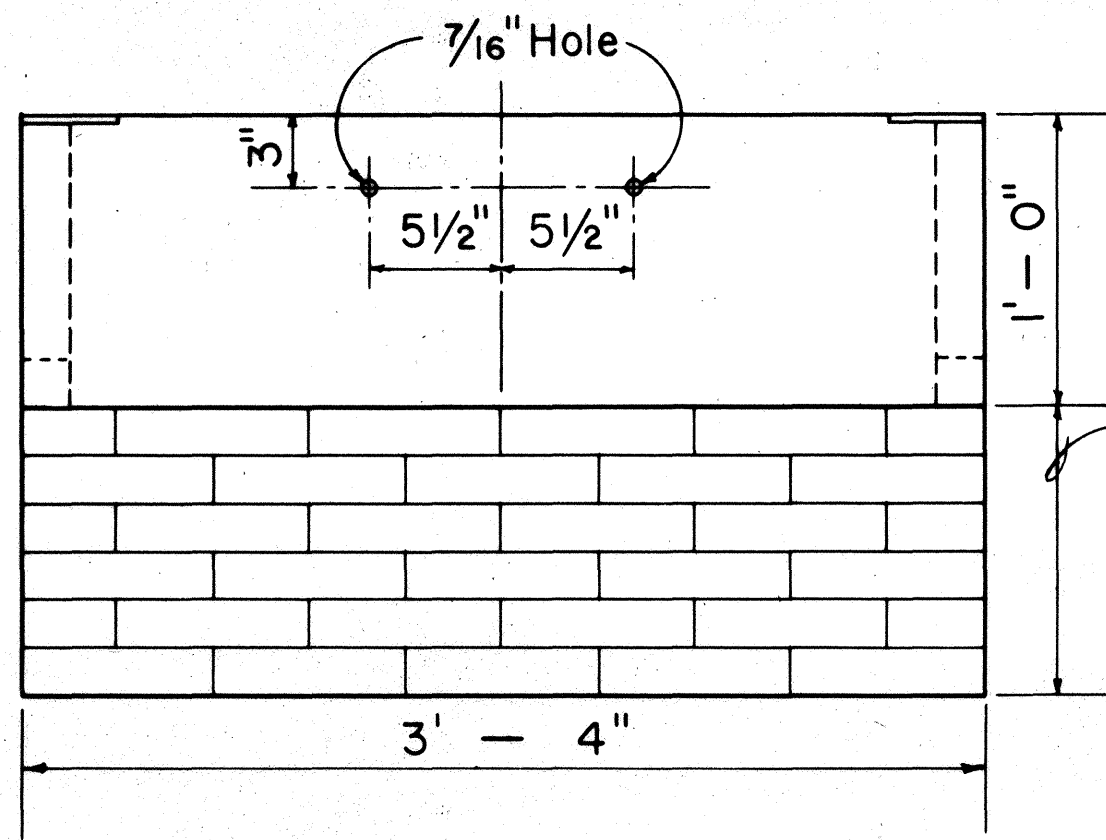


SIDE VIEW

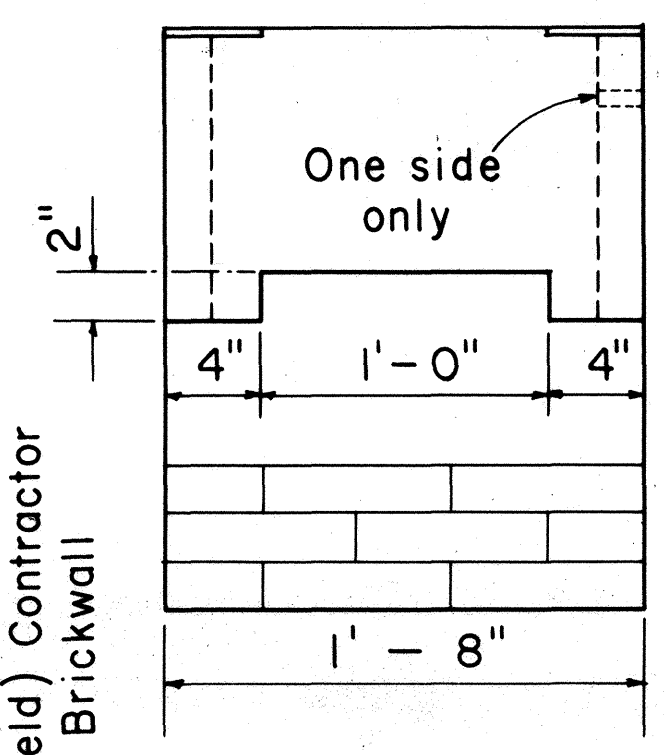

END VIEW

NOTES:

Use 3/8" Plate for driveways.
Concrete Box 225 Lbs.
1/4" Checker Plate 62 Lbs.
Secure cover with 3/8" x 1" flat head brass machine screws.

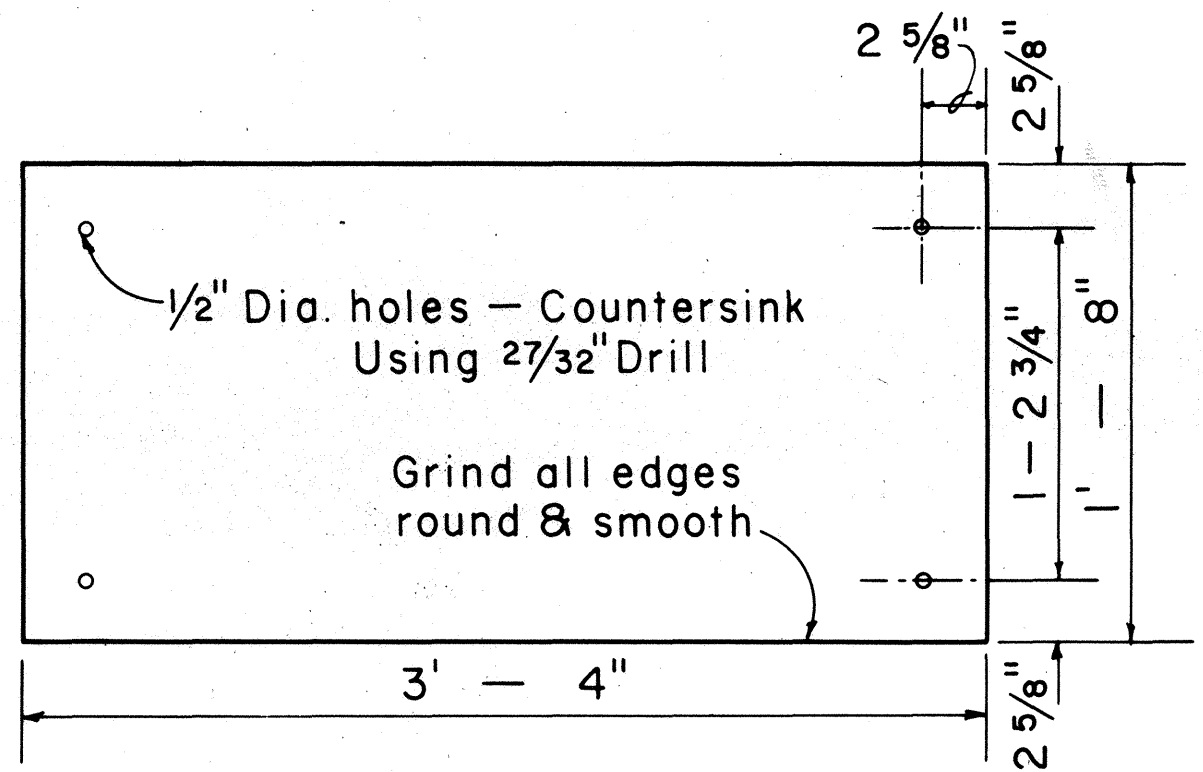


1/4" CHECKER PLATE COVER

(Hot dip galvanize checkered plate after drilling, countersinking, and grinding edge)

1'-4" X 3'-0" CONCRETE SERVICE BOX

Scale: 1 1/2" = 1' - 0"


011250

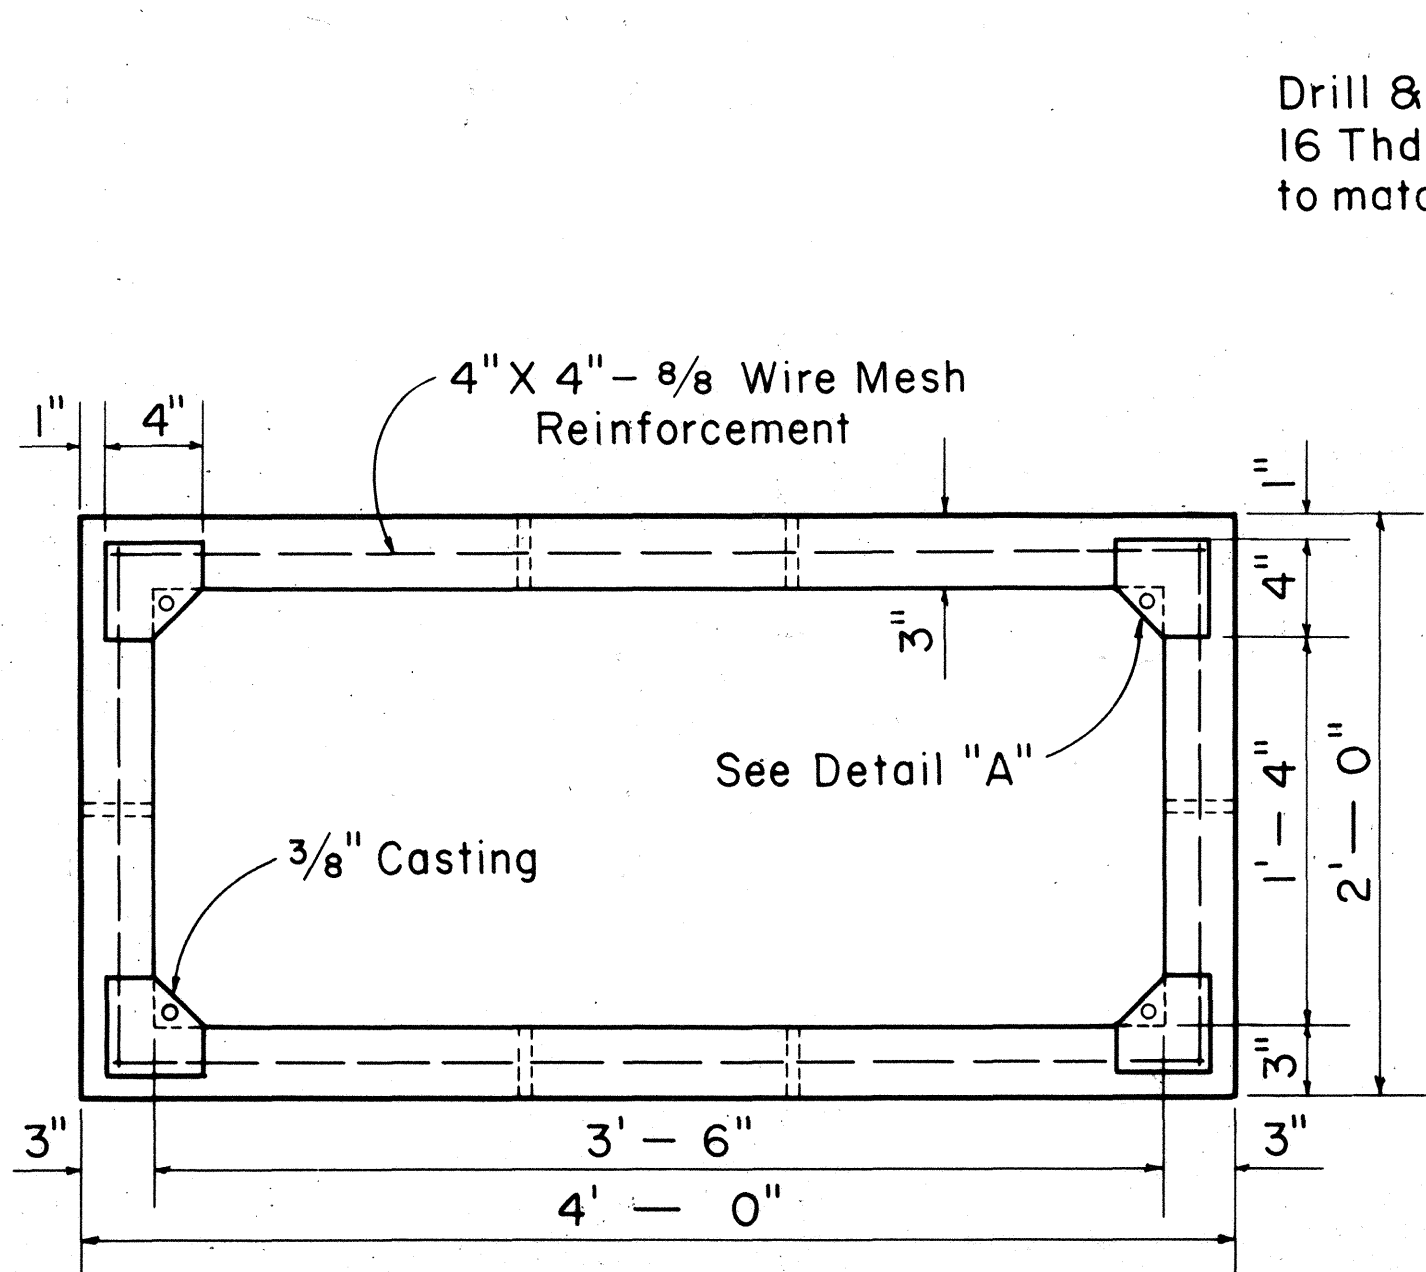


PLAN

DETAIL "A"

SECTION "A-A"

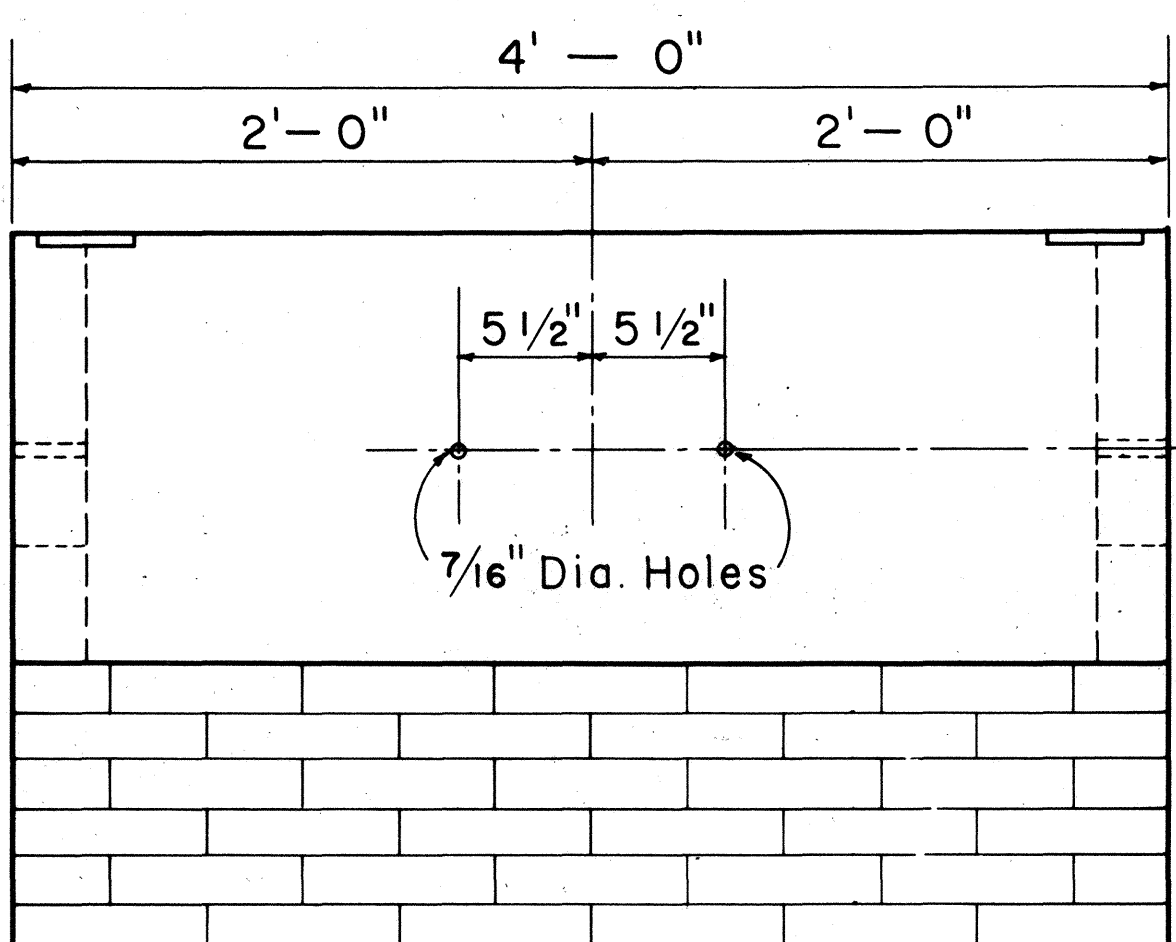


SIDE VIEW

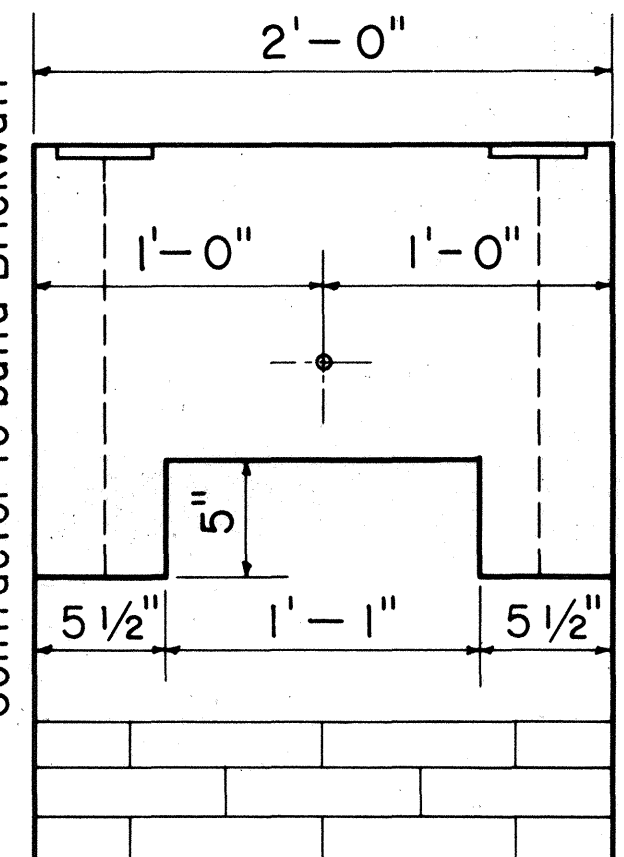

END VIEW

NOTES:

Use 3/8" Plate for driveway.
Concrete Box 575 Lbs.
1/4" Checker Plate 130 Lbs.
Secure cover with 3/8" x 1" flat head brass machine screws.

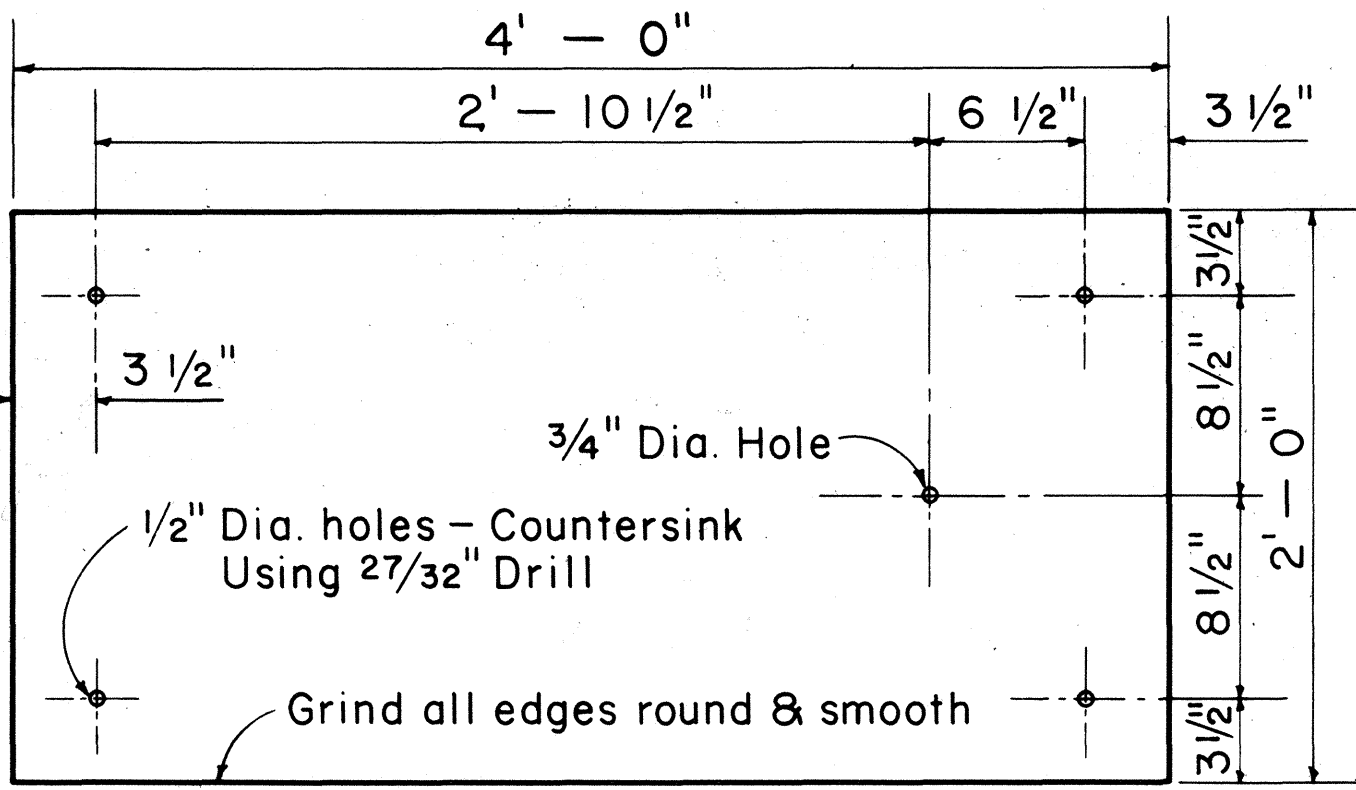

1/4" CHECKER PLATE COVER

(Hot dip galvanize checkered plate after drilling, countersinking, and grinding edge)

1'-6" X 3'-6" CONCRETE SERVICE BOX

Scale: 1 1/2" = 1' - 0"

011255

DATE
DRAWN BY
CHECKED BY
DESIGNED BY
NOTED BY
QUANTITIES BY
No.