

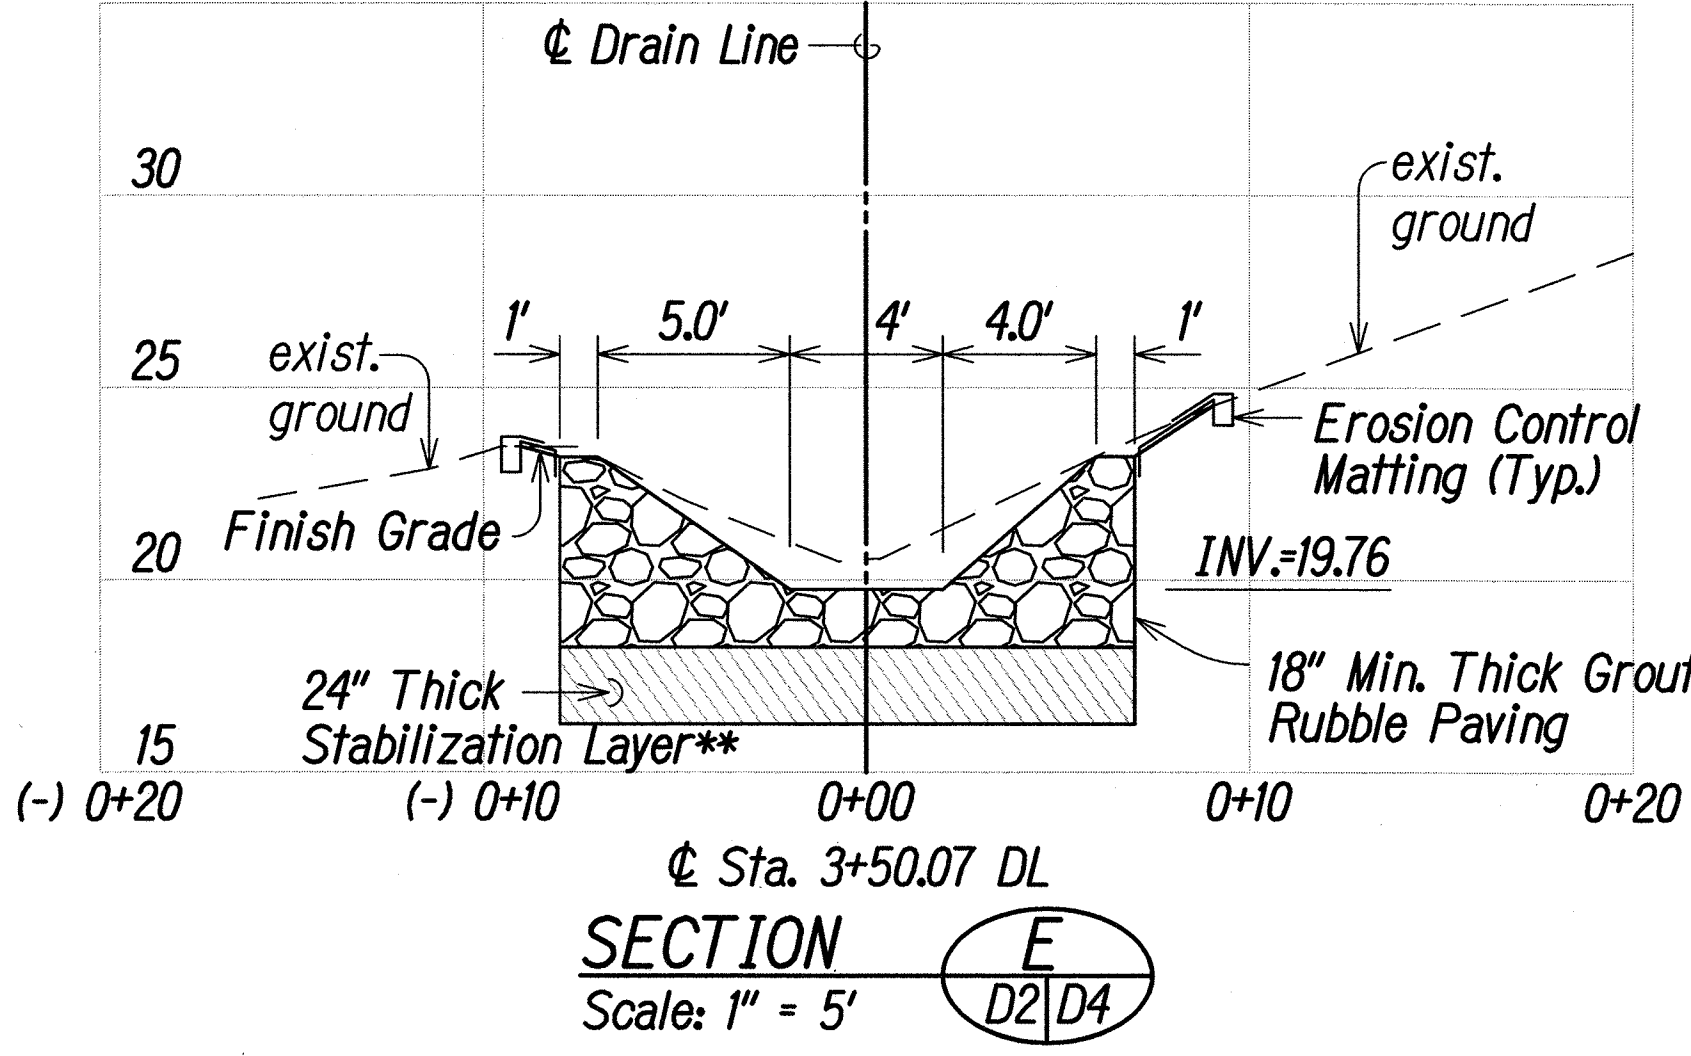
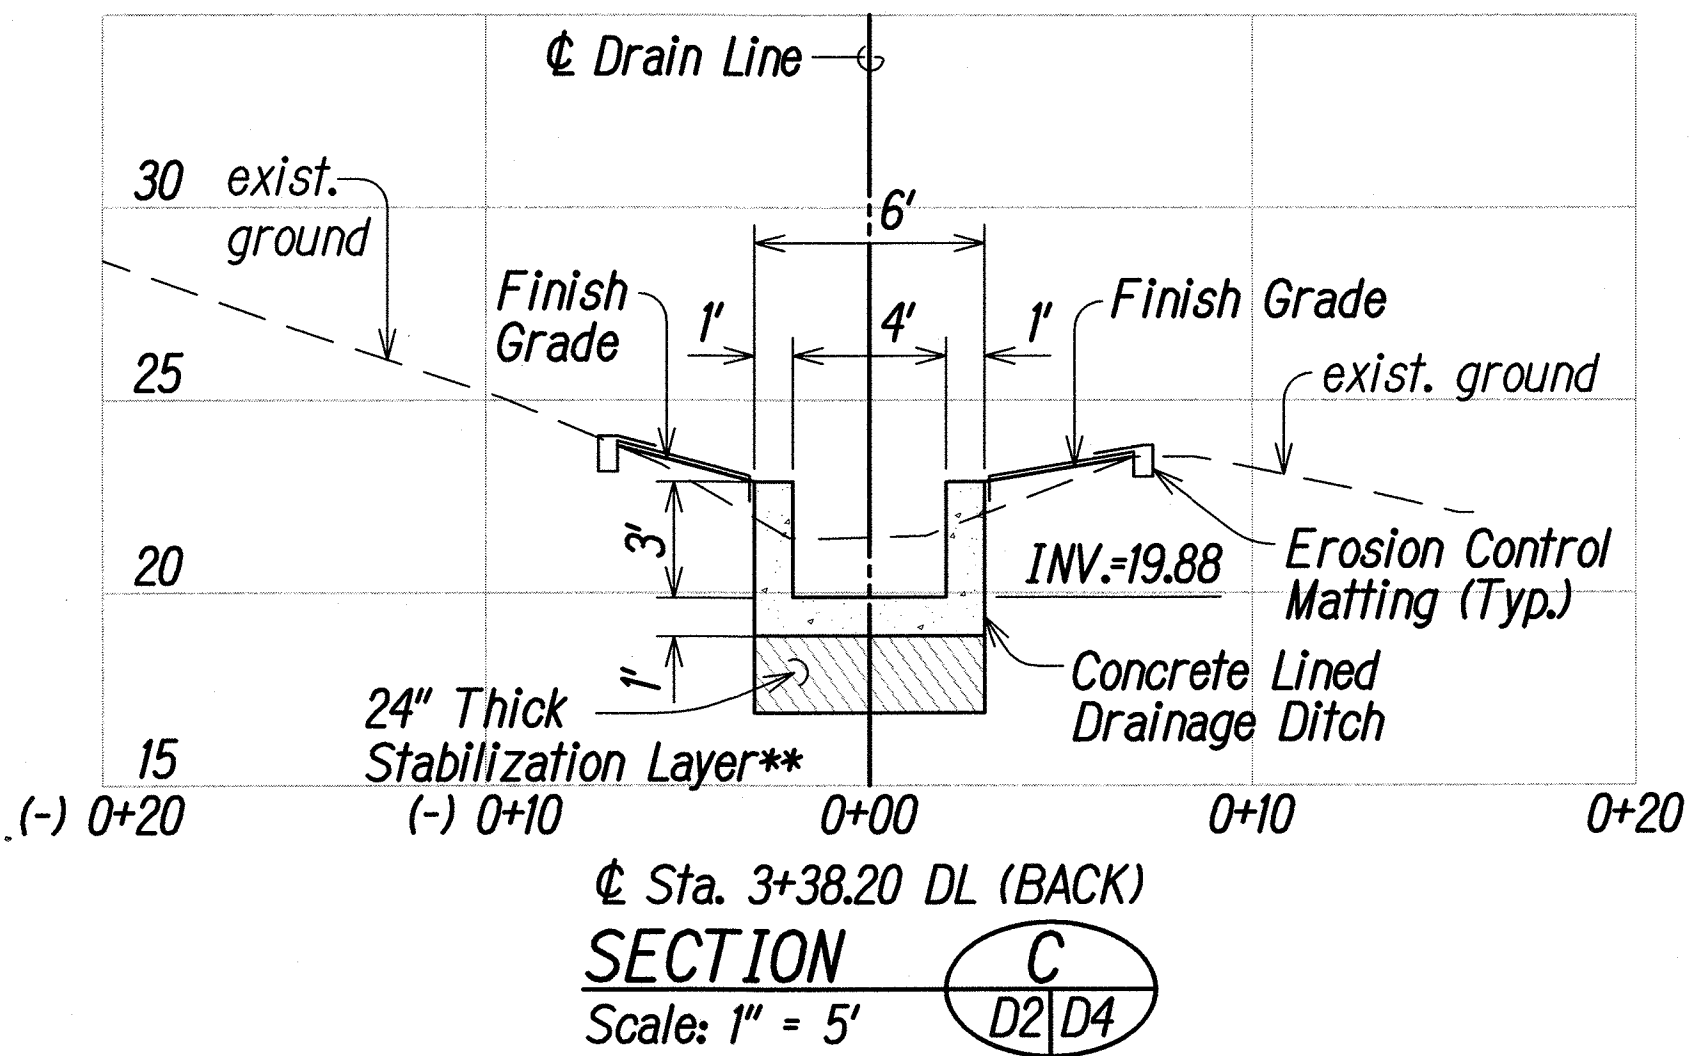
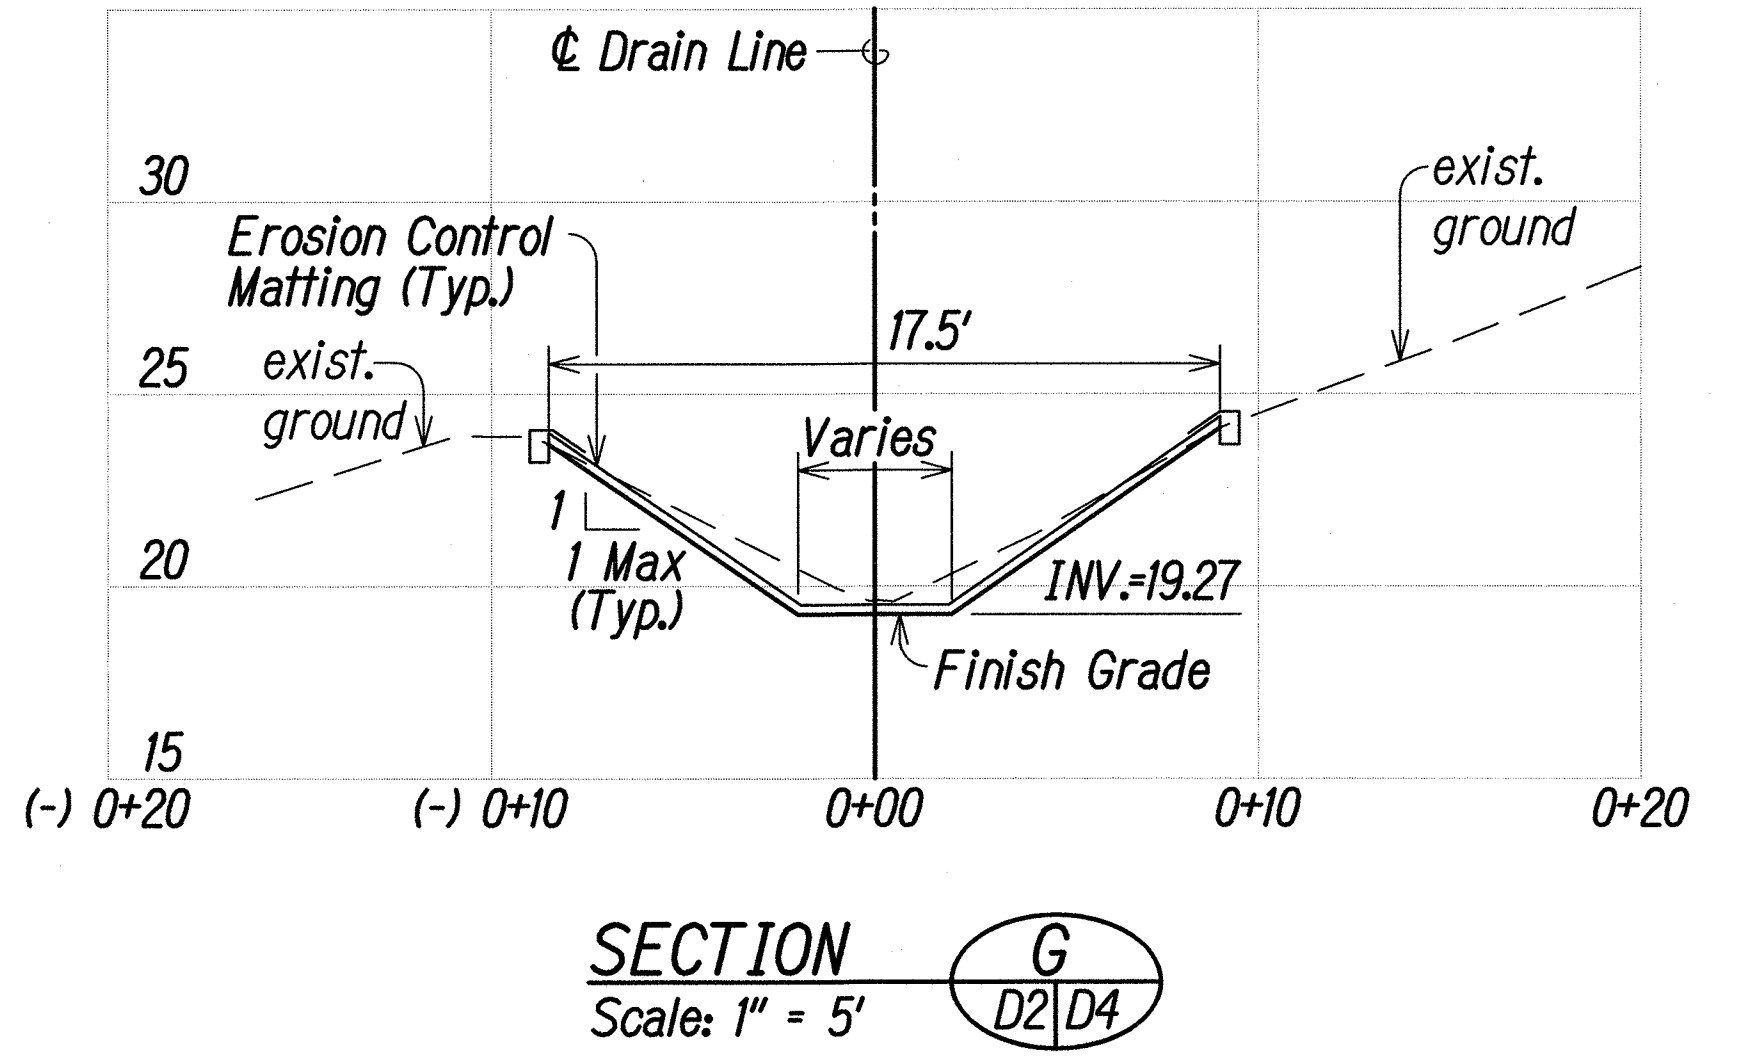
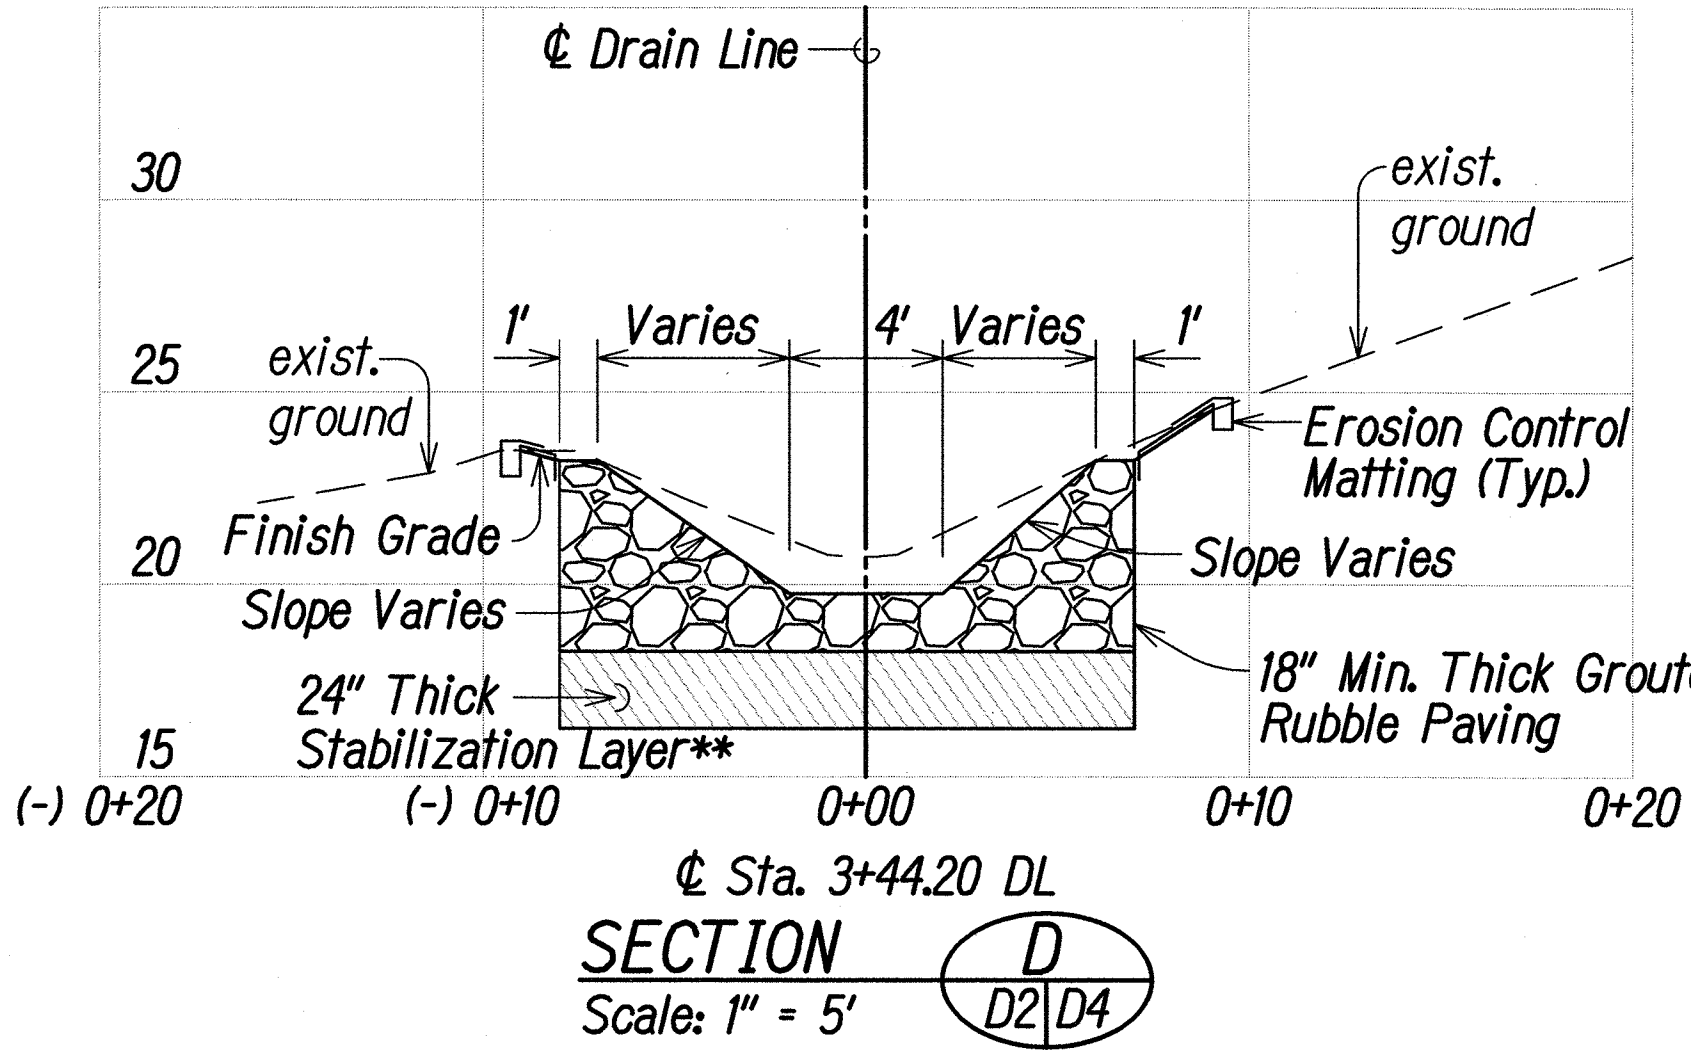
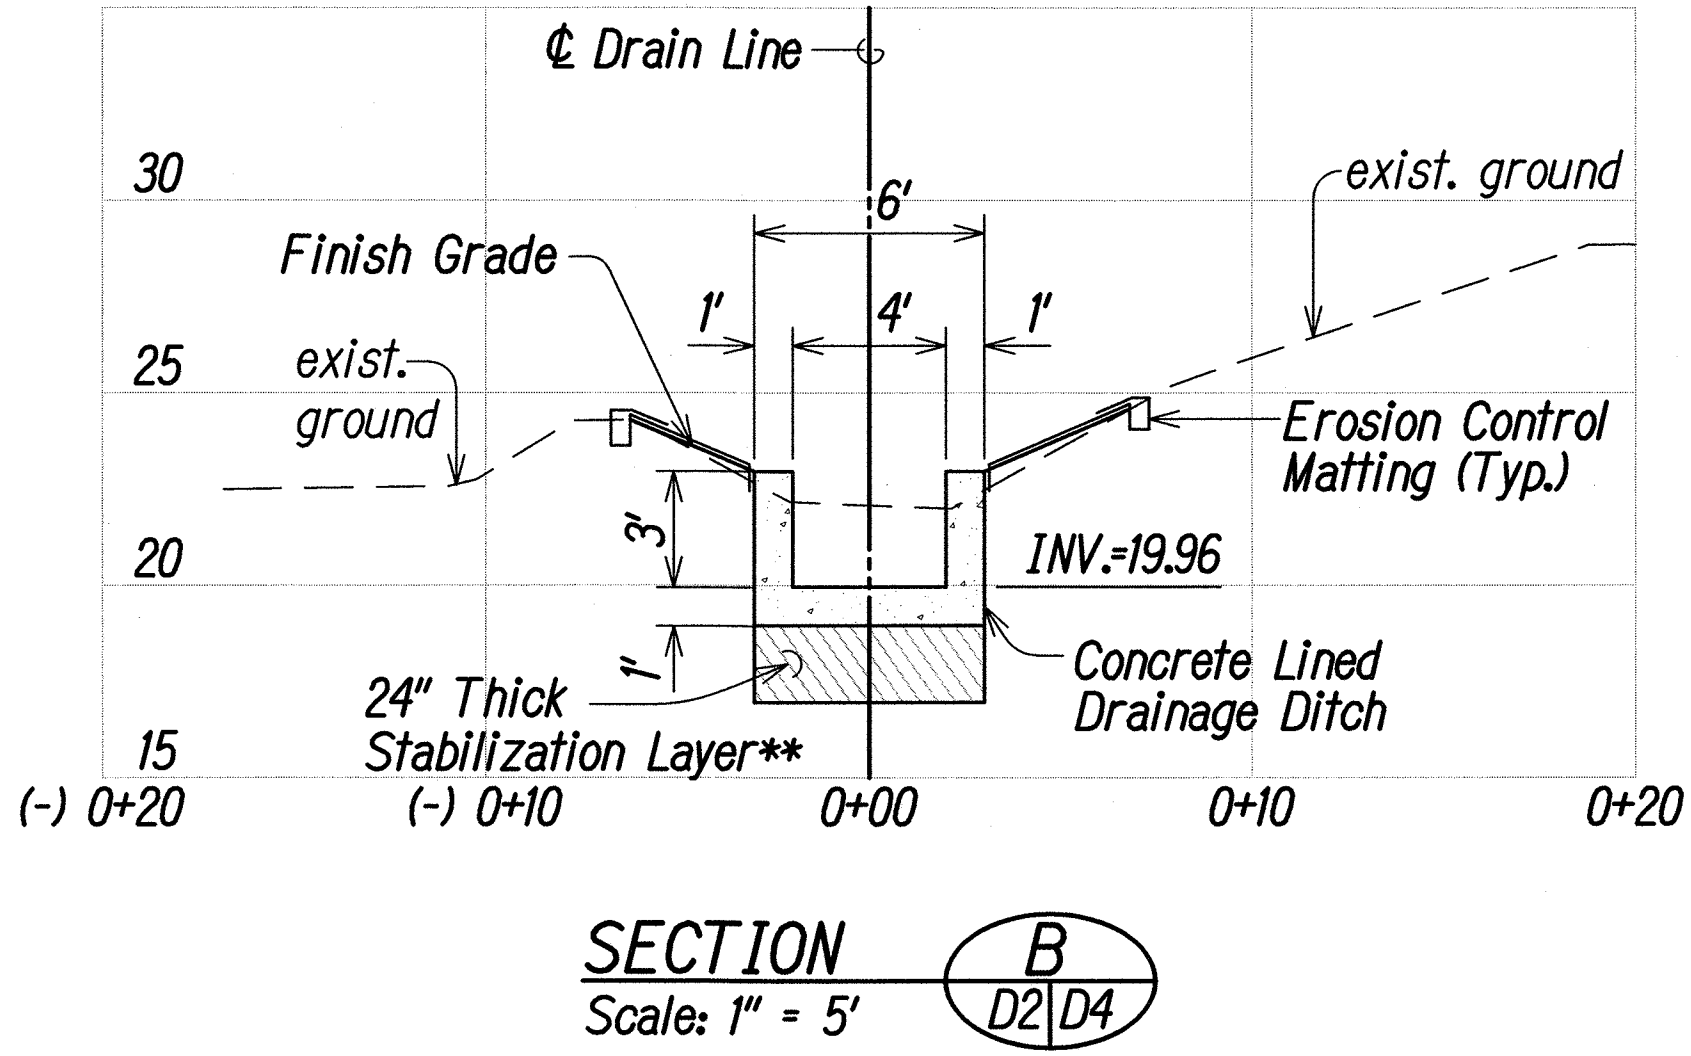
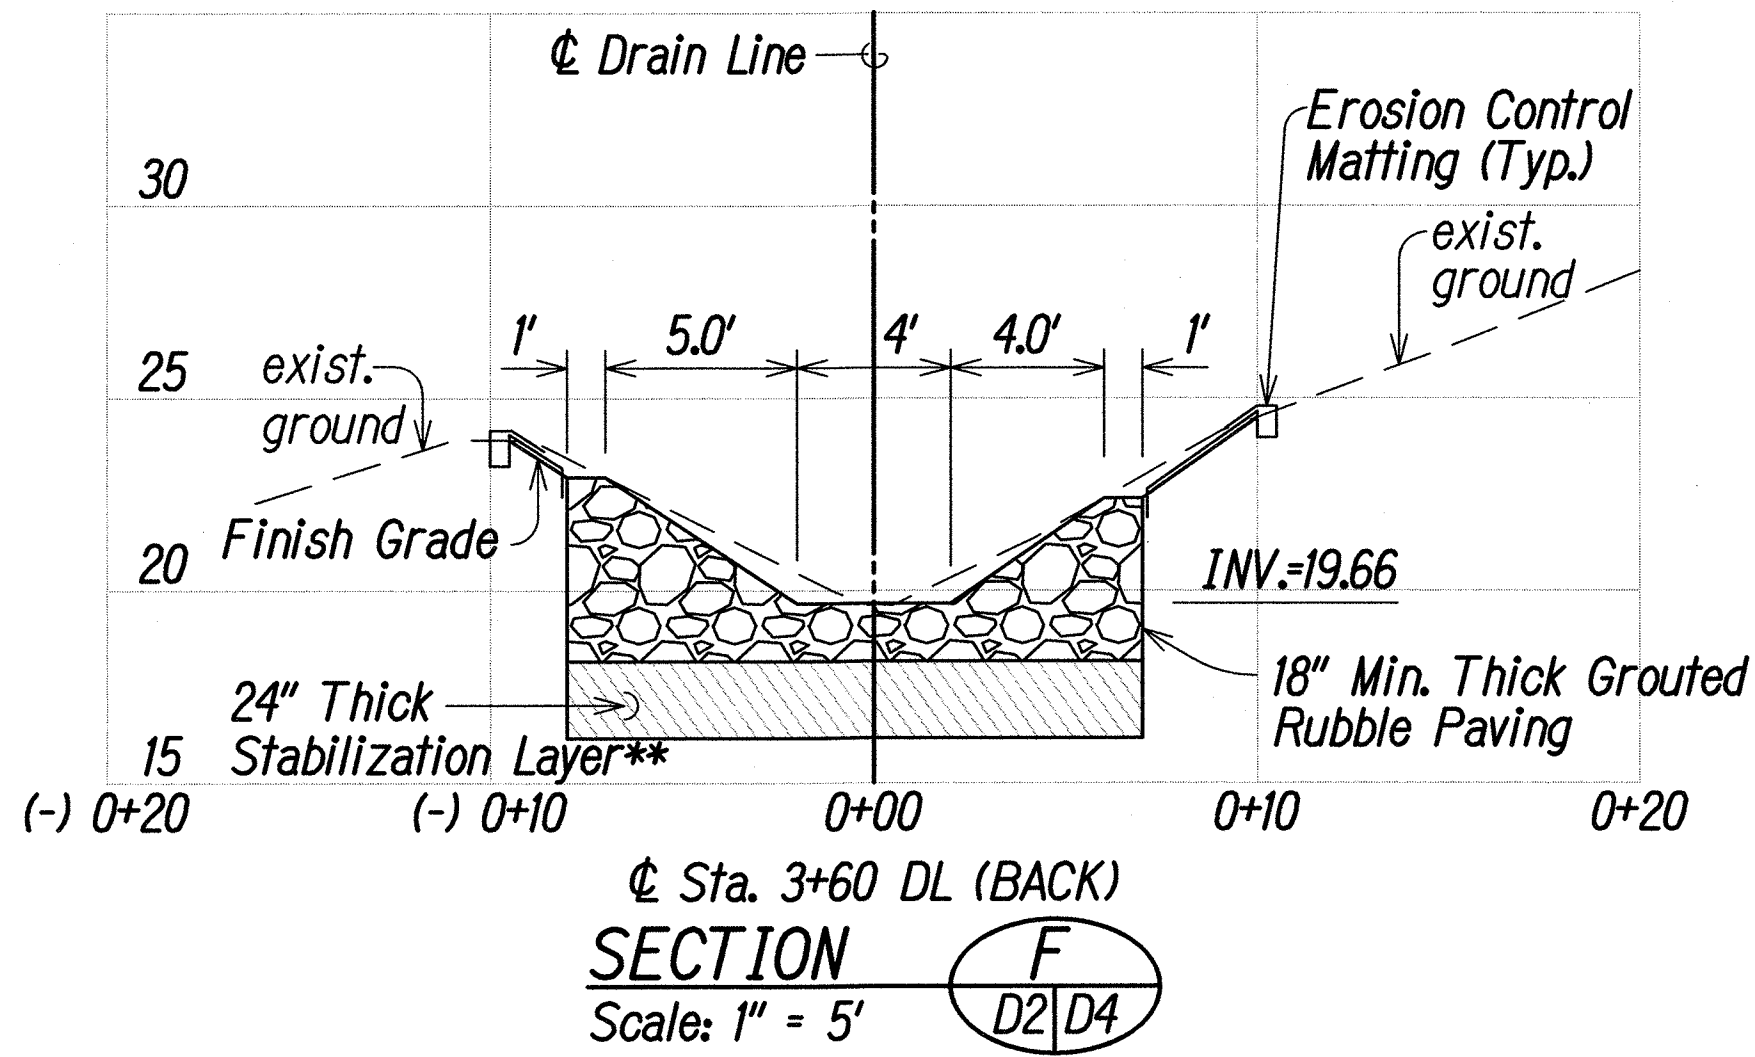


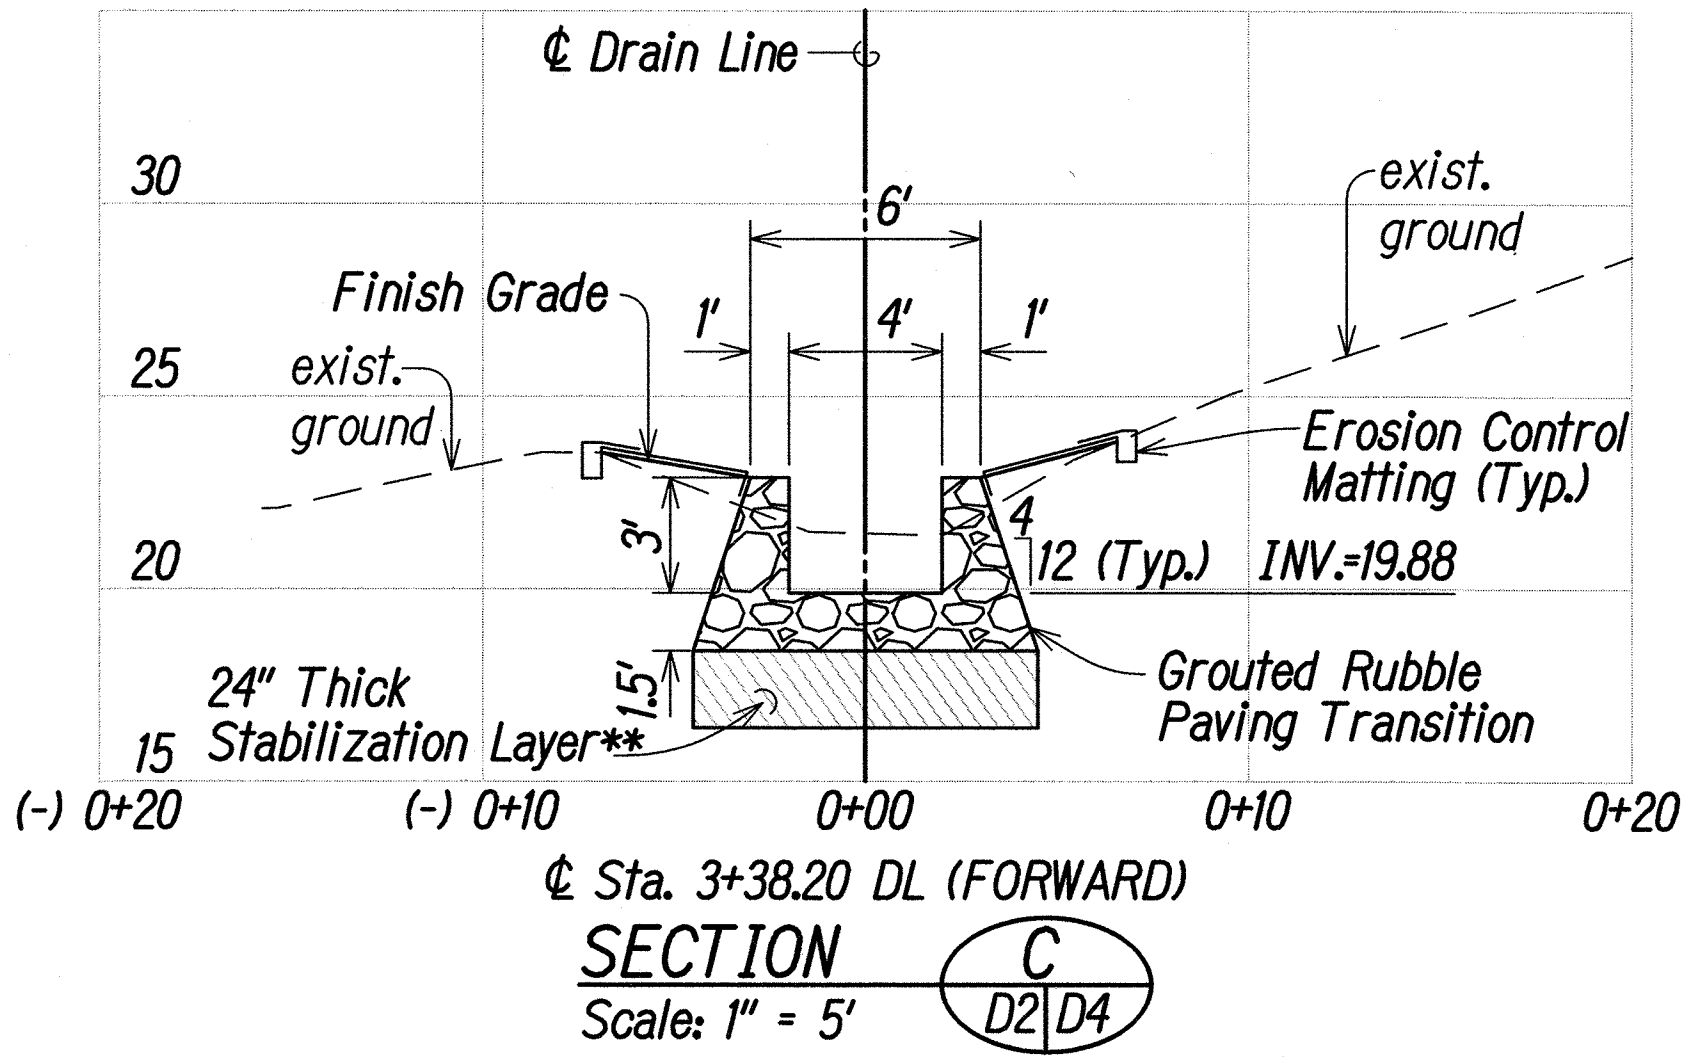

Note:
 ** Contractor shall over-excavate to a depth of 2 feet min. if soft and/or loose soil is encountered as determined by the Engineer. Install 2 feet min. thick Stabilization Layer consisting of No. 2 Basalt Aggregate (ASTM C33, No. 4 Gradation) wrapped with Non-Woven Filter Fabric (Mirafi 180N or equivalent).

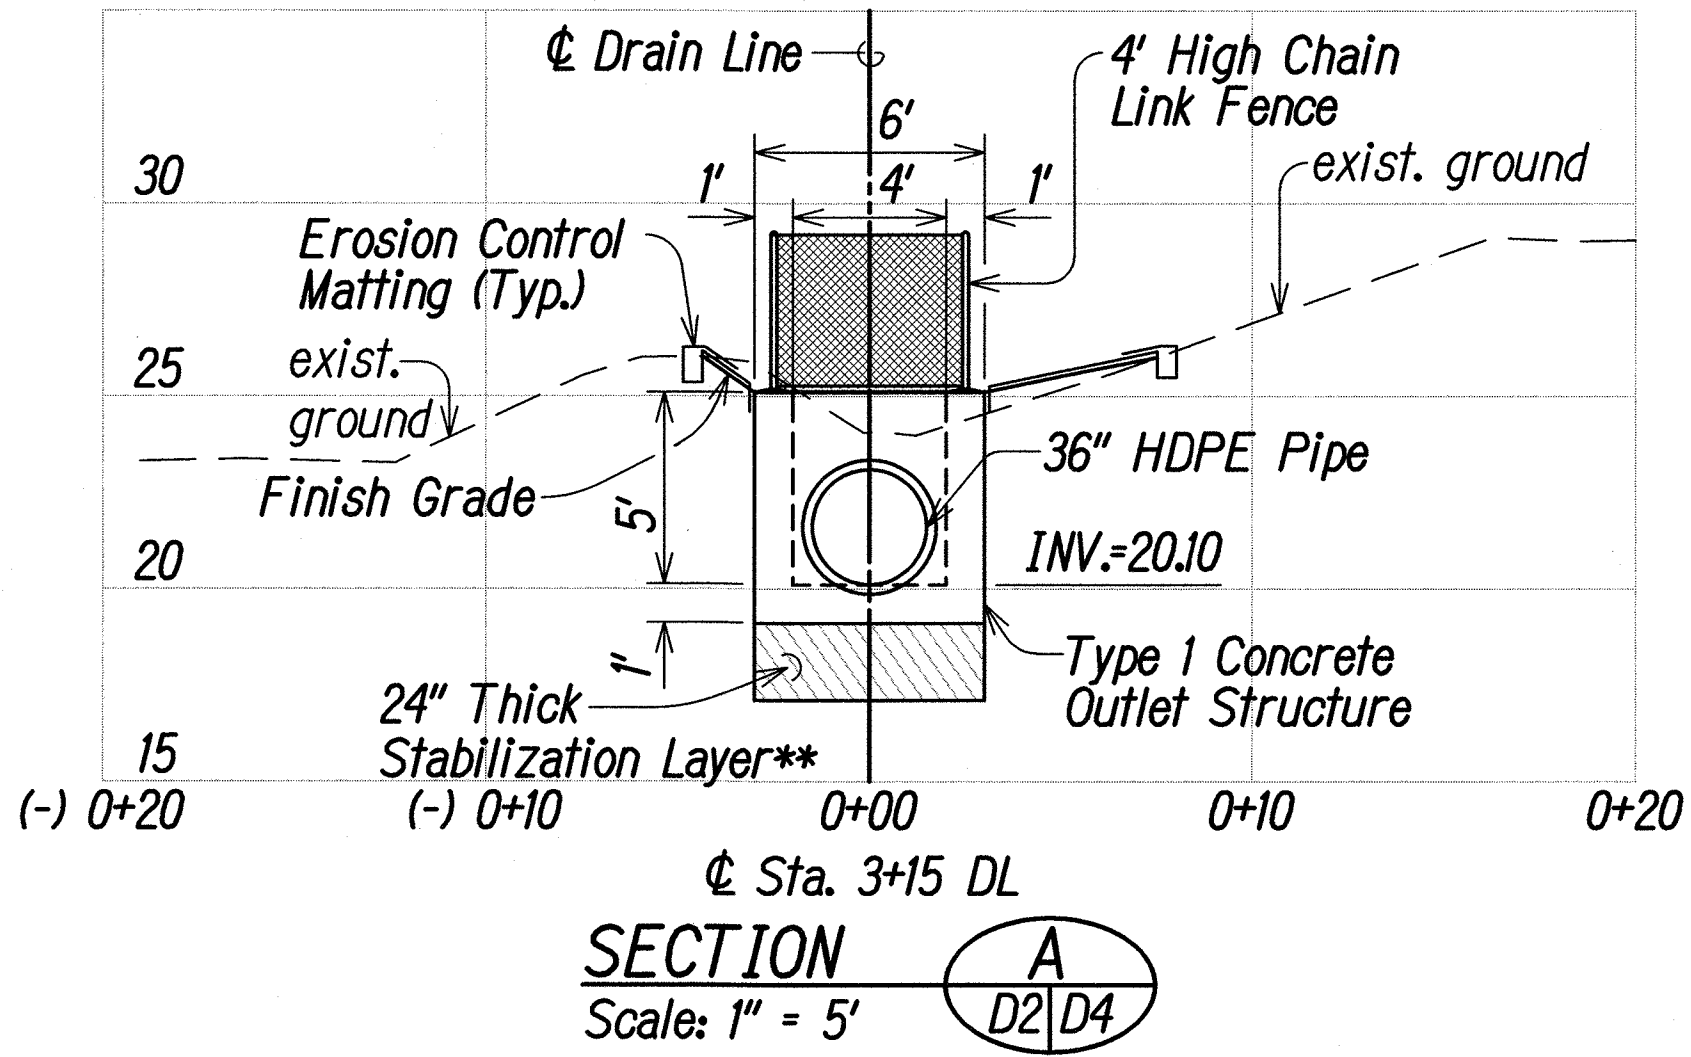

THIS WORK WAS PREPARED BY ME OR UNDER MY SUPERVISION.
 Russell M. Araki
 April 30, 2022
 dba PARK ENGINEERING

STATE OF HAWAII
 DEPARTMENT OF TRANSPORTATION
 HIGHWAYS DIVISION

DRAINAGE SECTIONS

FARRINGTON HIGHWAY
 Drainage Improvements
 Vicinity of Leeward Community College
 PROJECT NO. 99D-01-17

Scale: As Shown Date: June 2021

SHEET No. D4 OF D4 SHEETS