




MECHANICAL GENERAL NOTES

FOR THE INSTALLATION OF THE FCU AND ACCU, REUSE EXISTING SUPPORTS AND PIPE ROUTING AS THE PREVIOUS INSTALLATION. PROVIDE NEW SUPPORTS WHERE NECESSARY.



MECHANICAL NEW WORK NOTES

- ① INSTALL NEW FCU, ACCESORIES, T-STAT, REFRIGERANT PIPING, AND CONDENSATE PIPING. CONDENSATE PIPING TO CONNECT TO STORM DRAIN.
- ② INSTALL NEW ACCU. PROVIDE NEW REFRIGERANT PIPING TO THE FCU, PROVIDE CLEARANCES PER MANUFACTURER'S RECOMMENDATIONS. REFRIGERANT PIPING TO BE SIZED PER MANUFACTURER'S RECOMMENDATIONS.

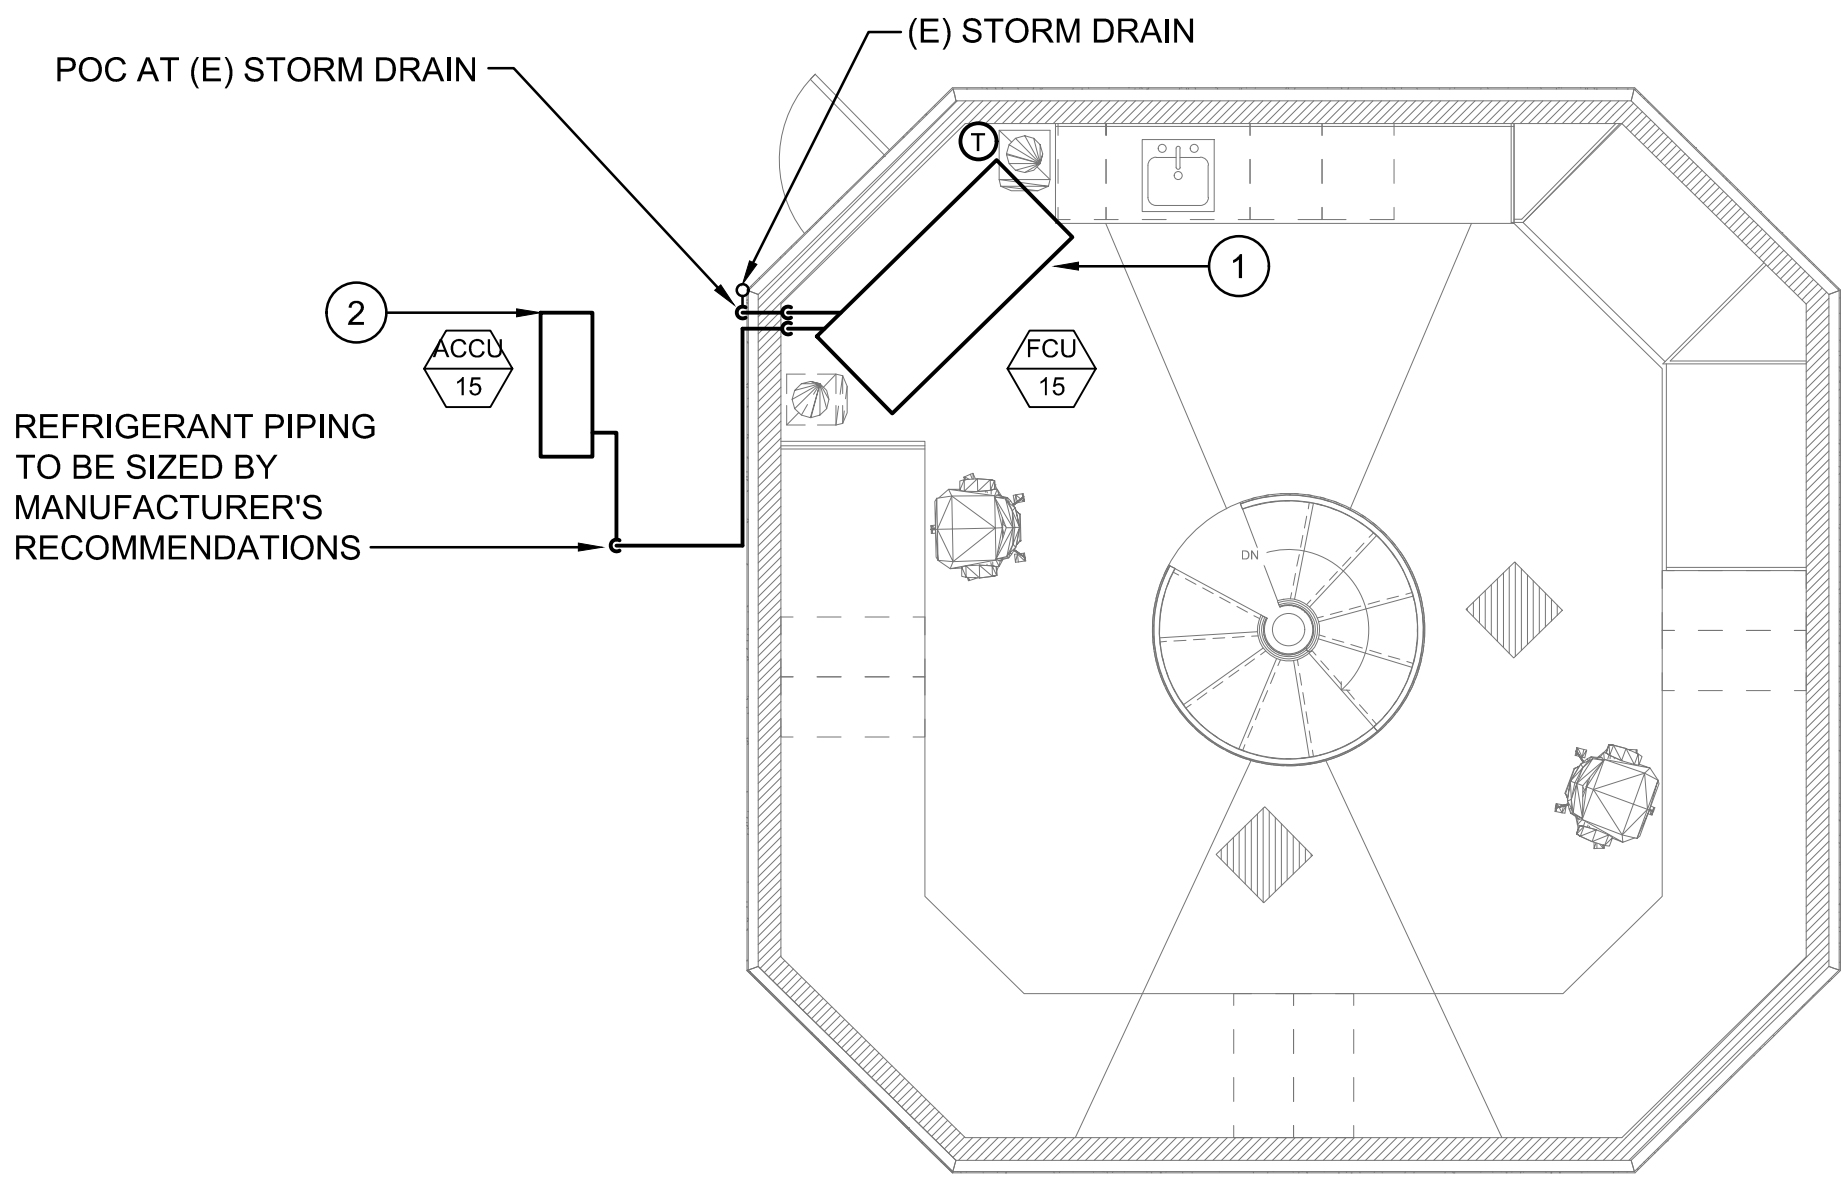


AIR TRAFFIC CONTROL TOWER 4TH LEVEL MECHANICAL NEW WORK PLAN

SCALE: 1/4" = 1'-0"

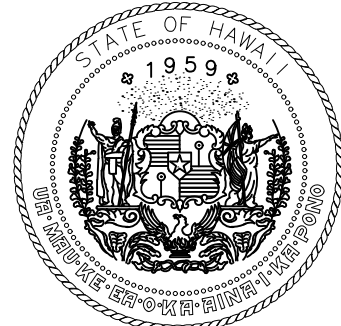

Airports Division
DEPARTMENT OF TRANSPORTATION
STATE OF HAWAII

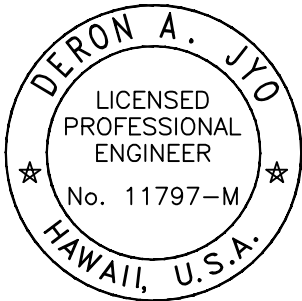

04/30/2024

Deron A. Jyo

This work was prepared by me or under my supervision.

DSGN.	DRWN.	CHKD.	APPD.
-------	-------	-------	-------

NO.	DATE	REVISIONS
-----	------	-----------

**FINAL
SUBMITTAL**

09/30/22
DATE

PROJECT TITLE :

**AIR TRAFFIC CONTROL
TOWER REPAIRS**

AT
KALAELOA AIRPORT
BARBERS POINT, OAHU, HAWAII

PROJECT NO.:

AO5024-03

SHEET TITLE:

**AIR TRAFFIC CONTROL
TOWER, 4TH LEVEL
MECHANICAL NEW
WORK PLAN**

DATE :

9/30/22

SHEET :

41 OF 49 SHEET

DWG. NO.

M106