



FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW	I-41-1(32)-5, Unit 4	1967	71	101

WATER NOTES


1. The Contractor shall notify the Board of Water Supply 7 days prior to commencing work on the cable relocation.
2. The Contractor shall furnish and install the 3" Control Cable Conduit and construct Type "C" Conduit Manhole. BWS shall furnish and install the Control Cable.
3. The existing type "C" Manhole frame & cover shall be cleaned, painted and reused at the new manhole constructed.
4. Contractor shall stubout conduit at the manhole as directed by the Engineer.

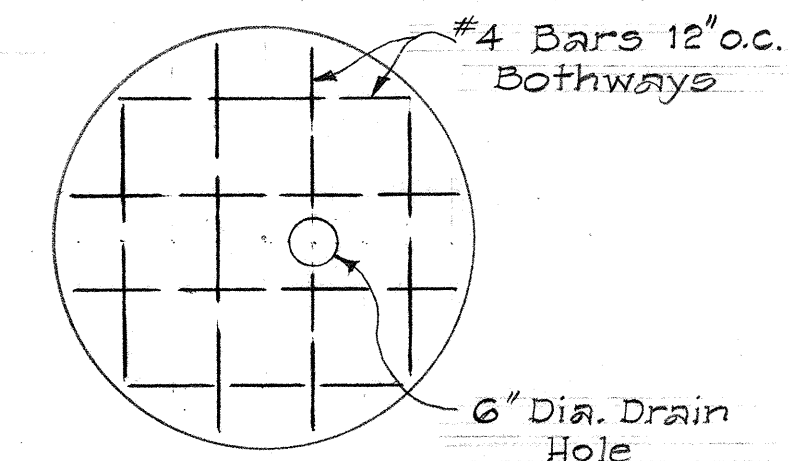


STEEL DETAIL
IN BOTTOM SLAB
Scale: 1/2"=1'-0"

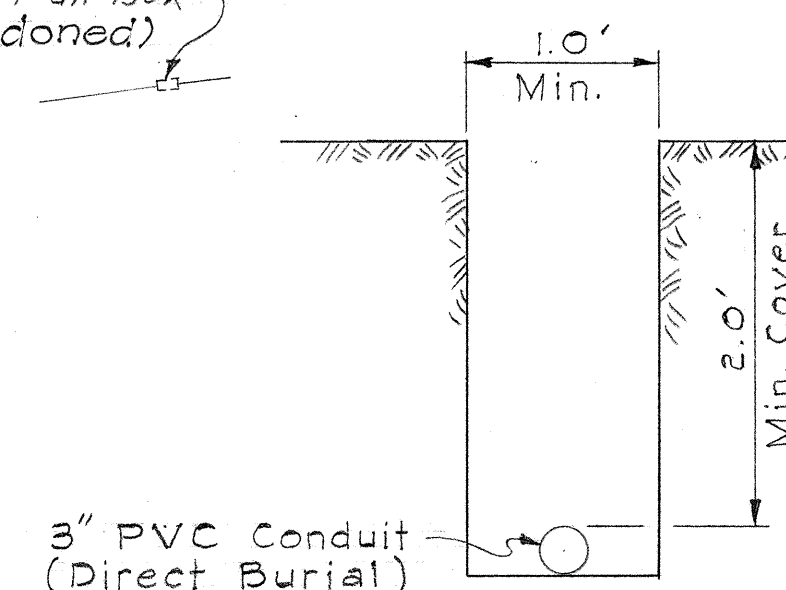

TYPICAL TRENCH DETAIL
Scale: 1"=1'-0"

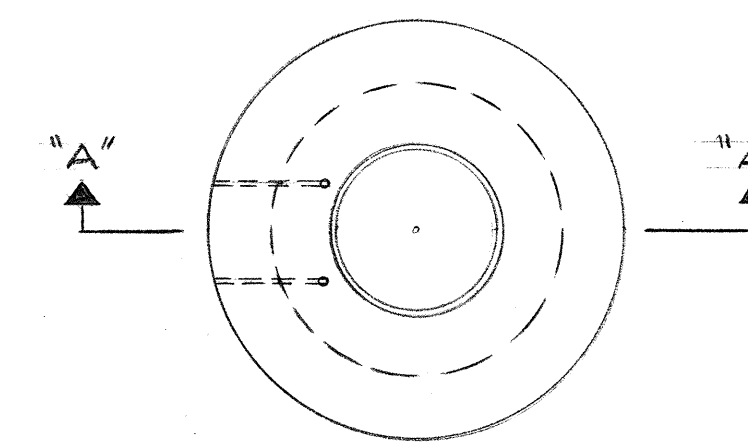

PLAN
Scale: 1/2"=1'-0"


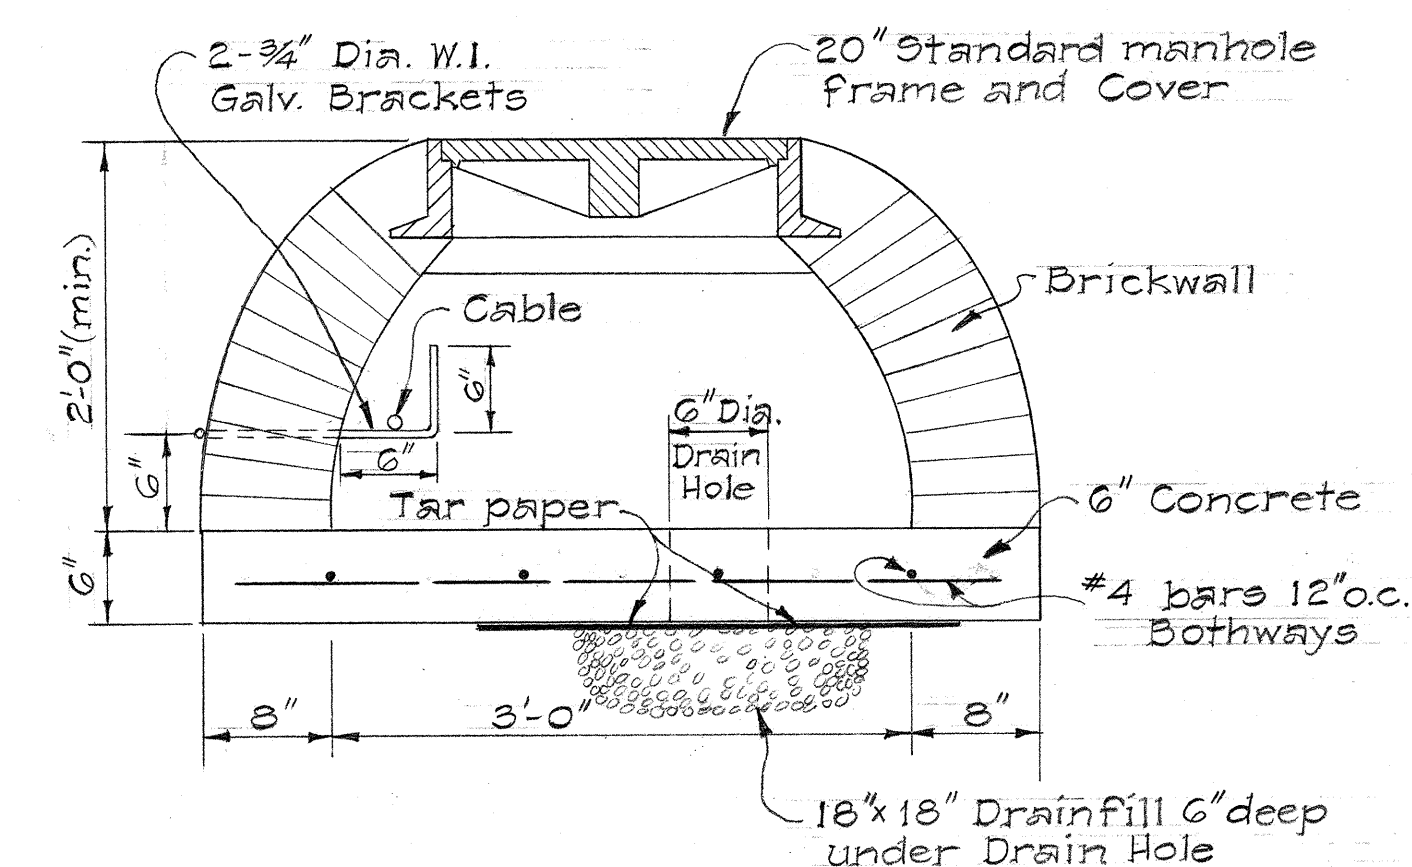


SECTION "A-A"
Scale: 1"=1'-0"

CONDUIT MANHOLE (TYPE "C")
Scale: As Shown

DATE	BY	DATE	BY

DATE	BY	DATE	BY

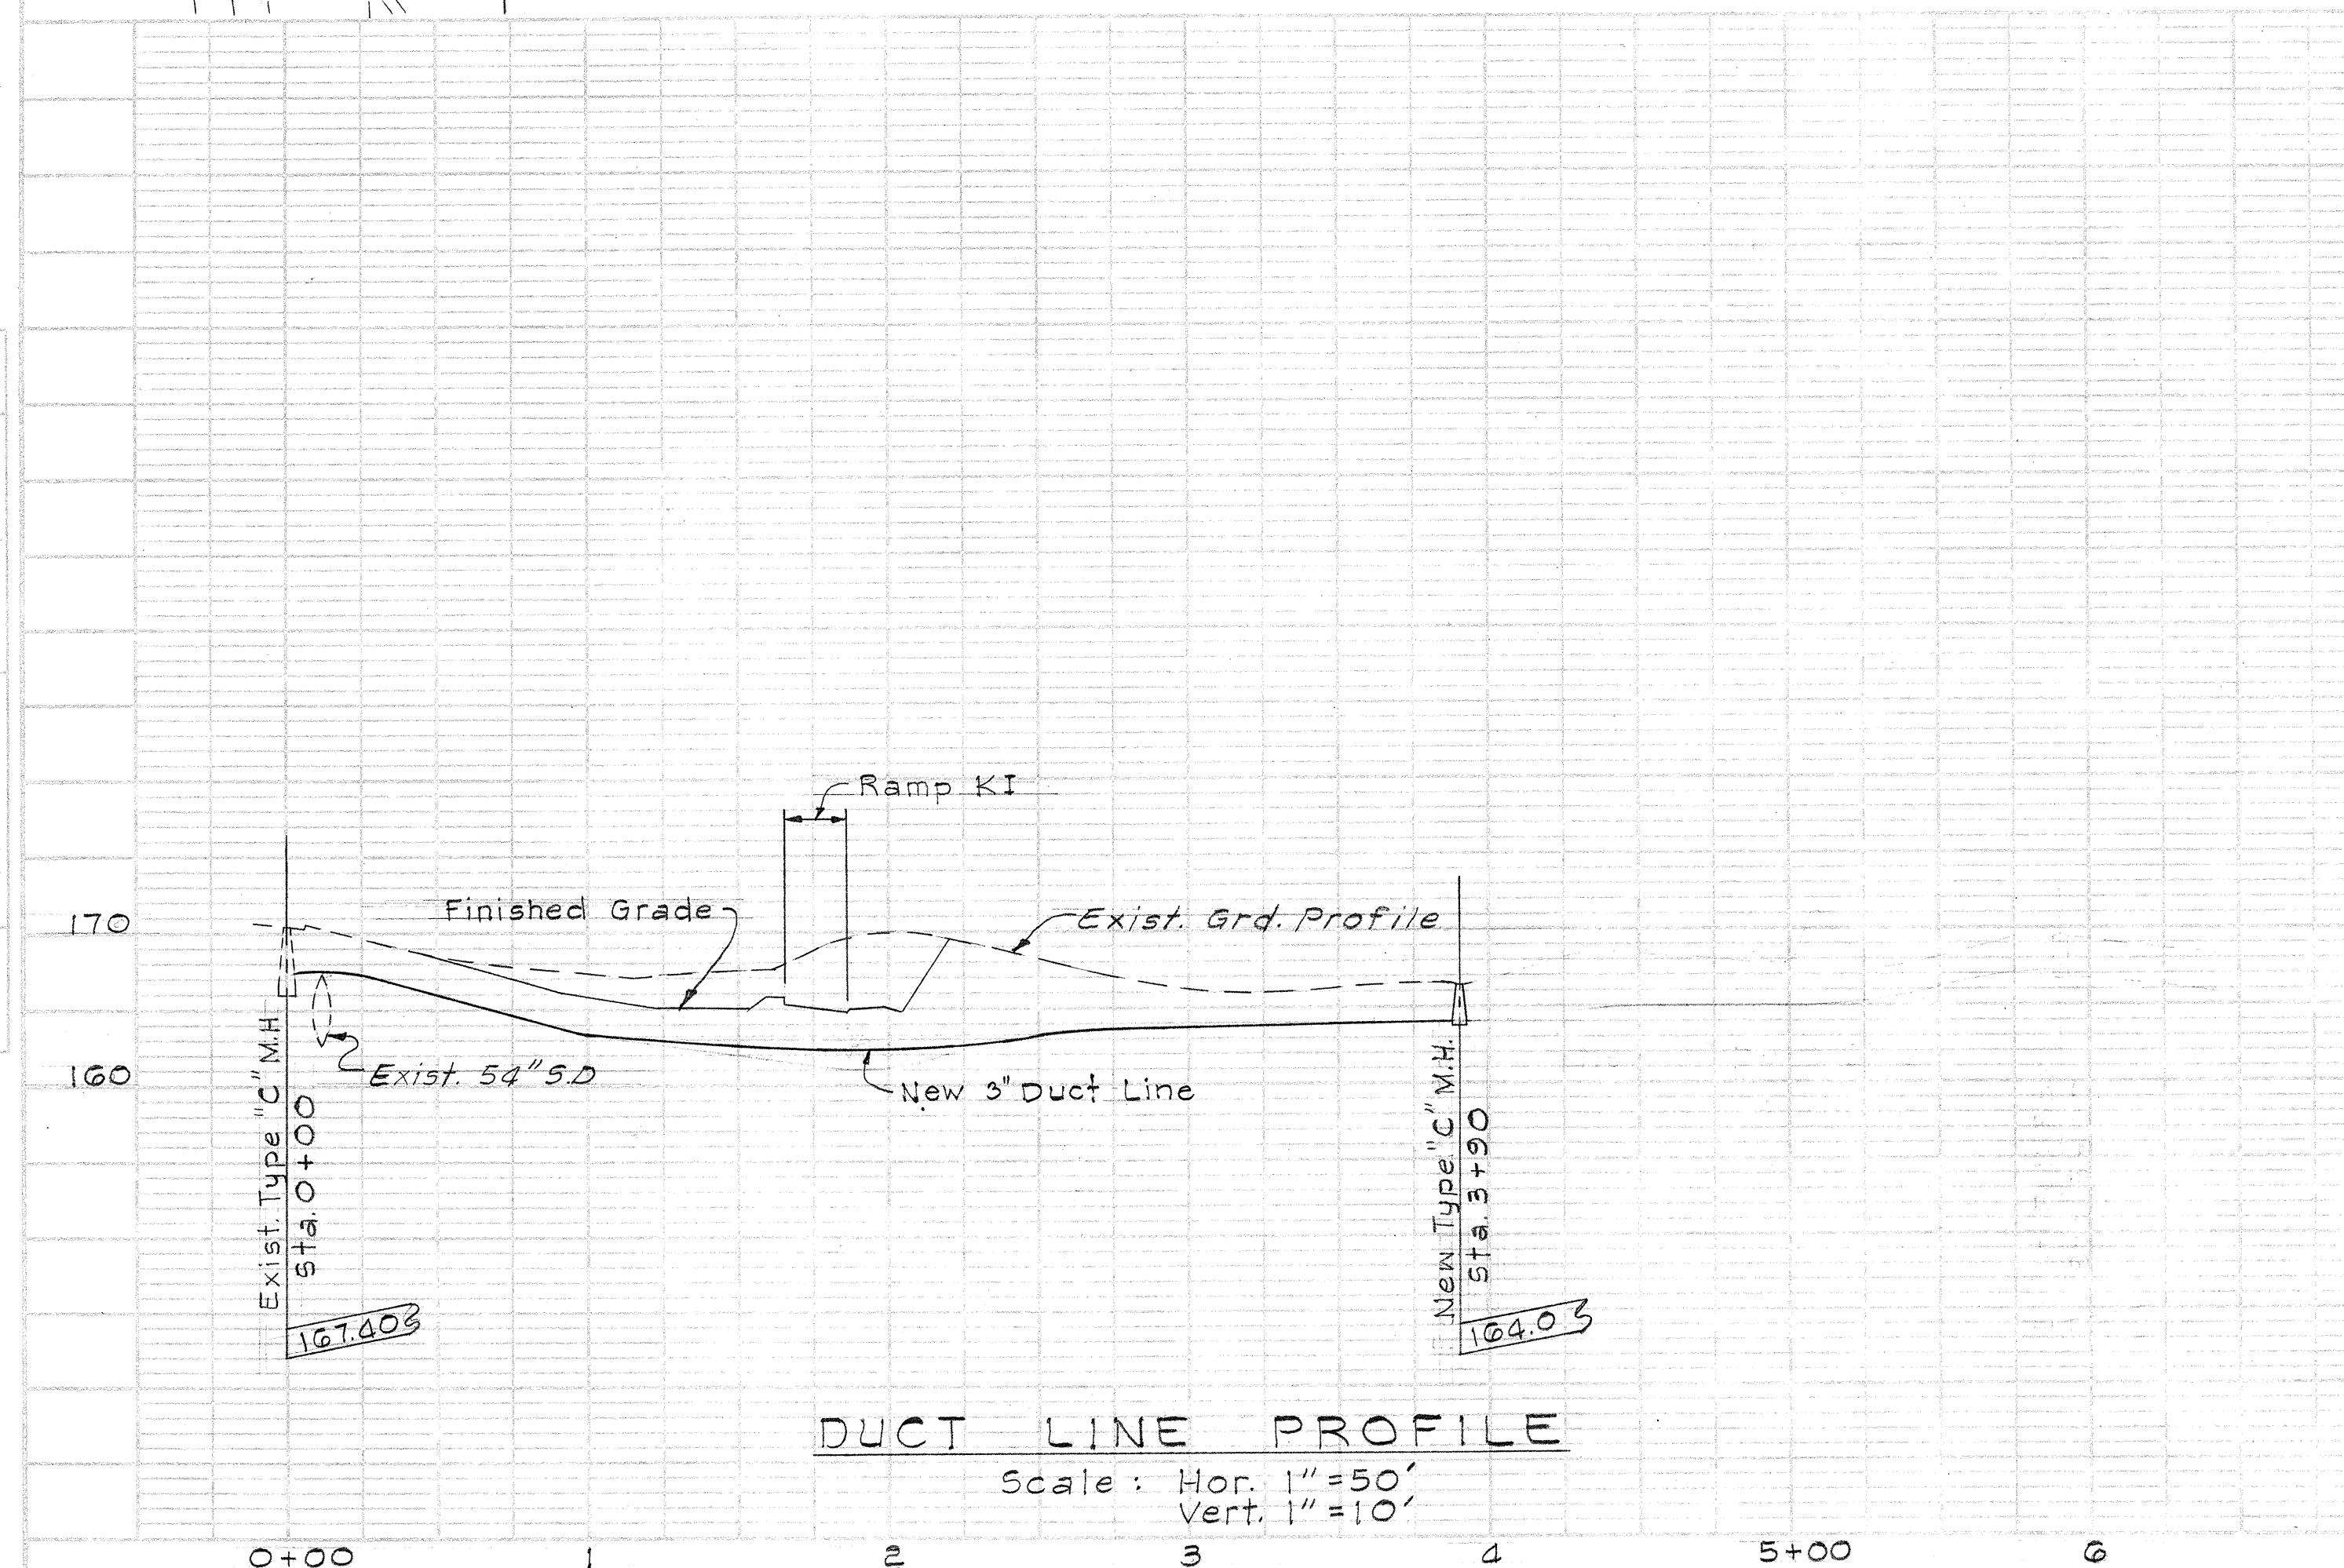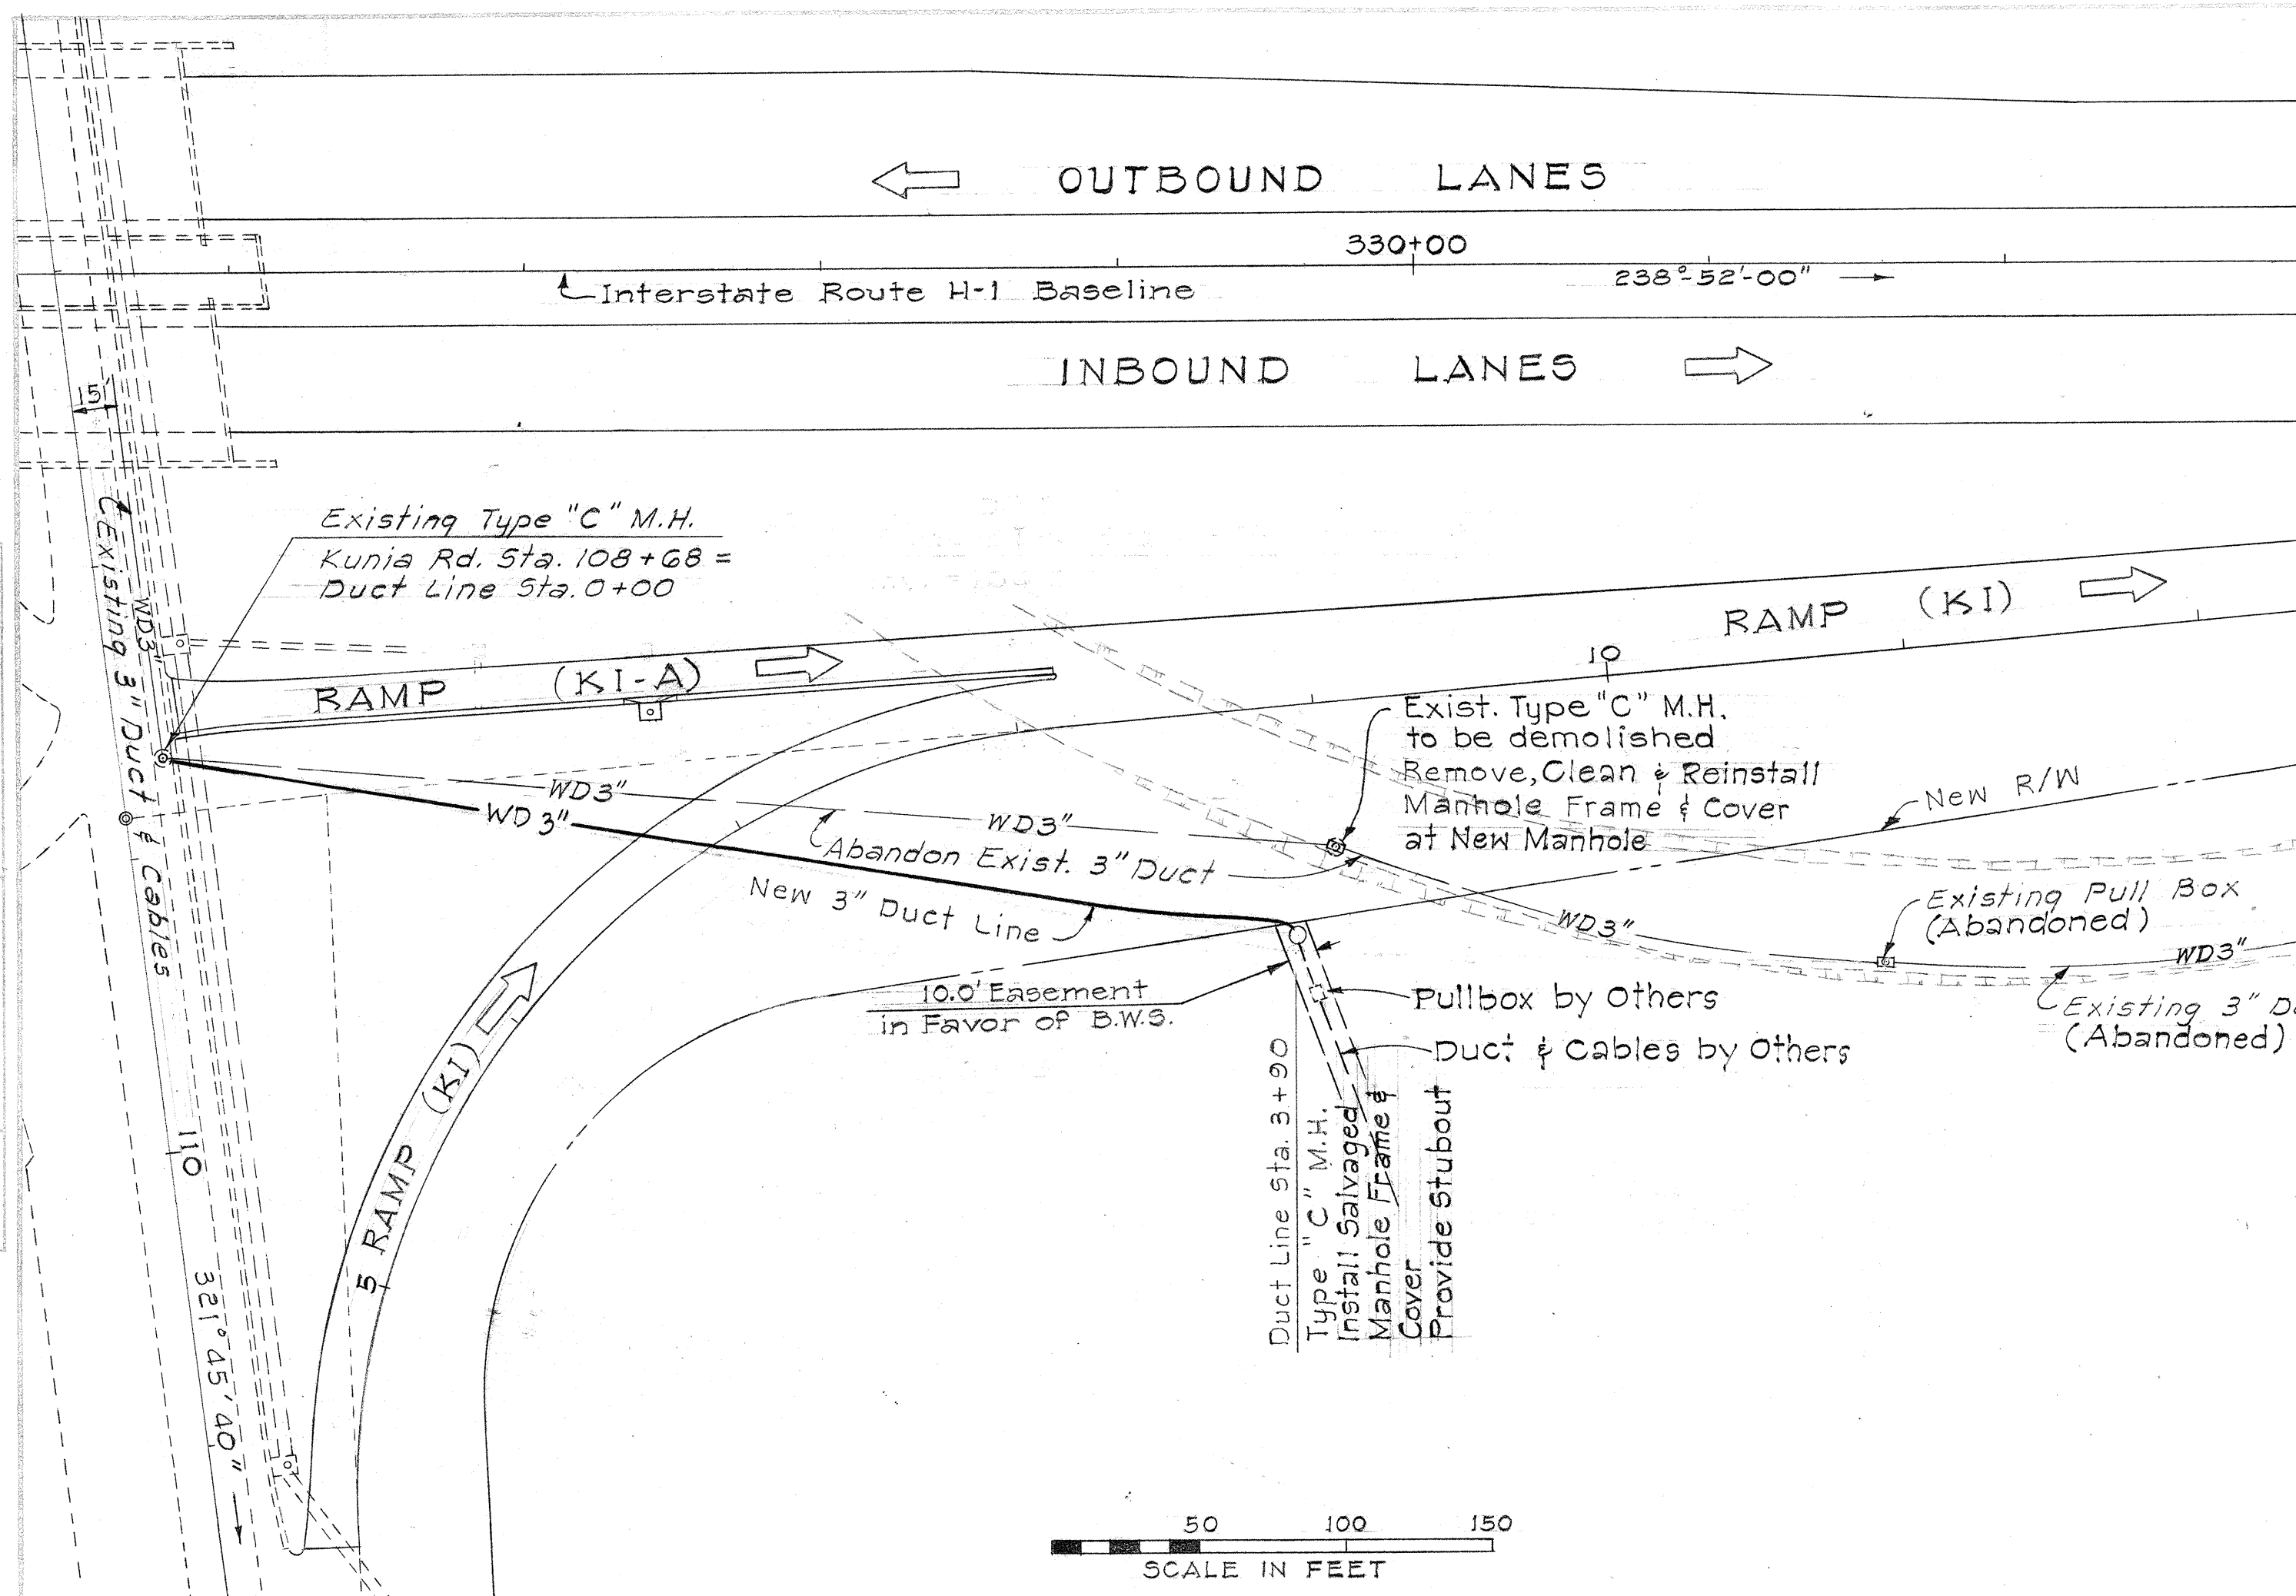

APPROVED:
[Signature]
for CHIEF, ENG'R. DIVISION, BWS. DATE 12-8-67

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION
**RELOCATION OF B.W.S.
CONTROL LINE SYSTEM**
INTERSTATE ROUTE H-1
F.A.I. Proj. No. I-41-1(32)-5, Unit 4
Scale: As Noted Date: Aug., 1967
SHEET No. 1 OF 1 SHEETS