

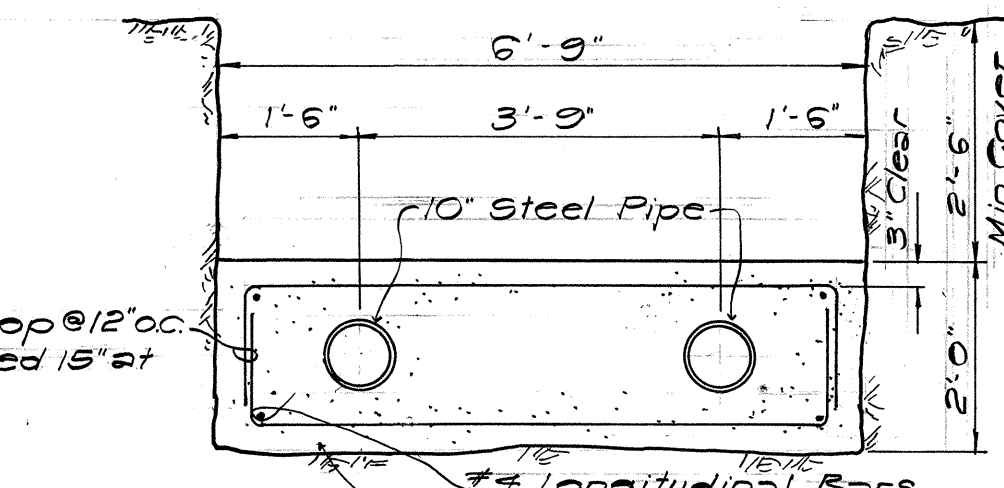


PLAN	SURVEYED	BY	DATE
NOTE BOOK	PLOTTED		
	ALIGNMENT CHECKED		
	RT. OF WAY CHECKED		
NO	EX-17		

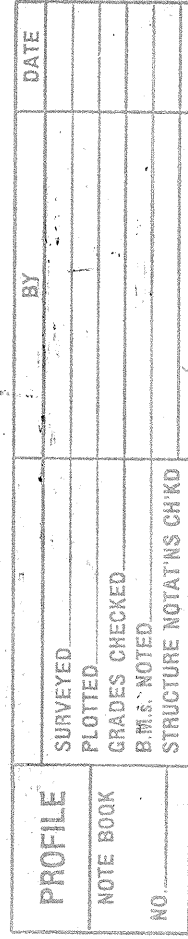

Hand-drawn cross-section diagram of a trench for two 10-inch steel pipes. The trench is 6'-0" wide and 3'-0" deep. The pipes are spaced 3'-0" apart, with 1'-6" from the trench walls to the center of each pipe. The trench is lined with a 6-inch thick material. A "Min. Cover" dimension of 3'-0" is indicated for the depth. The diagram is labeled "Un. Pip" at the bottom right.

1. The location of existing utilities shown on the plans are approximate only and it is the Contractor's responsibility to determine the exact location to his complete satisfaction.
2. Bends shall be made of segmentally welded sections of the same schedule as the pipe with a minimum radius of 5 feet.
3. The ends of abandoned lines shall be plugged with concrete and this work shall be considered incidental to structure excavation.



Scale : As shown Date: JAN. 1968