

WATER POLLUTION AND EROSION CONTROL NOTES:

A. GENERAL:

1. See Section 209 - Water Pollution and Erosion Control. Section 209 describes but is not limited to: submittal requirements; scheduling of a water pollution and erosion control conference with the Engineer; construction requirements; method of measurement; and basis of payment.
2. Effective October 1, 2008, follow the guidelines in the "Construction Best Management Practices Field Manual", dated January 2008 in developing, installing and maintaining the Best Management Practices (BMP) for the project.
3. Follow the guidelines in the Honolulu's City & County "Rules Relating to Soil Erosion Standards and Guidelines" along with applicable Soil Erosion Guidelines for projects on Maui, Molokai, Kauai, and Hawaii.
4. The Engineer may assess liquidated damages of up to \$27,500 for non-compliance of each BMP requirement and each requirement stated in Section 209, for every day of non-compliance. There is no maximum limit on the amount assessed per day.
5. The Engineer will deduct the cost from the progress payment for all citations received by the Department for non-compliance, or the Contractor shall reimburse the State for the full amount of the outstanding cost incurred by the State.
6. For projects that require an NPDES Permit from the Department of Health, install a rain gage prior to any field work including the installation of any site-specific best management practices. The rain gage shall have a tolerance of at least 0.05 inches of rainfall, and have an opening of at least one-inch in diameter. Install the rain gage on the project site in an area that will not deter rainfall from entering the gage opening. The rain gage installation shall be stable and plumbed. Do not begin field work until the rain gage is installed and site-specific best management practices are in-place.

B. WASTE DISPOSAL:

1. Waste Materials
Collect and store all waste materials in a securely lidded metal dumpster. The dumpster shall meet all local and State solid waste management regulations. Deposit all trash and construction debris from the site in the dumpster. Empty the dumpster a minimum of twice per week or as often as is deemed necessary. Do not bury construction waste materials onsite. The Contractor's supervisory personnel shall be instructed regarding the correct procedure for waste disposal. Post notices stating these practices in the office trailer and the Contractor shall be responsible for seeing that these procedures are followed.
2. Hazardous Waste
Dispose all hazardous waste materials in the manner specified by local or State regulations and by the manufacturer. The Contractor's site personnel shall be instructed in these practices and shall be responsible for seeing that these practices are followed.
3. Sanitary Waste
Collect all sanitary waste from the portable units a minimum of once per week, or as required.

C. EROSION AND SEDIMENT CONTROL INSPECTION AND MAINTENANCE PRACTICES:

1. Inspect all control measures at least once each week and within 24 hours of any rainfall event of 0.5 inches or greater within a 24 hour period.

2. Maintain all measures in good working order. If repair is necessary, it shall be initiated within 24 hours after the inspection.
3. Remove built-up sediment from silt fence when it has reached one-third the height of the fence.
4. Inspect silt screen or fence for depth of sediment, tears, to verify that the fabric is securely attached to the fence posts or concrete slab and to verify that the fence posts are firmly in the ground. Inspect and verify the bottom of the silt screen is buried a minimum of 6 inches below the existing ground.
5. Inspect temporary and permanent seeding and planting for bare spots, washouts and healthy growth.
6. Make a maintenance inspection report promptly after each inspection. Submit a copy to the Engineer no later than one week from the date of the inspection.
7. Provide a stabilized construction entrance to reduce vehicle tracking of sediments. Include stabilized construction entrance in the Water Pollution, $\frac{1}{3}$ Dust, and Erosion Control submittals. $\frac{1}{3}$ Minimum length should be 50 feet. $\frac{1}{3}$ Minimum width should be 30 feet. $\frac{1}{3}$ Minimum depth should be 12 inches or as recommended by the soils engineer and underlain with geo-textile fabric. $\frac{1}{3}$ Clean the paved $\frac{1}{3}$ street adjacent to the site entrance daily or as required to remove any excess $\frac{1}{3}$ mud, cold -planed materials, dirt or rock tracked from the site. $\frac{1}{3}$ Cover dump trucks $\frac{1}{3}$ hauling material from the construction site with a tarpaulin.
8. Include designated Concrete Washout Area(s) in the Water Pollution, Dust, and Erosion Control submittals.
9. Submit the name of a specific individual designated responsible for inspections, maintenance and repair activities and filling out the inspection and maintenance report.
10. Personnel selected for the inspection and maintenance responsibilities shall receive training from the Contractor. They shall be trained in all the inspection and maintenance practices necessary for keeping the erosion and sediment controls used onsite in good working order.
11. Contain, remove, and dispose slurry generated from saw cutting of pavement in accordance with approved BMP practices. Payment for confinement, removal, and disposal of slurry shall be considered incidental to the various contract items.

D. GOOD HOUSEKEEPING BEST MANAGEMENT PRACTICES:

1. Materials Pollution Prevention Plan
 - a. Applicable materials or substances listed below are expected to be present onsite during construction. Other materials and substances not listed below shall be added to the inventory.

Concrete
Detergents
Paints (enamel and latex)
Metal Studs
Tar
Fertilizers
Petroleum Based Products
Cleaning Solvents
Wood
Masonry Block


FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAWAII	BR-H1-1(249)	2010	5	61

- b. Use Material Management Practices to reduce the risk of spills or other accidental exposure of materials and substances to storm water runoff. Make an effort to store only enough product as is required to do the job.
- c. Store all materials stored onsite in a neat, orderly manner in their appropriate containers and if possible under a roof or other enclosure.
- d. Keep products in their original containers with the original manufacturer's label.
- e. Do not mix substances with one another unless recommended by the manufacturer.
- f. Whenever possible, use a product up completely before disposing of the container.
- g. Follow manufacturer's recommendations for proper use and disposal.
- h. Conduct a daily inspection to ensure proper use and disposal of materials onsite.

2. Hazardous Material Pollution Prevention Plan

- a. Keep products in original containers unless they are not resealable.
- b. Retain original labels and material safety data sheets (MSDS).
- c. Dispose of surplus products according to manufacturers' instructions and local and State regulations.

SURVEY PLOTTED BY	DATE
DESIGNED BY	
CHECKED BY	
NOTED BY	
ORIGINAL PLAN	
NOTE BOOK	
NO.	

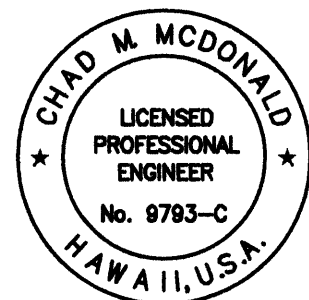

This work was prepared by me or under my supervision

Chad M. McDonald 4/30/2012
MITSUNAGA & ASSOCIATES, INC. EXP. DATE

NOTE: Contractor to check and verify dimensions at job before proceeding with work.

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION
**WATER POLLUTION &
EROSION CONTROL NOTES - 1**
INTERSTATE ROUTE H-1
**Seismic Retrofit- Pali Interchange
and Nuuanu Separation**
Federal Aid Project No. BR-H1-1(249)
Scale: As Noted Date: February 2010
SHEET No. C-2 OF 22 SHEETS

WATER POLLUTION AND EROSION CONTROL NOTES: -Continued

D. GOOD HOUSEKEEPING BEST MANAGEMENT PRACTICES: -cont.

3. Onsite and Offsite Product Specific Plan

The following product specific practices shall be followed onsite:

a. Petroleum Based Products:

Monitor all onsite vehicles for leaks and perform regular preventive maintenance to reduce the chance of leakage. Store petroleum products in tightly sealed containers which are clearly labeled. Apply asphalt substances used onsite according to the manufacturer's recommendation.

b. Fertilizers:

Apply fertilizers used only in the minimum amounts recommended by the manufacturer. Once applied, work fertilizer into the soil to limit exposure to storm water. Storage shall be in a covered shed. Transfer the contents of any partially used bags of fertilizer to a sealable plastic bin to avoid spills.

c. Paints:

Seal and store all containers when not required for use. Do not discharge excess paint to the highway drainage system. Dispose properly according to manufacturers' instructions or State and local regulations.

d. Concrete Trucks:

Wash Out or discharge concrete truck drum wash water only at a designated site. Do not discharge water in the highway drainage system or waters of the United States. Contact Drinking Water Branch, Department of Health at 586-4258 to receive permission to designate a disposal site. Clean disposal site as required or as requested by the Owner's representative.

4. Spill Control Plan

a. Post a spill prevention plan to include measures to prevent and clean up each spill.

b. The Contractor shall be the spill prevention and cleanup coordinator. Designate at least three site personnel who shall receive spill prevention and cleanup training. These individuals shall each become responsible for a particular phase of prevention and cleanup. Post the names of responsible spill personnel in the material storage area and in the office trailer onsite.

c. Clearly post manufacturers' recommended methods for spill cleanup. Make site personnel aware of the procedures and the location of the information and cleanup supplies.

d. Keep materials and equipment necessary for spill cleanup in the material storage area onsite.

e. Clean up all spills immediately after discovery.

f. Keep the spill area well ventilated. Personnel shall wear appropriate protective clothing to prevent injury from contact with a hazardous substance.

g. Report spills of toxic hazardous material to the appropriate State or local government agency, regardless of the size.

E. PERMIT REQUIREMENTS:

1. If a National Pollutant Discharge Elimination System (NPDES) Permit is required for Construction Activities of one acre or more, submit to the Engineer six sets of the Water Pollution and Erosion Control Submittals as detailed in Subsection 209.03 of the specifications.

2. If an NPDES Permit for Construction Dewatering is required, the Contractor shall be responsible to obtain the Permit from the Department of Health, Clean Water Branch.

3. Comply with all applicable State and Federal Permit conditions. Permits may include but are not limited to the following:

- a. NPDES Permit for Construction Activities
- b. NPDES Permit for Construction Dewatering
- c. NPDES Permit for Hydrotesting Waters
- d. Water Quality Certification
- e. Stream Channel Alteration Permit
- f. Section 404 Army Corps of Engineer Permit

CONSTRUCTION NOTES FOR GAS FACILITIES

1. The Gas Company gas pipelines in the project area are plastic coated and cathodically protected. The contractor shall be extremely careful when working near these gas pipelines.

2. Written clearances must be obtained from the Gas Company, Maps and Records Department, 515 Kamakee Street, at least five (5) working days prior to starting excavation near these gas pipelines.

3. Since gas line locations on field maps are approximate, the Contractor, after obtaining written clearance, shall call USA North a minimum of two (2) working days before starting excavation to arrange for field location of the existing gas pipelines. The telephone number is 1-800-227-2600.

4. The contractor shall excavate and backfill around gas pipelines in the presence of a representative of The Gas Company. All backfill within six inches of any gas pipeline shall be select cushion material approved by The Gas Company.

5. For relocation of any gas pipeline, the Contractor shall notify The Gas Company five (5) working days before starting work. The telephone number is 594-5574. The Contractor shall provide the necessary excavation and backfill, obtain traffic permits, and restore pavement, sidewalks, and other facilities. Any relocation of gas facilities shall be done by The Gas Company and paid for by the contractor.

6. The Contractor shall notify The Gas Company immediately after any damage as been caused to existing pipelines, coatings, or its cathodic protection devices. The telephone number is 535-5933, 24 hours a day. The Contractor shall be liable for any damage to The Gas Company facilities. Repair work on such damage shall be done by The Gas Company with payment for this work to be borne by the Contractor.

7. Minimum vertical and horizontal clearance between the gas pipelines and other pipelines, conduits, ductlines, or other facilities shall be 12 inches. Adequate support and protection for gas pipelines exposed in the trench shall be provided by the contractor and approved by The Gas Company.

8. The Contractor shall work in an expeditious manner in order to keep the uncovered gas pipelines exposed for as short a period of time as possible.

FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAWAII	BR-H1-1(249)	2010	6	61

WATER NOTES FOR STATE PROJECTS AND GUARDRAIL INSTALLATION

1. Unless otherwise specified, all materials and construction of water system facilities and appurtenances shall be in accordance with the Standard Specifications for Road and Bridge Construction, dated 1994, as amended, of the Hawaii Highways Division, Department of Transportation, and the City and County of Honolulu Board of Water Supply's "Water System Standards", dated 2002, the "Water System External Corrosion Control Standards", volume 3, dated 1991, and all subsequent amendments and additions.

2. The existence and location of underground utilities and structures as shown on the plans are from the latest available data but is not guaranteed as to the accuracy or the encountering of other obstacles during the course of the work. The Contractor shall be responsible and pay for all damages to existing utilities. The Contractor shall not assume that where no utilities are shown, that none exist.


3. The contractor shall be responsible for the protection of all water lines during construction. The Contractor shall be especially careful when excavating behind water lines, tees, and bends whenever there is a possibility of water line movement due to the removal of the supporting earth beyond the existing reaction blocks. The Contractor shall take whatever measure necessary to protect water lines, such as constructing special reaction blocks (with BWS approval) and/or modifying his construction method.

4. Prior to any excavating, the Contractor shall verify in the field the location of existing water mains and appurtenances.

5. The contractor shall have existing water mains toned before construction of work in vicinity of water mains. Call the investigation section at 748-5381 for toning services. Guardrail post locations are to be kept to a minimum clear distance of 18 inches to any 2-1/2 inch water lines and meter boxes. No post driving will be allowed when post is to be installed closer than 3 feet from water main. Excavated areas shall be restored to their original conditions.

6. The contractor shall verify all existing service lateral locations whether shown or not shown on the plans prior to commencing with any of the work and shall not assume that where no services are shown none exists.

ORIGINAL PLAN	DATE	DESIGNED BY	CHECKED BY	NO.
NOTE BOOK				

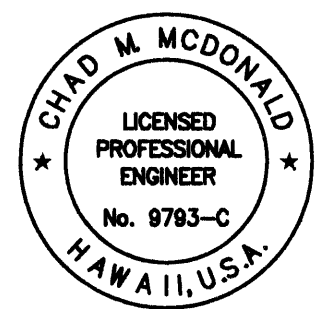

This work was prepared by me or under my supervision

Chad M. McDonald
MCDONALD & ASSOCIATES, INC. EXP. DATE 4/30/2012

NOTE: Contractor to check and verify dimensions at job before proceeding with work.

STATE OF HAWAII DEPARTMENT OF TRANSPORTATION HIGHWAYS DIVISION WATER POLLUTION & EROSION CONTROL NOTES - 2 INTERSTATE ROUTE H-1 Seismic Retrofit- Pali Interchange and Nuuanu Separation Federal Aid Project No. BR-H1-1(249) Scale: As Noted Date: February 2010 SHEET No. C-3 OF 22 SHEETS
--