
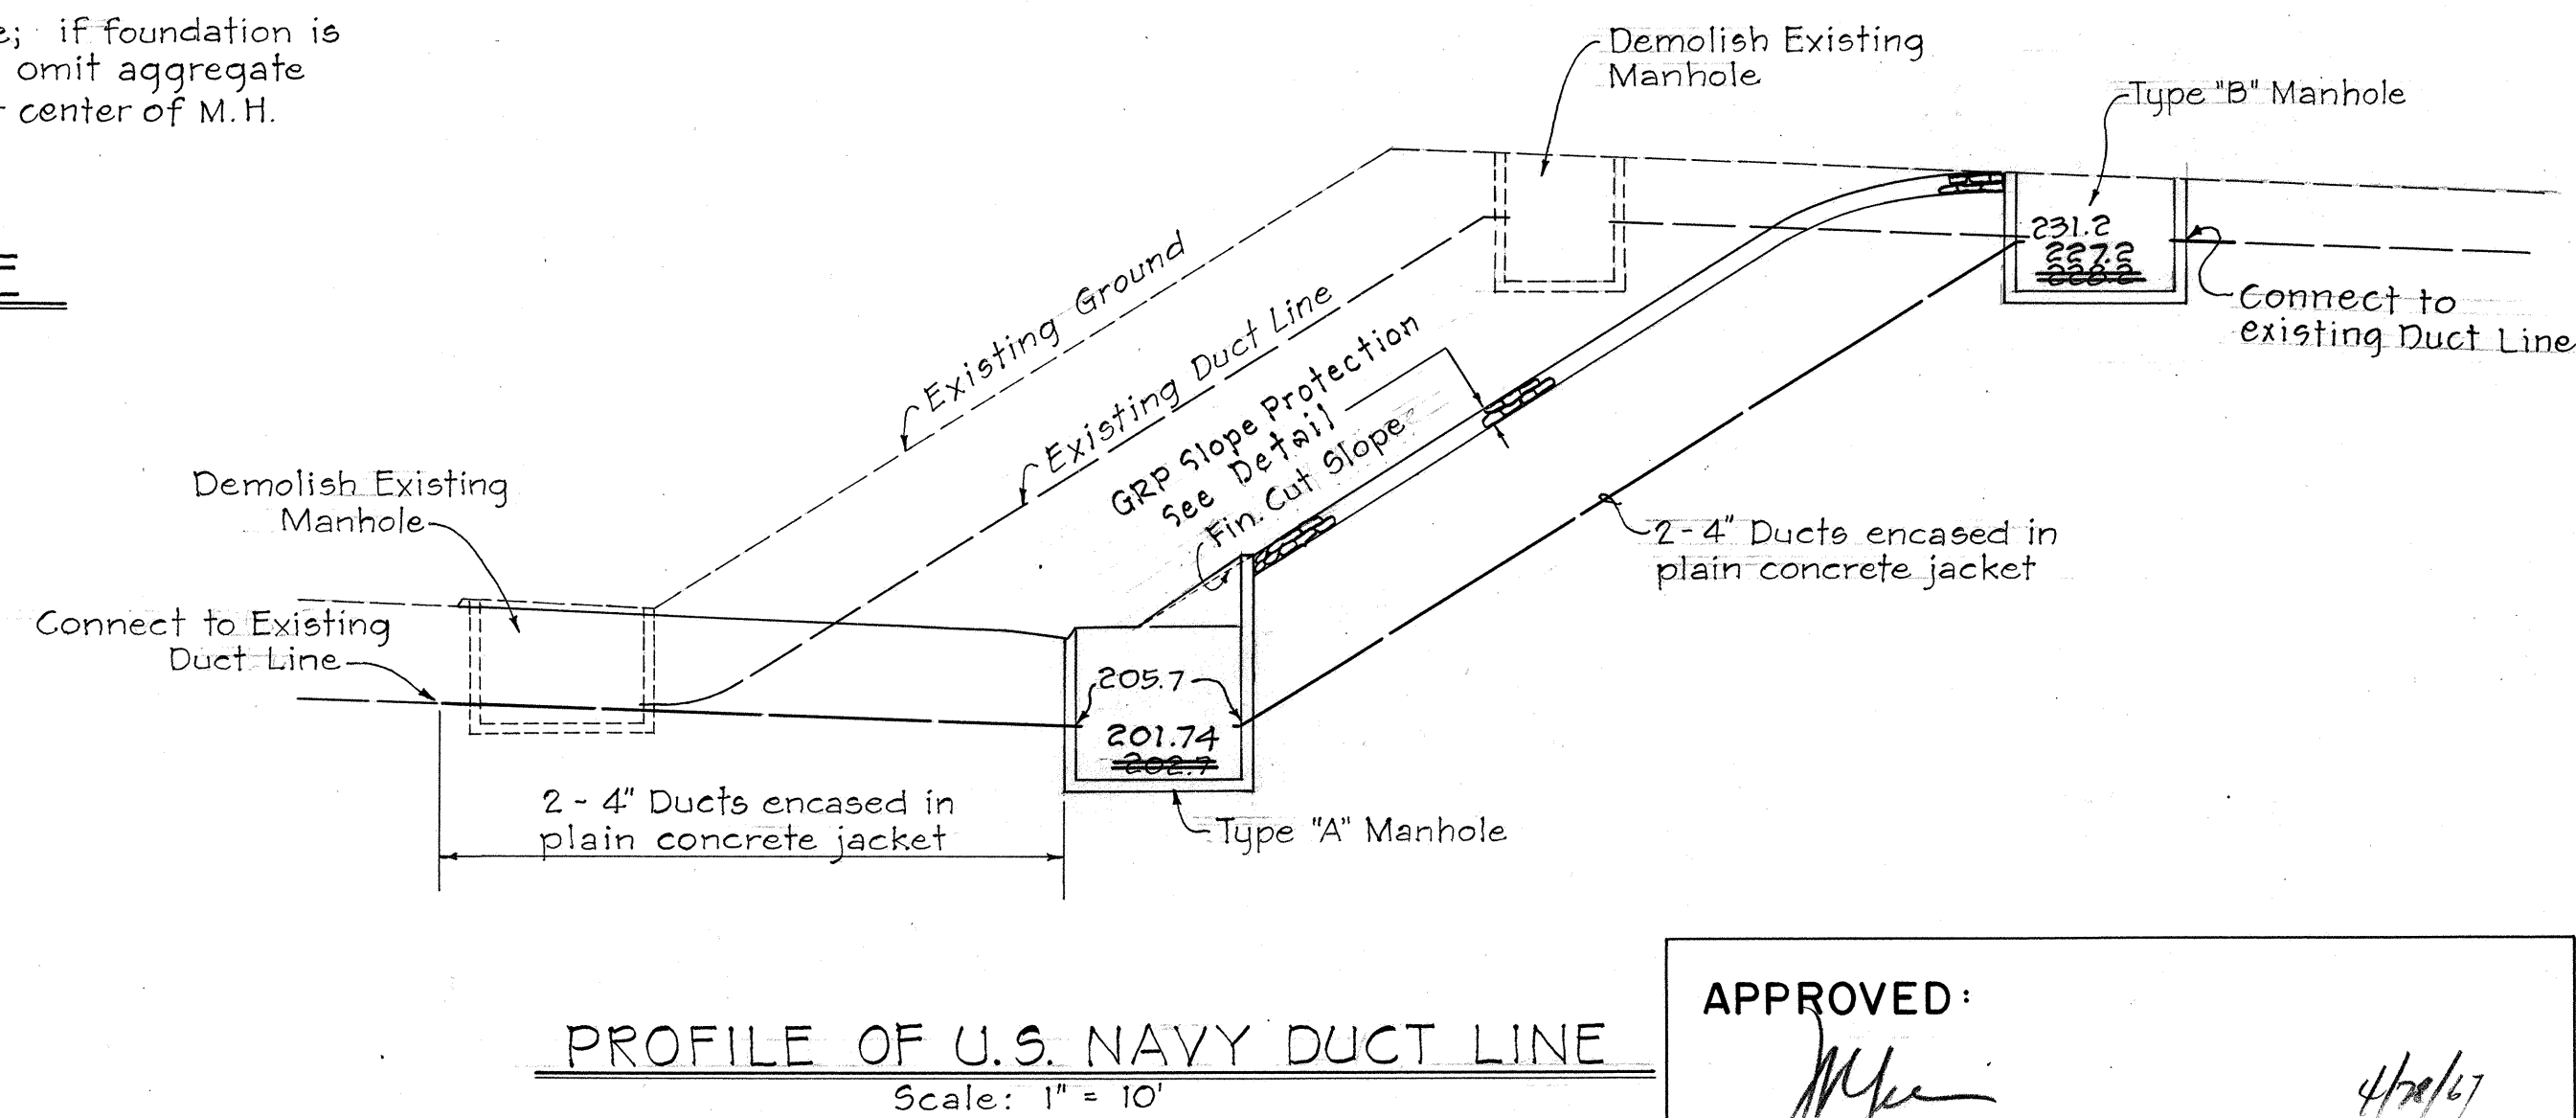
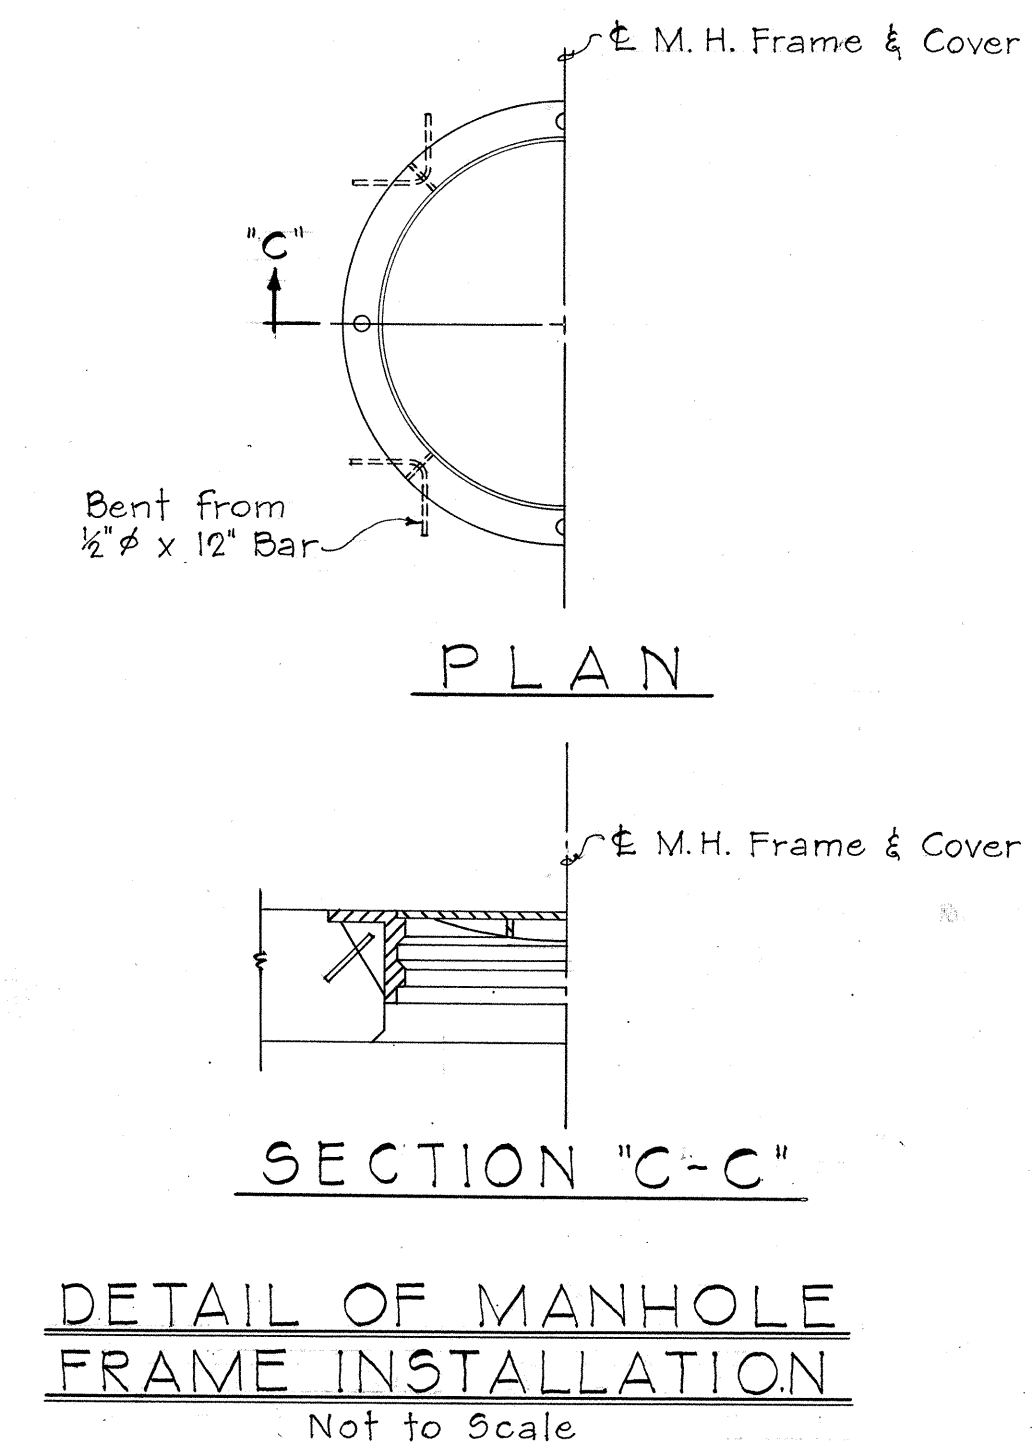
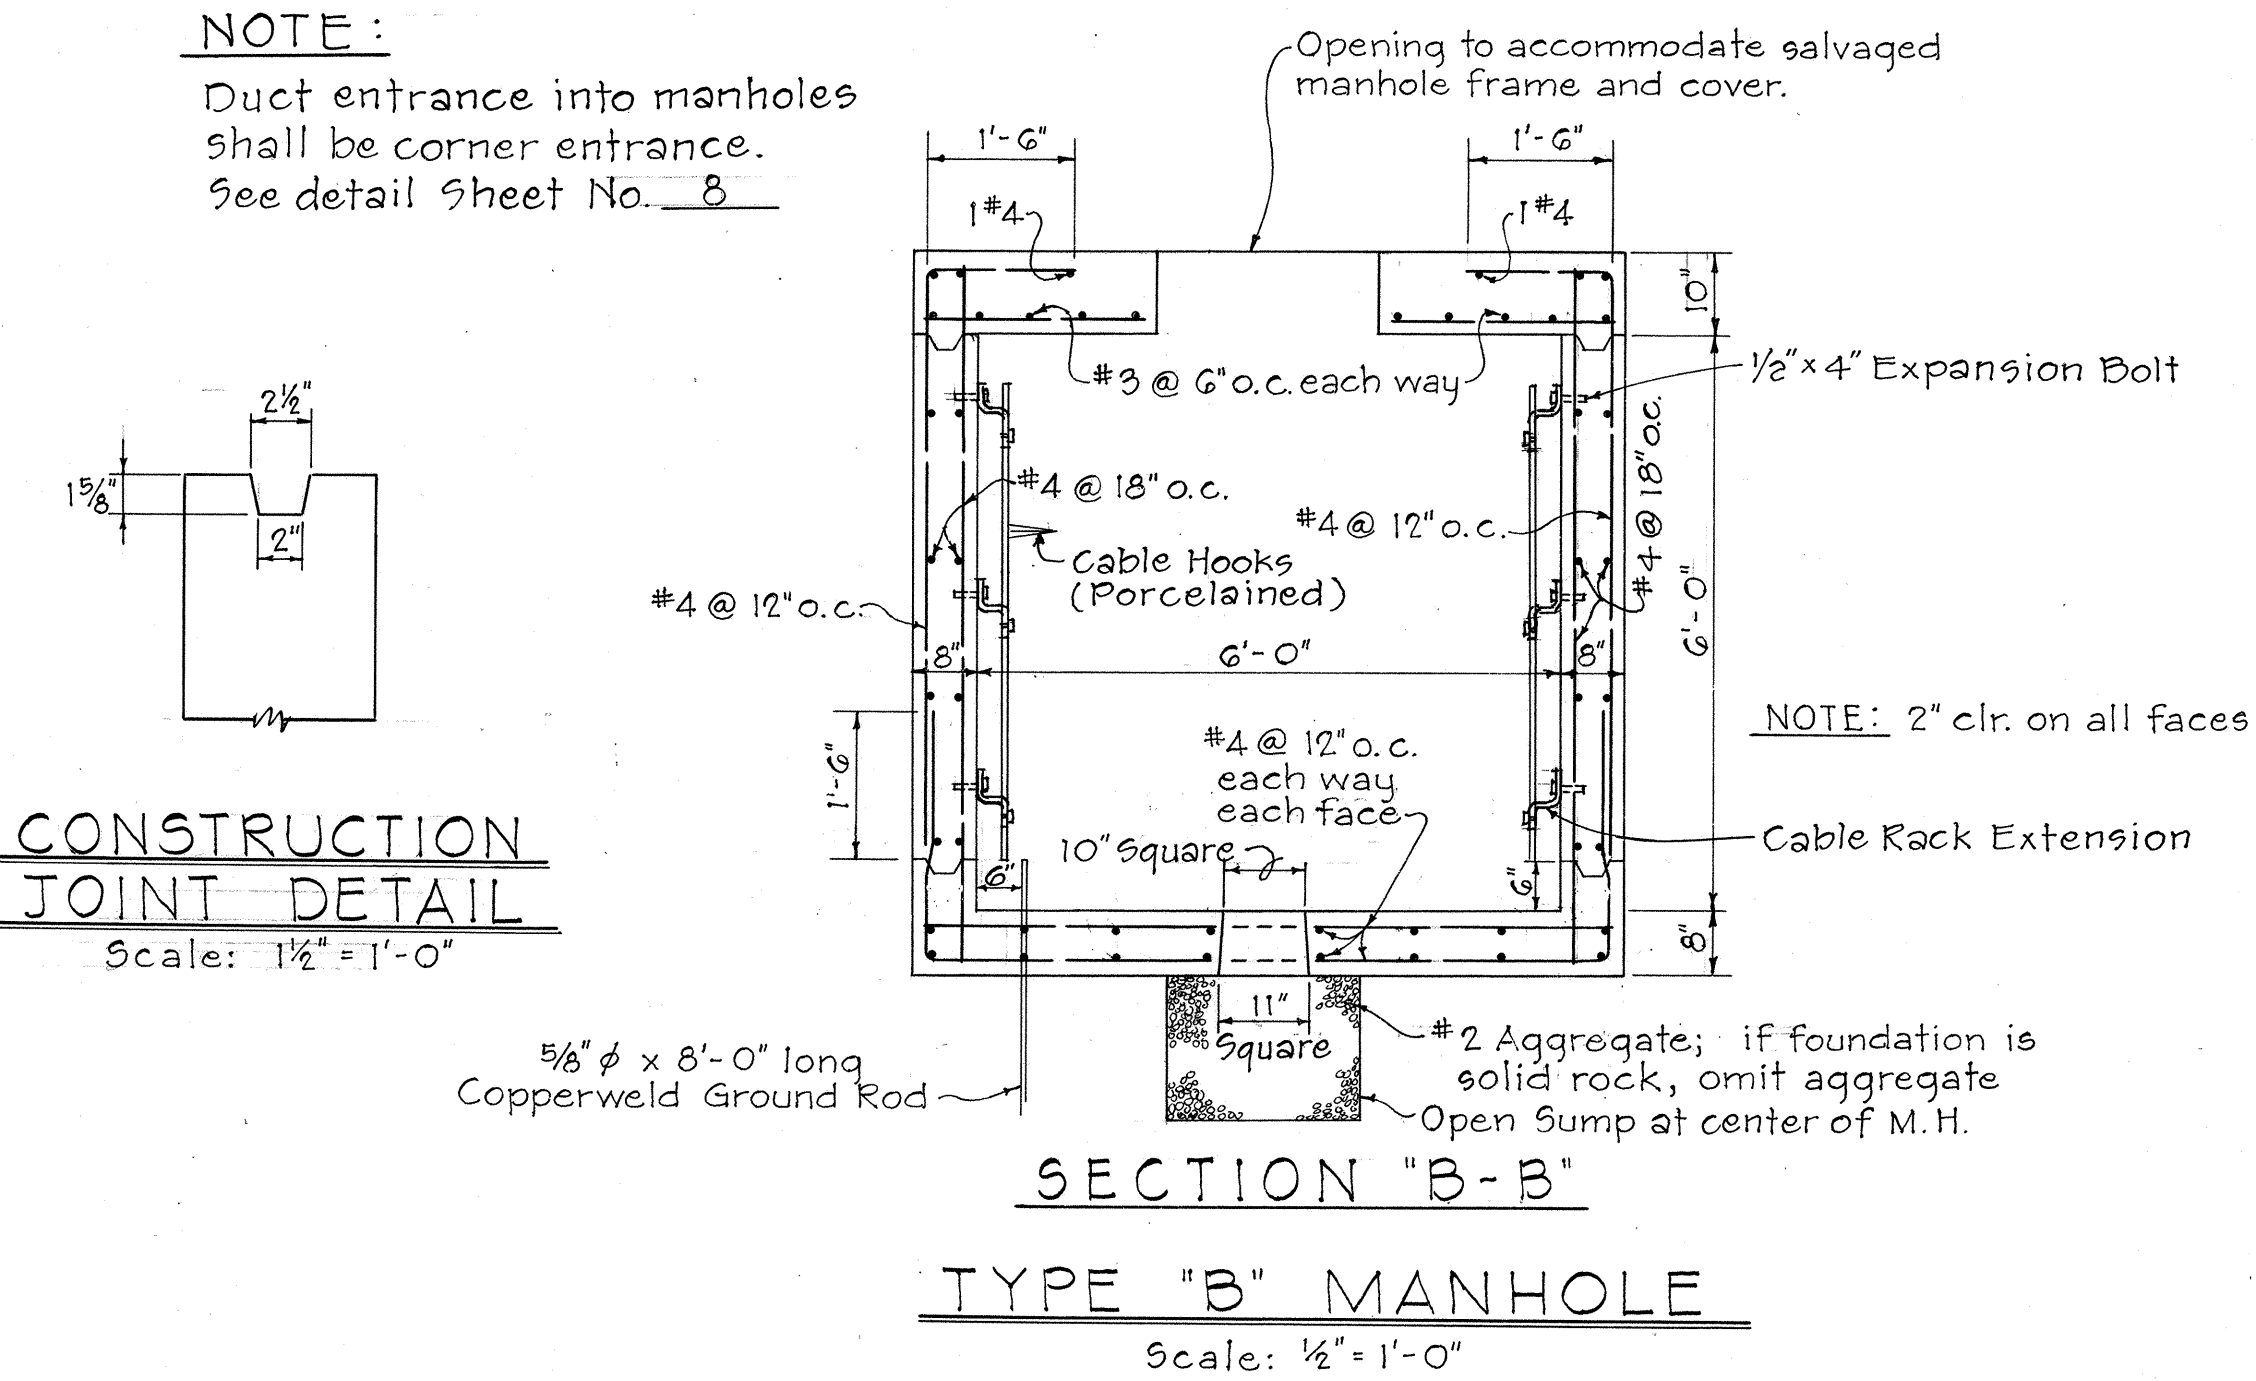
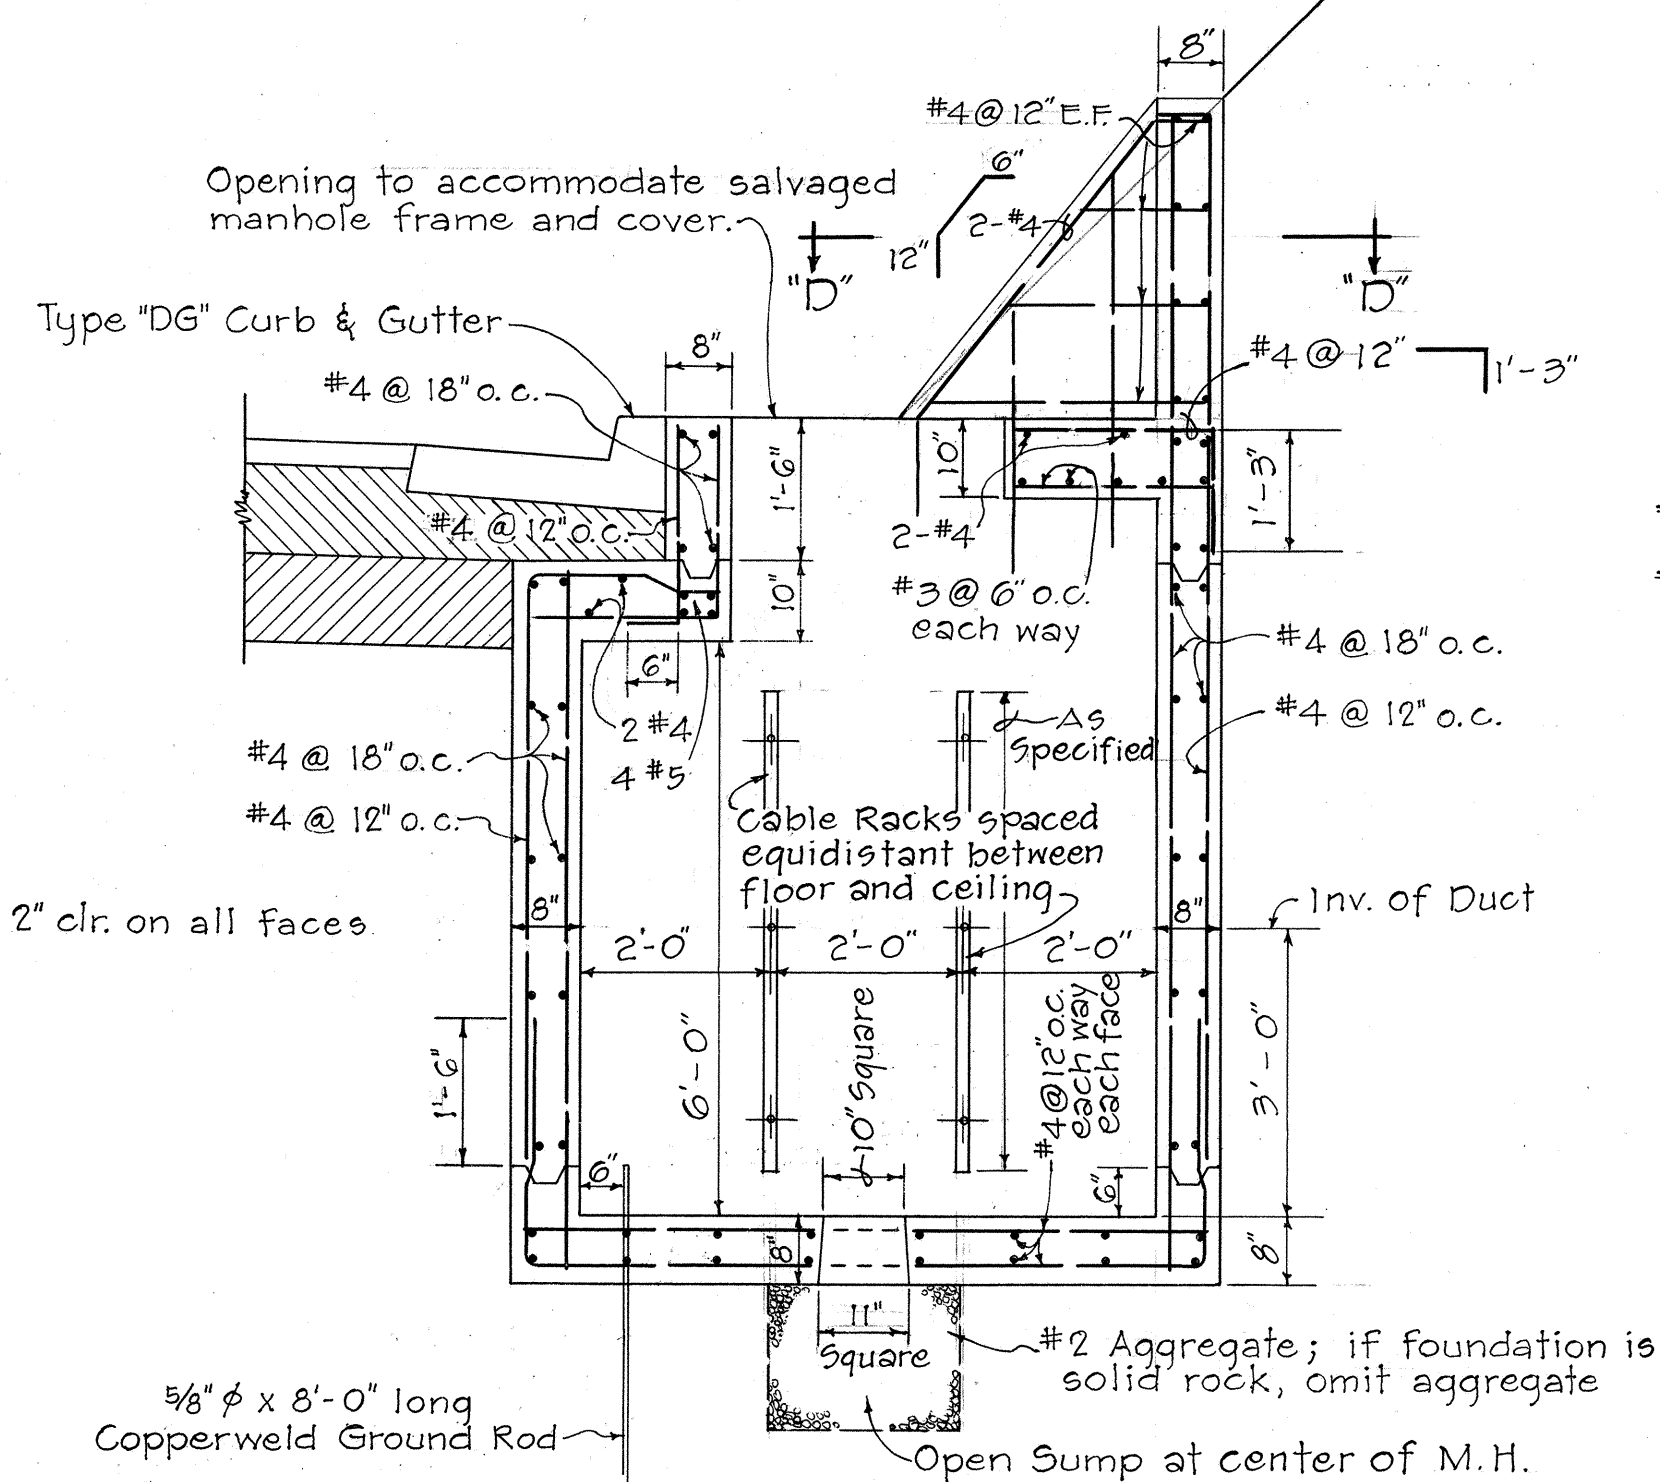
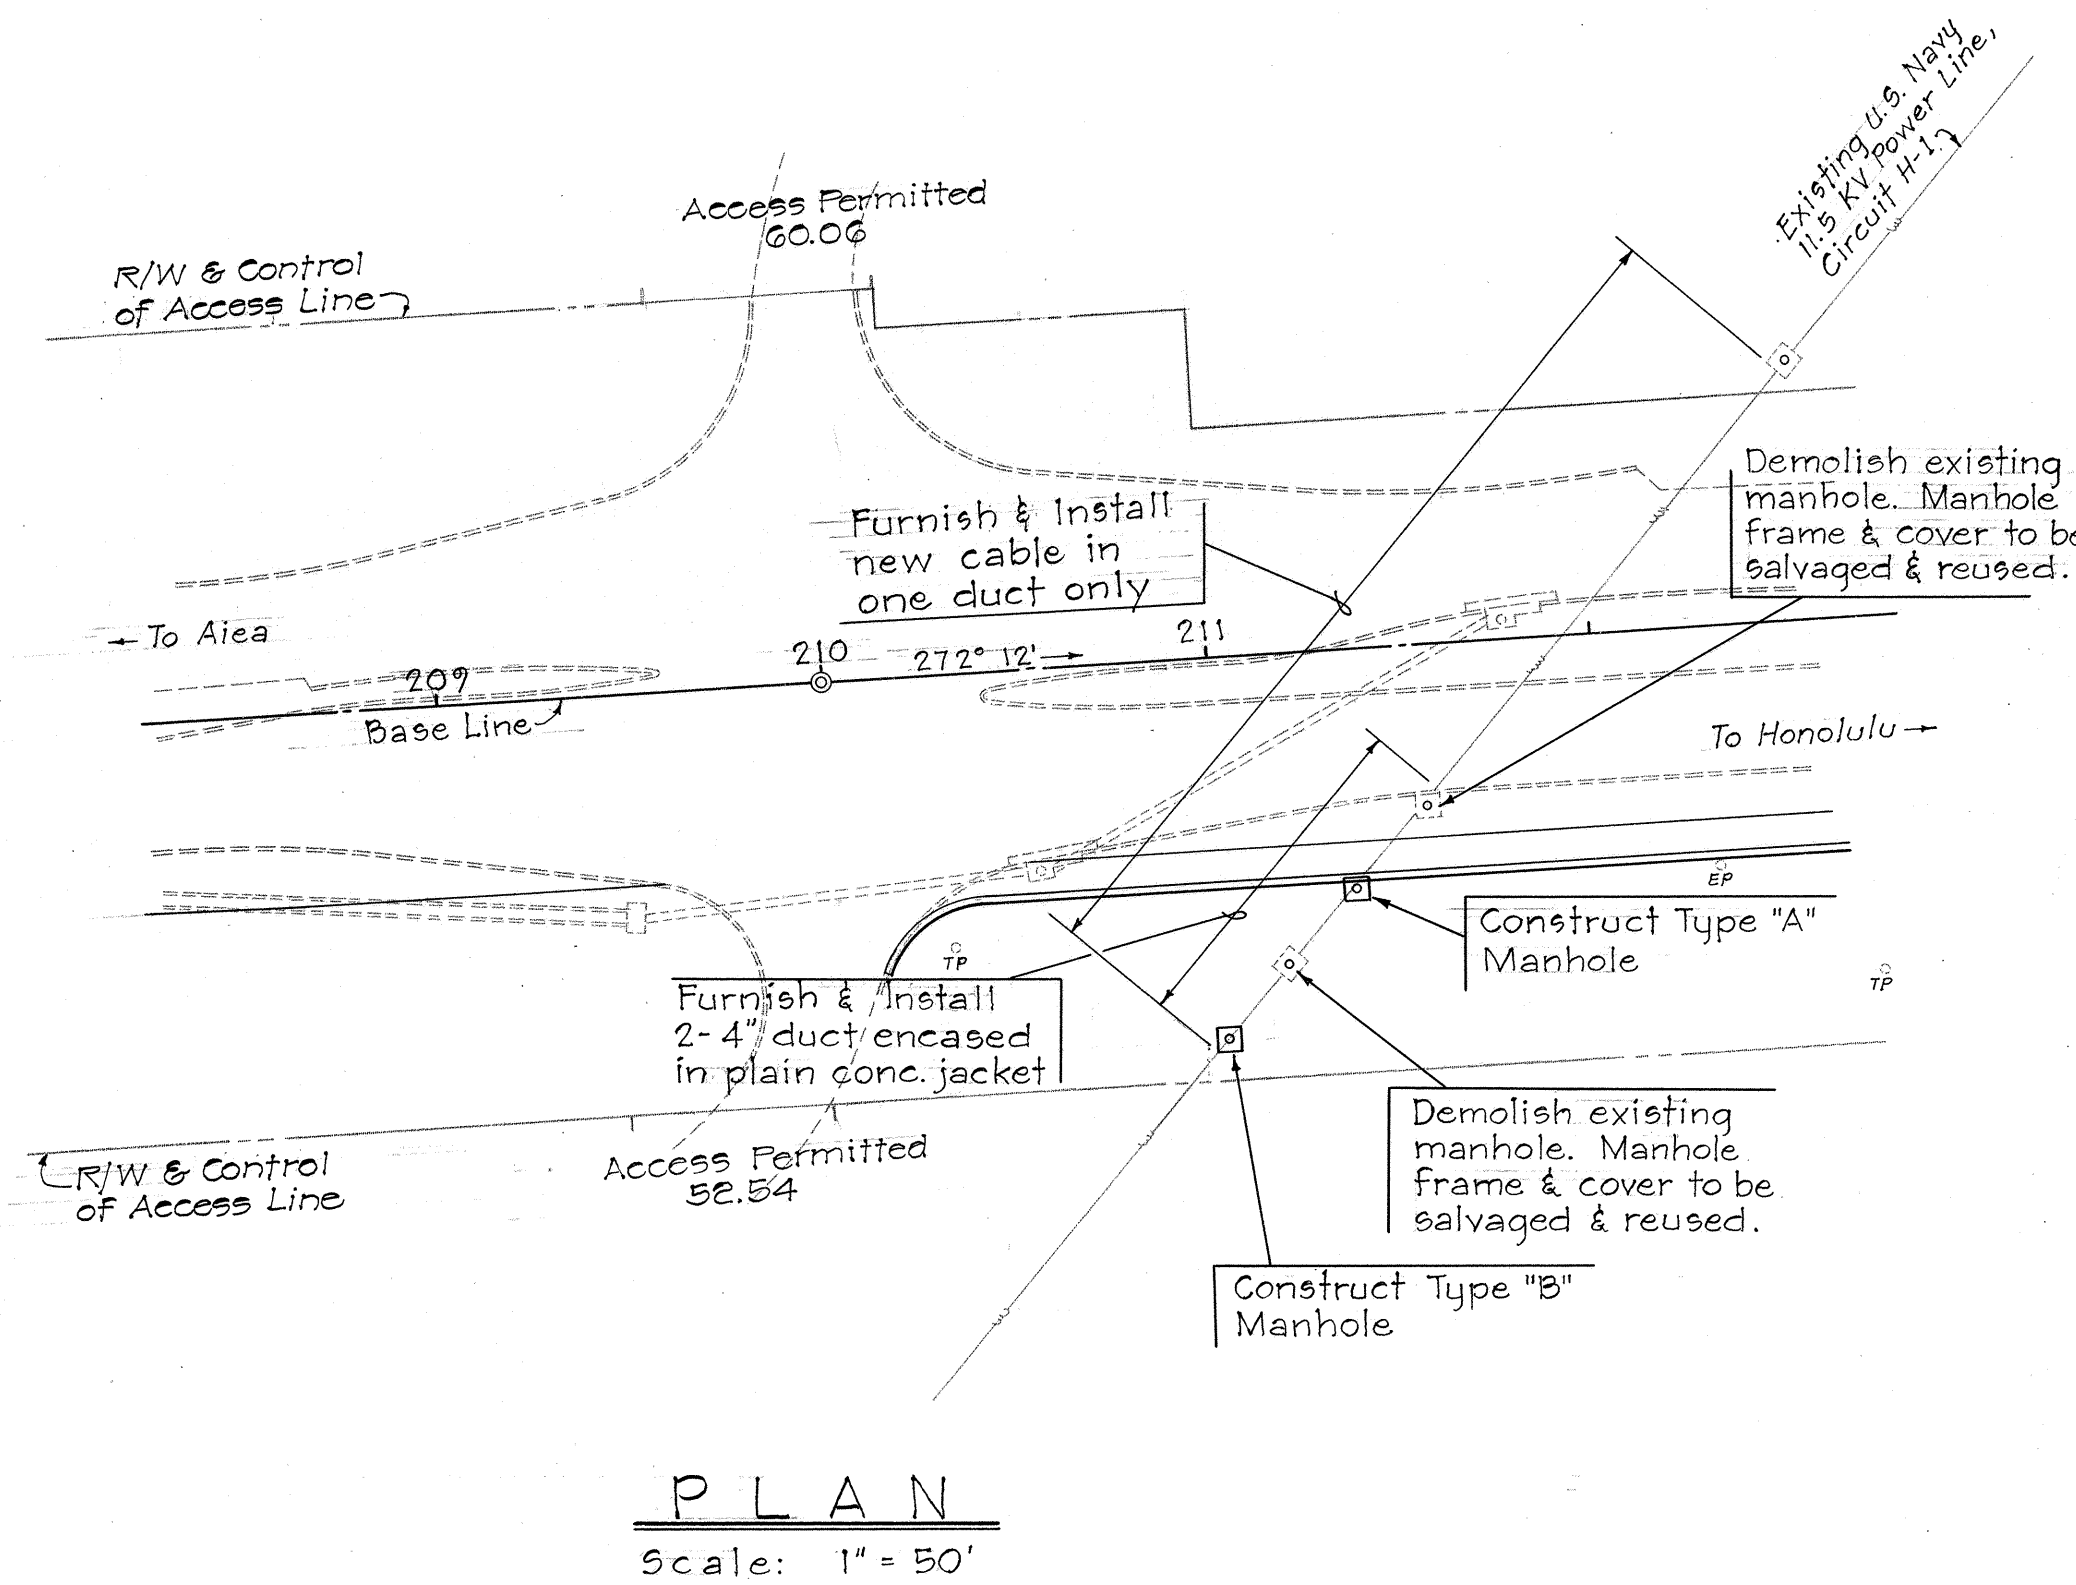


FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	FISCAL YEAR	SHEET NO.	TOTAL SHEETS
HAWAII	HAW.	U-072-1(21)	1967	7	35

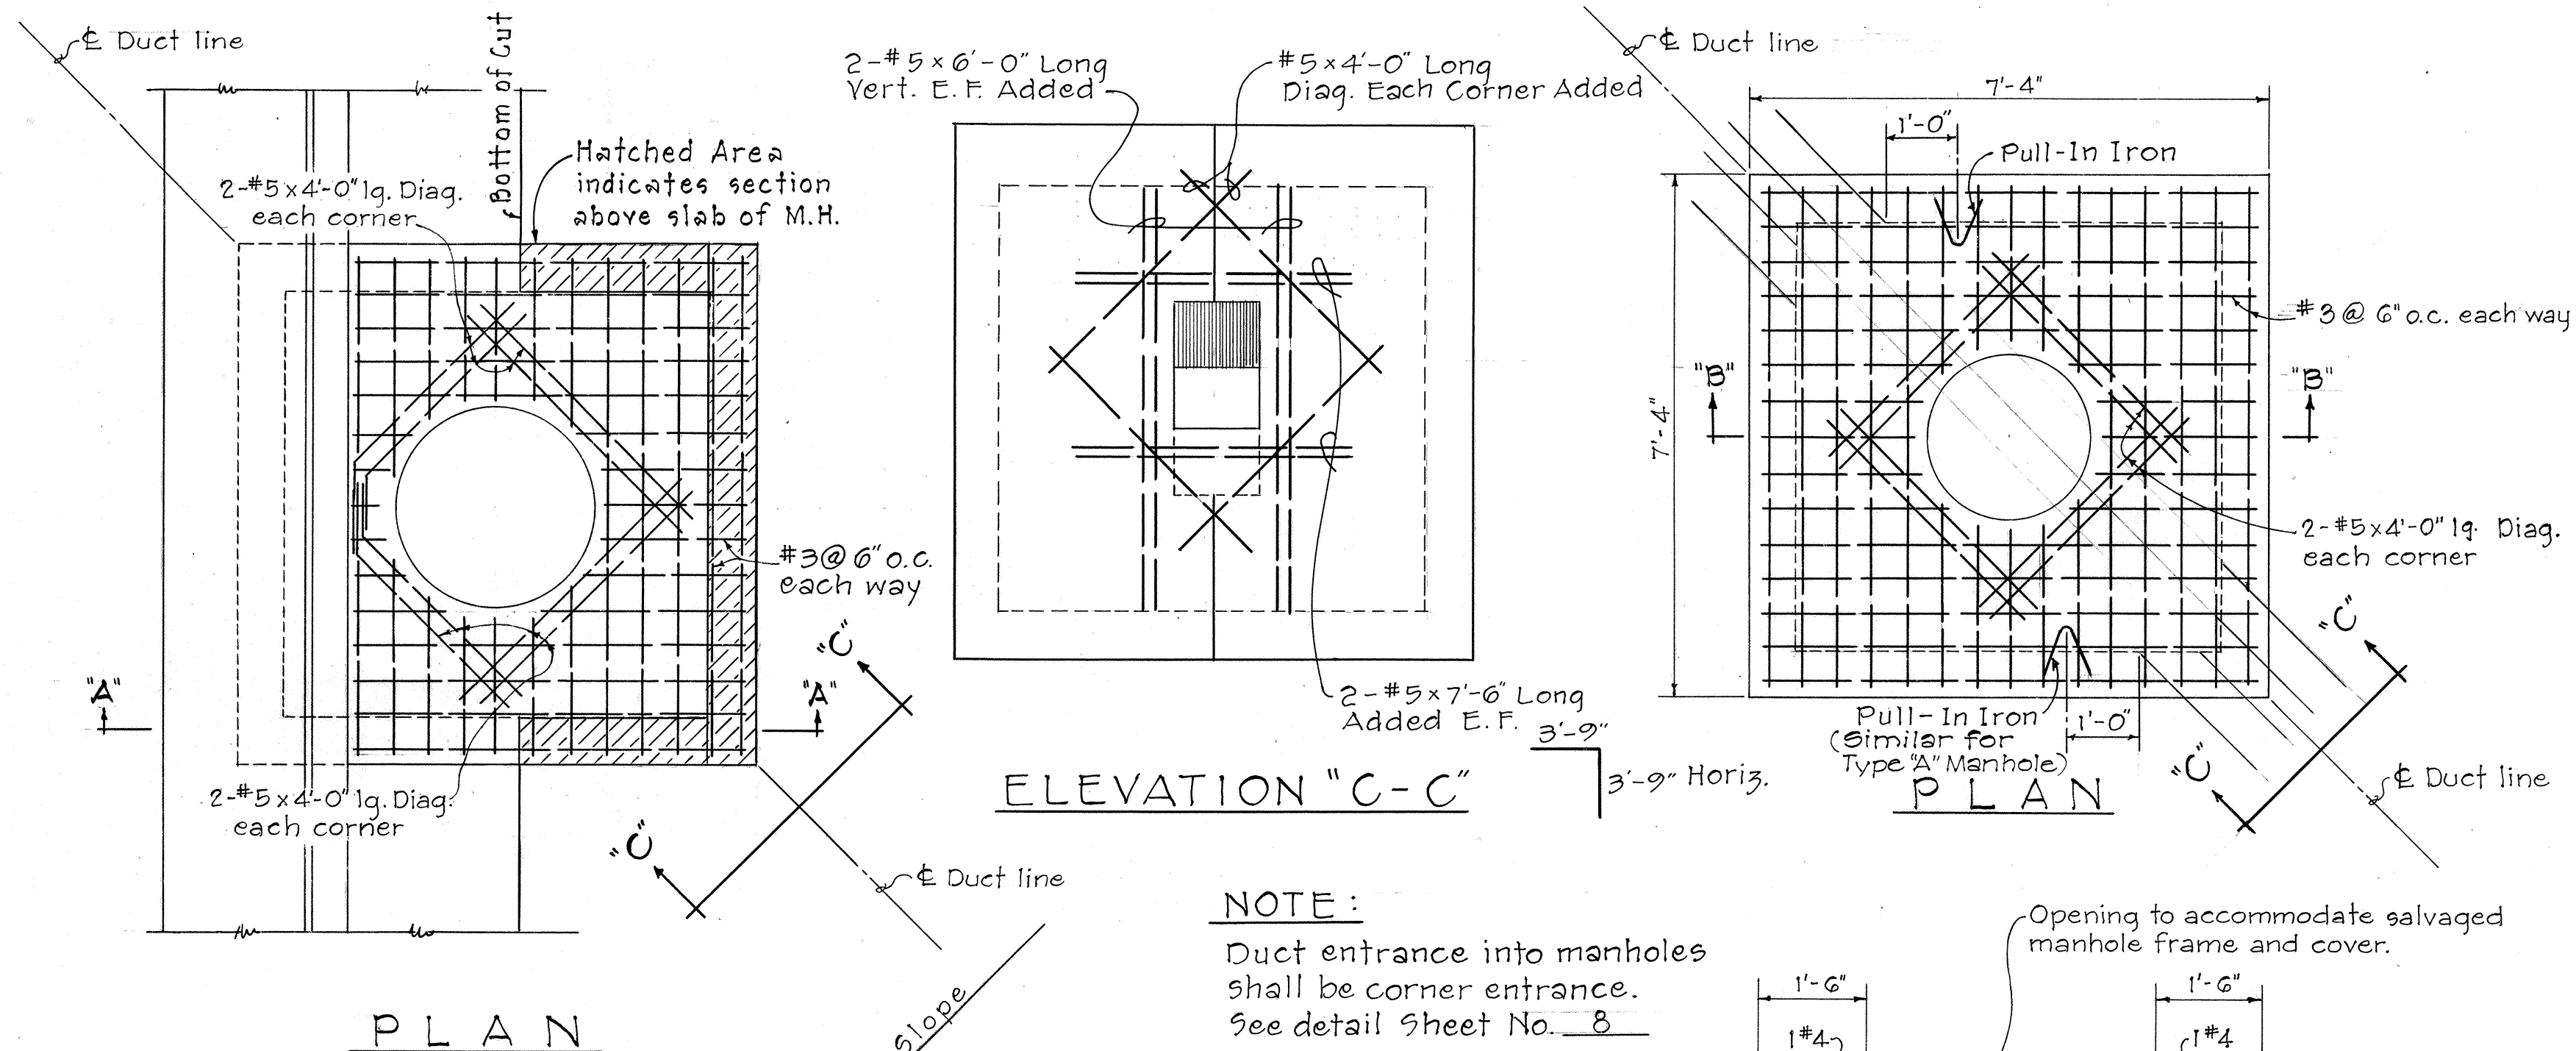

- NOTES:**
- Duct entrances at manholes to be spaced equidistant between the manhole floor and ceiling as much as possible.
 - Inverts for ducts and manholes are approximate only. Exact inverts to be determined by the Engineer.
 - Cable Racks to be installed on four walls of manhole.
 - Existing cable which is not to be incorporated in the final work shall be abandoned.

APPROVED:

[Signature]

COMMANDER, PACIFIC DIVISION, NAVY FACILITIES, ENGINEERING COMMAND

4/24/67

DATE

STATE OF HAWAII
DEPARTMENT OF TRANSPORTATION
HIGHWAYS DIVISION
**ADJUSTMENT OF EXISTING
NAVY UNDERGROUND DUCT LINE**
MOANALUA ROAD
TRUCK CLIMBING LANE
F.A. PROJ. NO. U-072-1(21)
Scale: As Shown Sept., 1966
SHEET NO. 1 OF 2 SHEETS

SURVEY PLOTTED BY: _____
DATE: _____
DRAWN BY: _____
CHECKED BY: _____
NOTE BOOK NO. _____

